

STRUCTURAL NOTES

GENERAL

- THIS PROJECT SHALL MEET ALL REQUIREMENTS OF THE CITY OF DELAND (VOLUSIA COUNTY), AND THE 2017 FLORIDA INTERNATIONAL BUILDING CODE 6TH EDITION.
- THE GENERAL CONTRACTOR SHALL VERIFY THE SIZE AND LOCATION OF ALL ARCHITECTURAL, MECHANICAL, PLUMBING, AND ELECTRICAL OPENINGS (COORDINATE WITH APPLICABLE TRADES). THE CONTRACTOR SHALL PROVIDE FOR ALL OPENINGS, WHETHER SHOWN ON THE STRUCTURAL DRAWINGS OR NOT. ANY DEVIATION FROM OPENINGS SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE BROUGHT TO THE ENGINEER'S ATTENTION FOR APPROVAL PRIOR TO CONSTRUCTION.
- THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS SHOWN ON THE STRUCTURAL DRAWINGS WITH THE ARCHITECTURAL DRAWINGS BEFORE CONSTRUCTION AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES OR INCONSISTENCIES BEFORE PROCEEDING WITH THE WORK.
- COMPLETE SHOP DRAWINGS AS REQUIRED FOR THE STRUCTURAL WORK SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW PRIOR TO COMMENCEMENT OF CONSTRUCTION IN ACCORDANCE WITH THE SPECIFICATIONS. SUCH REVIEW BY THE ENGINEER DOES NOT RELIEVE THE CONTRACTOR OF FULL RESPONSIBILITY FOR CORRECT FABRICATION AND CONSTRUCTION OF THE WORK. ALLOW TEN (10) BUSINESS DAYS FOR REVIEW FROM THE TIME SUBMITTALS ARE RECEIVED IN OUR OFFICE.
- ANY DEVIATION FROM, ADDITION TO, SUBSTITUTION FOR, OR MODIFICATION TO THE STRUCTURE OR ANY PART OF THE STRUCTURE DETAILED ON THESE DRAWINGS SHALL BE SUBMITTED IN WRITING TO THE ENGINEER FOR REVIEW. SHOP DRAWINGS THAT ARE SUBMITTED FOR REVIEW DO NOT CONSTITUTE "IN-WRITING" UNLESS IT IS CLEARLY NOTED THAT SPECIFIC CHANGES ARE BEING SUGGESTED.
- THE STRUCTURAL DRAWINGS ARE NOT TO BE SCALED FOR DETERMINATION OF QUANTITIES, LENGTHS, OR FIT OF MATERIALS.
- THE STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHODS OF CONSTRUCTION UNLESS SO STATED OR NOTED. THE CONTRACTOR SHALL PROVIDE ALL MEASURES NECESSARY TO PROTECT THE WORKMEN AND OTHER PERSONS DURING CONSTRUCTION.

SPECIAL INSPECTION

THE FOLLOWING ITEMS REQUIRE SPECIAL INSPECTION:
(REFERENCE ADJACENT TABLES FOR ADDITIONAL INFORMATION.)

- SOILS AND FOUNDATIONS
- CAST-IN-PLACE CONCRETE
- WOOD CONSTRUCTION
- SPECIAL CASES (EPOXY ANCHORS)

DESIGN LOADS

- ROOF LIVE LOAD 20 PSF
- ROOF DEAD LOAD 20 PSF
- WIND LOAD BASED ON ASCE 7-10
V_{ULT} = 133 MPH
V_{ASD} = 103 MPH
RISK CATEGORY = II
EXPOSURE CATEGORY C
INTERNAL PRESSURE COEFFICIENT GC_p: ±0.18

- SEISMIC LOADS
S_s = 0.081
S_i = 0.042
SITE CLASS D
S₀₈ = 0.086
S₀₁ = 0.067
DESIGN CATEGORY - II
SNOW LOADS : N/A
- SEE ROOF PLAN FOR ADDITIONAL MECHANICAL LOADS.

FOUNDATION DESIGN AND SITEWORK FOR BUILDING (NOTE: UPDATE PER SITE SPECIFIC GEOTECHNICAL REPORT)

- THE FOUNDATION DESIGN OF THIS PROJECTS WAS BASED ON BEARING CAPACITY OF 3,000 PSF PROVIDED ON GEOTECHNICAL REPORT PREPARED BY TERRACON CONSULTANTS, INC WITH A REPORT NO. H1205226, DATED AUGUST 20, 2020.
- FOUNDATION DESIGN AND SITEWORK SHALL BE VERIFIED PRIOR TO PLACEMENT OF CONCRETE. A WRITTEN VERIFICATION SIGNED AND SEALED BY A GEOTECHNICAL ENGINEER SHALL BE SUBMITTED TO THE STRUCTURAL ENGINEER OF RECORD STATING THAT THE BEARING ELEVATIONS EXPOSED AFTER SITE STRIPPING HAVE BEEN INSPECTED AND ARE ADEQUATE TO SUPPORT A MINIMUM OF 1500 PSF (ALLOWABLE SOIL BEARING CAPACITY) AND THE SOILS SUPPORTING THE SLAB-ON-GRADE ARE ADEQUATE TO MINIMIZE DIFFERENTIAL MOVEMENT TO LESS THAN 1/2" AND TOTAL MOVEMENT TO LESS THAN 1".
- REMOVE ALL VEGETATION AND DEBRIS, INCLUDING PAVEMENTS, SIDEWALKS, BUILDING FOUNDATIONS, AND ABANDONED UTILITIES.
- REMOVE ORGANIC SOIL TO A DEPTH OF ±6 INCHES.
- PROOFROLL THE EXPOSED SUBGRADE TO DETECT SOFT OR YIELDING SOILS. REMOVE ANY SOFT OR YIELDING SOILS, SCARIFY, MOISTURE CONDITION AND RECOMPACT IN ACCORDANCE WITH ASTM D-698.
- SOILS EXCAVATED FROM THE SITE THAT ARE FREE OF DELETERIOUS MATERIALS MAY BE USED AS FILL.
- RAISE EXCAVATIONS AND LOW AREAS WITH COMPACTED FILL (ASTM D-698).
- STRUCTURAL FILL SHALL BE COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D-698. THE IN-PLACE MOISTURE CONTENT FOR COHESIVE SOILS SHALL NOT VARY BY MORE THAN -1% TO +3% AND GRANULAR SOIL ±3% OF THE OPTIMUM MOISTURE CONTENT.
- FOUNDATION DESIGN IS BASED ON AN ALLOWABLE BEARING PRESSURE OF 1,500 PSF AT MINIMUM 18" INTO SUITABLE EXISTING SOILS. MINIMUM CONTINUOUS FOOTING WIDTH IS 16 INCHES. MINIMUM FOOTING DEPTH IS 18" BELOW GRADE.
- PROVIDE POSITIVE DRAINAGE AWAY FROM EXCAVATIONS SO AS NOT TO ALLOW STANDING WATER FOR LONG PERIODS OF TIME.
- PROVIDE A 6 MIL THICK VAPOR BARRIER BETWEEN THE COMPACTED BASE AND CONCRETE SLAB.
- DO NOT PUNCTURE THE VAPOR BARRIER, LAP AND TAPE ENDS.
- BACKFILL AND COMPACT UTILITY TRENCHES AS DESCRIBED ABOVE.
- PERFORM ALL SITEWORK UNDER THE DIRECT SUPERVISION OF A GEOTECHNICAL ENGINEER.

CONCRETE

- ALL CONCRETE SHALL BE NORMAL WEIGHT, WITH A MINIMUM COMPRESSIVE STRENGTH OF 3,500 PSI AT 28 DAYS, (U.N.O.). DESIGNER: USE A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI FOR SNOW LOCATIONS.
- MINIMUM CEMENT CONTENT SHALL BE 5 SACKS PER CUBIC YARD.
- TYPE C OR F FLY ASH MAY BE USED UP TO 20% OF TOTAL CEMENT CONTENT BY VOLUME. THIS IS ONLY FOR CONCRETE SPECIFIED IN THESE STRUCTURAL DRAWINGS. REFER TO SPECIFICATIONS BY OTHER DISCIPLINES.
- MAXIMUM SLUMP SHALL BE 5 IN. U.N.O.
- MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE AMERICAN CONCRETE INSTITUTE'S "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS", ACI 301.
- CONCRETE MIX SHALL NOT USE ANY ADMIXTURES WHICH CONTAIN CALCIUM CHLORIDE.
- CONCRETE TEST REPORTS SHALL BE MADE AVAILABLE AT THE JOB SITE. CONTRACTOR SHALL SUBMIT CONCRETE MIX DESIGN PER SPECIFICATIONS PRIOR TO PLACEMENT CONCRETE.

REINFORCING STEEL

- BARS SHALL BE ASTM A615, GRADE 60.
- DETAIL, FABRICATE AND PLACE IN CONFORMANCE WITH ACI 315 AND 318.
- LAP ALL REINFORCING STEEL 40 BAR DIAMETERS (U.N.O.).
- LAP CONTINUOUS BARS IN GRADE BEAMS 40 BAR DIAMETERS (U.N.O. ON DRAWINGS). TOP BARS TO BE SPICED BETWEEN SUPPORTS AND BOTTOM BARS TO BE SPICED AT SUPPORTS, AS APPLICABLE.
- PROVIDE ACCESSORIES FOR SUPPORT OF ALL REINFORCING.
- SUBMIT SHOP DRAWINGS SHOWING ALL REINFORCING FOR APPROVAL BY THE STRUCTURAL ENGINEER OF RECORD.
- THE FOLLOWING MINIMUM CONCRETE COVER SHALL BE PROVIDED FOR REINFORCEMENT.

	MINIMUM COVER, IN.
A. CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH	3
B. CONCRETE EXPOSED TO EARTH OR WEATHER: #6 THROUGH #18 BAR #6 BAR, W31 OR D31 WIRE, AND SMALLER	2 1½
C. CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND: SLABS, WALLS, JOISTS: #14 AND #18 BARS #11 BAR AND SMALLER BEAMS, COLUMNS: PRIMARY REINFORCEMENT, TIES, STIRRUPS, SPIRALS	1½ ¾ 1½

CONCRETE MASONRY UNITS

- CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C90, TYPE 1, WITH COMPRESSIVE STRENGTH (f_m) OF 1,500 PSI
- GROUT FOR CONCRETE MASONRY SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 2,500 PSI
- MORTAR SHALL BE TYPE N, U.N.O.
- REINFORCING IN MASONRY WALLS SHALL BE GRADE 60, ASTM A615.
- TYPICAL REINFORCING
VERTICAL - REF. PLAN FOR SIZE AND SPACING
HORIZONTAL - #9 WIRE IN DUR-O-WALL (LADUR TRUSS TYPE) OR APPROVED EQUAL AT 16" O.C. IN MASONRY WALLS, EXCEPT AT 8" O.C. FOR WALL BELOW GRADE OR STACK BOND WALLS (U.N.O. ON DRAWINGS).
- MATERIALS AND WORKMANSHIP SHALL CONFORM TO DESIGN REQUIREMENTS BASED UPON THE AMERICAN CONCRETE INSTITUTE'S "BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES", ACI 530.

POST-INSTALLED ANCHORS

- EXCEPT WHERE NOTED ON DRAWINGS, USE WWW.STRONGTIE.COM FOR ADDITIONAL PRODUCT DATA. IT IS ACCEPTABLE TO USE THE SIMPSON SET-XP ADHESIVE SYSTEM OR APPROVED EQUAL (TYP. U.N.O.) ICC ESR-2508.
- EXCEPT WHERE INDICATED ON THE DRAWINGS, HILTI PRODUCTS MAY BE USED. CONTACT HILTI AT (800) 879-8000 FOR PRODUCT RELATED QUESTIONS.
- ANCHOR CAPACITY USED IN DESIGN SHALL BE BASED ON THE TECHNICAL DATA PUBLISHED OR SUCH OTHER METHOD AS APPROVED BY THE STRUCTURAL ENGINEER OF RECORD. SUBSTITUTION REQUESTS FOR ALTERNATE PRODUCTS MUST BE APPROVED IN WRITING BY THE STRUCTURAL ENGINEER OF RECORD PRIOR TO USE. CONTRACTOR SHALL PROVIDE CALCULATIONS DEMONSTRATING THAT THE SUBSTITUTED PRODUCT IS CAPABLE OF ACHIEVING THE PERFORMANCE VALUES OF THE SPECIFIED PRODUCT. SUCH SUBSTITUTIONS WILL BE EVALUATED BY THEIR HAVING AN ICC ESR SHOWING COMPLIANCE WITH THE RELEVANT BUILDING CODE FOR SEISMIC USES, LOAD RESISTANCE, INSTALLATION CATEGORY, AND AVAILABILITY OF COMPREHENSIVE INSTALLATION INSTRUCTIONS. ADHESIVE ANCHOR EVALUATION WILL ALSO CONSIDER CREEP, IN-SERVICE TEMPERATURE AND INSTALLATION TEMPERATURE.
- INSTALL ANCHORS PER THE MANUFACTURER INSTRUCTIONS, AS INCLUDED IN THE ANCHOR PACKAGING.
- INSTALL ACCORDING TO MANUFACTURER'S SPECIFICATIONS. THREADED ROD AND REBAR DIAMETERS AND EMBEDMENT LENGTHS SHALL BE AS NOTED ON DRAWINGS.
- OVERHEAD ADHESIVE ANCHORS MUST BE INSTALLED USING PRODUCTS WHICH HAVE SPECIFIC APPLICATIONS THAT ARE INTENDED FOR OVERHEAD USE.
- RECOMMENDED FOR CONTRACTOR TO ARRANGE AN ANCHOR MANUFACTURER'S REPRESENTATIVE TO PROVIDE ONSITE INSTALLATION TRAINING FOR ALL OF THEIR ANCHORING PRODUCTS SPECIFIED.
- ANCHOR CAPACITY IS DEPENDANT UPON SPACING BETWEEN ADJACENT ANCHORS AND PROXIMITY OF ANCHORS TO EDGE OF CONCRETE. INSTALL ANCHORS IN ACCORDANCE WITH SPACING AND EDGE CLEARANCES INDICATED ON THE DRAWINGS.
- EXISTING REINFORCING BARS IN THE CONCRETE STRUCTURE MAY CONFLICT WITH SPECIFIC ANCHOR LOCATIONS. UNLESS NOTED ON THE DRAWINGS THAT THE BARS CAN BE CUT, THE CONTRACTOR SHALL REVIEW THE EXISTING STRUCTURAL DRAWINGS AND SHALL UNDERTAKE TO LOCATE THE POSITION OF THE REINFORCING BARS AT THE LOCATIONS OF THE CONCRETE ANCHORS, BY FERROSCAN, GPR, X-RAY, CHIPPING OR OTHER MEANS.
- CONTRACTOR SHALL USE THE NECESSARY MEANS, AS REQUIRED BY OSHA TO PROTECT FROM DUST DRILLING OPERATIONS.

LIGHT GAGE METAL FRAMING

- STEEL STUD SIZES SHALL BE AS NOTED ON THE DRAWINGS, CONFORMING TO SSMA STANDARDS.
- FABRICATE AND ERECT ALL MANUFACTURER SHALL SUPPLY ALL CLIPS, FASTENERS, TEMPORARY BRACING, ACCESSORIES, STANDARD BRIDGING, ETC.
- ALL STEEL STUDS SHALL HAVE A MINIMUM 1½" FLANGE WITH A ½" RETURN (U.N.O.).
- ALL STUDS 18 GAGE AND THINNER SHALL HAVE A MINIMUM YIELD STRENGTH, F_y, OF 33 KSI AND TENSILE STRENGTH, F_u, OF 45 KSI. ALL STUDS 16 GAGE AND THICKER SHALL HAVE A MINIMUM STRENGTH OF 50 KSI AND TENSILE STRENGTH OF 65 KSI (U.N.O.).
- TRACK SECTIONS SHALL BE EQUAL GRADE AND GAGE THICKNESS OF STUDS BEING USED. TYPICAL, U.N.O.
- ALL FASTENERS SHALL BE SELF-TAPPING NO. 12-14 GAGE SCREWS, OR WELD IN ACCORDANCE WITH SECTION 6.0 OF THE AMERICAN WELDING SOCIETY'S "STRUCTURAL WELDING CODE - SHEET METAL" (AWS D1.3) AS SHOWN ON DRAWINGS.

STRUCTURAL WOOD

- WOOD FRAMING SHALL COMPLY WITH THE SOUTHERN PINE INSPECTION BUREAU, OR SHALL CONFORM TO SPECIFICATIONS AS PUBLISHED BY THE WESTERN WOODS PRODUCTS ASSOCIATION.
- WOOD FRAMING 2 INCHES X 4 INCHES AND LARGER SHALL BE NO. 2 SOUTHERN PINE, NO. 2 DOUGLAS FIR LARCH, OR EQUIVALENT (U.N.O.).
- WOOD COLUMNS 6 INCHES X 6 INCHES AND LARGER SHALL BE NO. 1 SOUTHERN PINE, NO. 1 DOUGLAS FIR LARCH, OR EQUIVALENT.
- ALL EXPOSED WOOD FRAMING, UNLESS NOTED OTHERWISE, SHALL BE "SELECT" GRADE LUMBER.
- ALL PLATES IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED (USE CATEGORY 2 AS SPECIFIED BY AWPA) FOR MOISTURE PROTECTION. ALL WOOD EXPOSED TO WEATHER SHALL BE PRESSURE TREATED (USE CATEGORY 3B AS SPECIFIED BY AWPA) OR WESTERN RED CEDAR.
- ENGINEERED WOOD PRODUCTS
A. SIZES AND DESIGNATIONS ARE BASED ON PUBLISHED REDBUILT MEMBERS AS MANUFACTURED BY REDBUILT (FORMERLY THE COMMERCIAL DIVISION OF TRUS JOIST).
B. OTHER WOOD MEMBERS WILL BE PERMITTED WHERE LOAD CAPACITIES ARE EQUIVALENT AND SUBSTANTIATED BY PUBLISHED LOAD TABLES.
C. FABRICATOR SHALL SUBMIT SHOP DRAWINGS SHOWING LAYOUT OF MEMBERS, BRIDGING, BRACING, ERECTION DETAILS, TRUSS PENETRATIONS, AND DESIGN CALCULATIONS SEALED BY A REGISTERED ENGINEER (state).
D. FOR QUOTATIONS, SHOP DRAWINGS, AND MATERIAL ORDERS, CALL REDBUILT'S NATIONAL ACCOUNT SERVICE CENTER (WWW.REDBUILT.COM) AT 1-866-647-5757 AND ASK FOR THE ACCOUNT COORDINATOR FOR THIS PROJECT.
- METAL-PLATE-CONNECTED WOOD TRUSSES
A. TRUSS FABRICATION AND INSTALLATION SHALL COMPLY WITH THE FOLLOWING STANDARDS:
a. ANSI / TPI 1 - 2014- NATIONAL DESIGN STANDARD FOR METAL PLATE CONNECTED WOOD TRUSS CONSTRUCTION
b. BCSI-B1: GUIDE FOR HANDLING, INSTALLING, RESTRAINING & BRACING OF TRUSSES
c. BCSI-B2: TRUSS INSTALLATION & TEMPORARY RESTRAINT/ BRACING
d. BCSIES: PERMANENT RESTRAINT/BRACING OF CHORDS & WEB MEMBERS
B. TRUSSES SHALL BE DESIGNED FOR THE FOLLOWING LOADS
a. TOP CHORD: DEAD LOAD = 20 PSF
LIVE LOAD = 10 PSF
b. BOTTOM CHORD: DEAD LOAD = 5 PSF (NON-CONCURRENT)
LIVE LOAD = 10 PSF
NON-CONCURRENT LIVE LOAD = 10 PSF
c. ADDITIONAL MECHANICAL LOADS SHALL BE APPLIED TO THEIR RESPECTIVE CHORD MEMBER AS NOTED ON THE FLOOR/ROOF PLAN
d. SNOW DRIFT LOADS AND UNBALANCED ROOF SNOW LOADS AS INDICATED (WHERE APPLICABLE)
e. REQUIRED UPLIFT FOR COMPONENTS AND CLADDING LOADS AS INDICATED IN THE DESIGN LOADS SECTION OF THESE STRUCTURAL NOTES
f. ALLOWABLE VERTICAL DEFLECTION LIMITS: DEAD + LIVE: U/80
LIVE: U/240
g. TRUSS CAMBER: TO BE PROVIDED BY THE TRUSS DESIGNER AS REQUIRED TO MEET SERVICEABILITY LIMITS UNLESS SPECIFICALLY NOTED BY THE BUILDING DESIGNER

- ALL TRUSS-TO-TRUSS CONNECTORS SHALL BE SPECIFIED BY THE TRUSS DESIGNER. TRUSS-TO-STRUCTURAL ELEMENT CONNECTIONS SHALL BE SPECIFIED BY THE BUILDING DESIGNER, UNLESS SPECIFICALLY NOTED.
- PERMANENT MEMBER RESTRAINT BRACING OF TRUSS SYSTEM SHALL BE SPECIFIED BY THE TRUSS DESIGNER. TRUSS DESIGNER IS PERMITTED TO SUBSTITUTE PERMANENT INDIVIDUAL TRUSS MEMBER RESTRAINT WITH REINFORCEMENT DESIGNED TO PREVENT BUCKLING. IF SPECIFIC TRUSS MEMBER PERMANENT RESTRAINT DESIGN IS NOT PROVIDED, THE METHOD OF PERMANENT INDIVIDUAL TRUSS MEMBER RESTRAINT AND DIAGONAL BRACING FOR THE TRUSS TOP CHORD, BOTTOM CHORD, AND WEB MEMBERS SHALL BE IN ACCORDANCE WITH BCSI-B3 OR BCSI-B7
- A "TRUSS SUBMITTAL PACKAGE" AS DEFINED BY ANSI/ TPI-1, SHALL BE SUBMITTED TO THE BUILDING DESIGNER FOR REVIEW FOR COMPATIBILITY WITH THE TRUSS SUBMITTAL PACKAGE SHALL INCLUDE: INDIVIDUAL TRUSS DESIGN DRAWINGS, THE TRUSS PLACEMENT DIAGRAM (INCLUDING TRUSS BRIDGING LAYOUT), THE COVER/TRUSS INDEX SHEET, LATERAL RESTRAINT AND DIAGONAL BRACING DETAILS DESIGNED IN ACCORDANCE WITH GENERALLY ACCEPTED ENGINEERING PRACTICE, APPLICABLE BCSI-DEFINED LATERAL RESTRAINT AND DIAGONAL BRACING DETAILS AND ANY OTHER STRUCTURAL DETAILS GERMANE TO THE TRUSSES. EACH INDIVIDUAL TRUSS DESIGN DRAWING, OR COVER/TRUSS IN SHEET IF USED, SHALL BEAR THE SEAL AND SIGNATURE OF THE TRUSS DESIGNER REGISTERED IN THE PROJECT STATE.
- THE CONTRACTOR SHALL FAMILIARIZE THEMSELVES WITH THE "REQUIREMENTS OF THE CONTRACTOR" AS DEFINED BY ANSITPI 1.
- ROOF DECK
A. ALL ROOF DECK SHALL BE APA RATED GRADE PLYWOOD OR OSB (ORIENTED STRAND BOARD). STRUCTURAL I GRADES MAY HAVE EITHER AN EXTERIOR OR EXPOSURE I DESIGNATION (U.N.O.).
B. ROOF SHEATHING SHALL BE ¾" INCH THICK MINIMUM (48/24) U.N.O.
C. STAGGER ENDS OF SHEETS.
D. PROVIDE BLOCKING AT EDGES OF ALL ROOF SHEETS. PLYWOOD CLIPS MAY BE USED AT ROOF INSTEAD OF BLOCKING, UNLESS BLOCKING REQUIRED FOR NAILING.
E. NAIL EDGES OF ROOF SHEETS AT 6 IN. O.C. MAXIMUM (U.N.O.).
F. NAIL FACES OF ROOF SHEETS AT 12 IN. O.C. MAXIMUM.
G. USE MINIMUM 10d COMMON NAILS (U.N.O.).
- WALL SHEATHING
A. ALL WALL SHEATHING SHALL BE APA RATED GRADE PLYWOOD OR OSB (ORIENTED STRAND BOARD). STRUCTURAL I GRADES MAY HAVE EITHER AN EXTERIOR OR EXPOSURE I DESIGNATION (U.N.O.).
B. WALL SHEATHING SHALL BE ¾" INCH THICK MINIMUM (32/16) U.N.O.
C. STAGGER ENDS OF SHEETS.
D. PROVIDE BLOCKING AT EDGES OF ALL SHEARWALL SHEETS.
E. NAIL EDGES OF SHEARWALL SHEETS PER SCHEDULE ON PLAN (OTHER WALLS AT 6 IN. O.C. MAXIMUM).
F. NAIL FACES OF WALL SHEETS AT 12 IN. O.C. MAXIMUM.
G. USE MINIMUM 10d COMMON NAILS (U.N.O.).
- CONNECTORS SHALL BE AS MANUFACTURED BY THE SIMPSON CO. OR APPROVED EQUAL. CONNECTORS USED WITH PRESSURE TREATED LUMBER OR IN UNCONDITIONED SPACE, SHALL HAVE THE ZMAX (B185) COATING. ALL NAILS USED FOR CONNECTORS SHALL MATCH THOSE SPECIFIED BY THE SUPPLIER'S PRODUCT CATALOG.
- NAILING, UNLESS NOTED OTHERWISE, SHALL BE PER THE 2015 INTERNATIONAL BUILDING CODE.
- ALL REFERENCES TO NAILS ON THE STRUCTURAL DRAWINGS ARE BASED ON COMMON WIRE NAILS (U.N.O.) WITH THE FOLLOWING DIMENSIONS. TYPICAL, U.N.O.
8d COMMON: 0.131" DIA. X 2½" LONG
10d COMMON: 0.148" DIA. X 3" LONG
16d COMMON: 0.162" DIA. X 3½" LONG
POWER AUTOMATED NAIL GUNS SHALL USE NAILS TO MATCH THE ABOVE NAILS AS SPECIFIED.

Statement of Special Inspections

This Statement of Special Inspections / Quality Assurance Plan includes the following building systems:

- ☒ Soils and Foundations
- ☒ Cast-in-Place Concrete
- ☐ Masonry
- ☐ Structural Steel
- ☒ Wood Construction
- ☒ Special Cases

General Notes

The inspectors and testing agencies shall be engaged by the Owner or the Owner's Agent, and not by the Contractor or Subcontractor whose work is to be inspected or tested. Any conflict of interest must be disclosed to the Building Official, prior to commencing work.

The qualifications of all personnel performing Special Inspections and testing activities are subject to the approval of the Building Official and E.O.R. The credentials of all inspectors and testing technicians shall be provided if requested.

The special inspectors shall keep records of inspections and shall furnish inspection reports to the owner, Engineer of Record (E.O.R.) and Architect of Record (A.O.R.). Field and testing result reports shall be submitted to all designated parties as they are completed. The reports shall indicate that the work performed was done in accordance to the construction drawings. Discrepancies shall be brought to the attention of the general contractor for correction. If the discrepancies are not corrected, the discrepancies shall be brought to the attention of the E.O.R. prior to completion of that phase of work. A final report that documents required special inspections and corrections of discrepancies shall be submitted by the General Contractor to the Owner, E.O.R. and A.O.R.

Soils and Foundations

Item	Scope	Monitoring: Periodic (P) Continuous (C)
1. Shallow Foundations	<i>Inspect soils below footings for adequate bearing capacity and consistency with geotechnical report.</i>	P
	<i>Inspect removal of unsuitable material and preparation of subgrade prior to placement of controlled fill.</i>	C
2. Controlled Structural Fill	<i>Perform sieve tests (ASTM D422 & D1140) and modified Proctor tests (ASTM D1557) of each source of fill material.</i> <i>Inspect placement, lift thickness and compaction of controlled fill.</i> <i>Test density of each lift of fill by nuclear methods (ASTM D2922)</i> <i>Verify extent and slope of fill placement.</i>	C

Note:

- Special Inspection is not required during placement of controlled fill having a total depth of 12 inches or less.

Cast-in-Place Concrete

Item	Scope	Monitoring: Periodic (P) Continuous (C)
1. Mix Design	<i>Review concrete batch tickets and verify compliance with approved mix design. Verify that water added at the site does not exceed that allowed by the mix design. Submit proposed mix design of each class of concrete to Structural Engineer of Record and to inspection and testing firm for review prior to commencement of work.</i>	P
2. Material Certification	<i>Review for conformance to contract documents. Submit to Structural Engineer of Record for review.</i>	P
3. Anchor Rods	<i>Inspect size, positioning and embedment of anchor rods. Inspect concrete placement and consolidation around anchors.</i>	C
4. Concrete Placement	<i>Inspect placement of concrete. Verify that concrete conveyance and depositing avoids segregation or contamination. Verify that concrete is properly consolidated.</i>	C
5. Sampling and Testing of Concrete	<i>Test concrete compressive strength (ASTM C31 & C39), slump (ASTM C143), air-content (ASTM C231 or C173) and temperature (ASTM C1064). Three concrete test cylinders will be taken for every 75 or less cubic yards of each class of concrete placed, or concrete placed on any given day. One additional test cylinder will be taken during cold weather concreting, cured on job site under same conditions as concrete represents.</i>	C
6. Curing and Protection	<i>Inspect curing, cold weather protection and hot weather protection procedures.</i>	P

Note: Special Inspection is not required for flatwork patios, driveways and sidewalks, on grade not shown on structural drawings.

Wood Construction

Item	Scope	Monitoring: Periodic (P) Continuous (C)
1. Fabricator Certification/ Quality Control Procedures <input type="checkbox"/> Fabricator Exempt	<i>Inspect shop fabrication and quality control procedures for wood truss plant.</i> <i>Confirm certification of supplier.</i>	P
2. Material Grading	<i>Inspect grade stamps on structural lumber for compliance with the contract documents.</i>	P
3. Connections	<i>Verify connection hardware and its installation. Inspect bearing, nails, bolts, hangers or clips, or other devices are tight and otherwise properly installed per the contract documents.</i>	C
4. Framing and Details	<i>Inspect members for size and placement for conformance to the SER approval submittals and contract document. Review engineered joist shop drawings. Submit to SER for review.</i>	P
5. Diaphragms & Shearwalls	<i>Inspect thickness and grade of plywood (or OSB), blocking, placement, embedment, size of hold down anchors and the edge and field nailing of the plywood (or OSB) to the framing for conformance to the contract documents.</i>	C
6. Prefabricated Wood Trusses	<i>Inspect the fabrication of wood trusses. Bottom chord splices are prohibited in the middle third point of the truss.</i>	P
7. Permanent Truss Bracing	<i>Bridging and bracing installed per the approved truss shop drawings.</i>	P

Special Cases

Item	Scope	Monitoring: Periodic (P) Continuous (C)
Epoxy Anchors in Concrete or CMU	<i>Review anchors and product being used for conformance to contract documents. Observe installation for compliance to manufacturers specifications. Perform pull test to 125% of allowable design load per manufacturer specifications. (Minimum of 10% of total anchors, to include a minimum of one of each type, size or embedment.)</i>	C



PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770

Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

1	CHECK SET	12-15-20
2	PERMIT SET	12-18-20
3	BID SET	02-01-21

DRAWN BY: DAS

PANDA PROJECT #: S8-21-D8043

ARCH PROJECT #: P7356.2



PANDA EXPRESS

TRUE WARM & WELCOME 2300
2599 S WOODLAND BLVD
DELAND, FL 32720

S-000

STRUCTURAL NOTES AND
SPECIAL INSPECTIONS

TRUE WARM & WELCOME 2300 R1

TABLE 2304.10.1 FASTENING SCHEDULE (FBC 2017 6TH EDITION)

DESCRIPTION OF BUILDING ELEMENTS		NUMBER AND TYPE OF FASTENER	SPACING AND LOCATION		DESCRIPTION OF BUILDING ELEMENTS	NUMBER AND TYPE OF FASTENER	SPACING AND LOCATION	
ROOF								
1. BLOCKING BETWEEN CEILING JOIST, RAFTERS OR TRUSSES TO TOP PLATE OR OTHER FRAMING BELOW.	3-8d COMMON (2 1/2"x0.131") OR 3-10d BOX (3"x0.128"); OR 3-3"x0.131" NAILS;OR 3-3"x14 GAGE STAPLES, 7/16" CROWN	EACH END, TOENAIL			20. 1" X 6" SHEATHING TO EACH BEARING	2-8d COMMON (2 1/2"x0.131"); OR 2-10d BOX (3"x0.128")	FACE NAIL	
					20. 1" X 6" SHEATHING TO EACH BEARING	2-8d COMMON (2 1/2"x0.131"); OR 2-10d BOX (3"x0.128")	FACE NAIL	
BLOCKING BETWEEN RAFTERS OR TRUSS NOT AT WALL TOP PLATE, TO RAFTER OR TRUSS	2-8d COMMON (2 1/2"x0.131") 2-3"x0.131" NAILS 2-3"x14 GAGE STAPLES	EACH END, TOENAIL			21. 1" X 8" AND WIDER SHEATHING TO EACH BEARING	3-8d COMMON (2 1/2"x0.131"); OR 3-10d BOX (3"x0.128")	FACE NAIL	
	2-16d COMMON (3 1/2"x0.162") 3-3"x0.131" NAILS 3-3"x14 GAGE STAPLES	EACH NAIL			FLOOR			
FLAT BLOCKING TO TRUSS AND WEB FILLER	16d COMMON (3 1/2"x0.162") @ 6" O.C. 3"x0.131" NAILS @ 6" O.C. 3"x14 GAGE STAPLES @ 6" O.C.	FACE NAIL			22. JOIST TO SILL, TOP PLATE, OR GIRDER	3-8d COMMON (2 1/2"x0.131"); OR FLOOR 3-10d BOX (3"x0.128"); OR 3-3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLE, 7/16" CROWN	6" O.C., TOENAIL	
2. CEILING JOIST TO TOP PLATE	3-8d COMMON (2 1/2"x0.131"); OR 3-10d COMMON (3"x0.128"); OR 3-3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLES, 7/16" CROWN	EACH JOIST, TOENAIL			23. RIM JOIST, BAND JOSIT, OR BLOCKING TO TOP PLATE, SILL OR OTHER FRAMING BELOW	3-8d COMMON (2 1/2"x0.131"); OR FLOOR 10d BOX (3"x0.128"); OR 3"x0.131" NAILS; OR 3"x14 GAGE STAPLE, 7/16" CROWN	6" O.C., TOENAIL	
					24. 1" X 6" SUBFLOOR OR LESS TO EACH	2-8d COMMON (2 1/2"x0.131"); OR 2-10d BOX (3"x0.128")	FACE NAIL	
3. CEILING JOIST NOT ATTACHED TO PARALLEL RAFTER, LAPS OVER PARTITIONS (NO THRUST) (SEE SECTION 2308.7.3.1, TABLE 2308.7.3.1)	3-16d COMMON (3 1/2"x0.131"); OR 4-10d BOX (3"x0.128"); OR 3-3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLES, 7/16" CROWN	EACH JOIST, TOENAIL			25. 2" SUBFLOOR TO JOIST OR GIRDER	2-16d COMMON (3 1/2"x0.162")	FACE NAIL	
					26. 2" PLANKS (PLANKS & BEAM - FLOOR & ROOF)	2-16d COMMON (3 1/2"x0.162")	EACH BEARING, FACE NAIL	
4. CEILING JOIST NOT ATTACHED TO PARALLEL RAFTER (HEEL JOINT) (SEE SECTION 2308.7.3.1, TABLE 2308.7.3.1)	PER TABLE 2308.7.3.1	FACE NAIL			27. BUILT-UP GIRDERS AND BEAMS, 2" LUMBER LAYES	20d COMMON (4"x0.192") 10d BOX (3"x0.128"); OR 3"x0.131" NAILS; OR 3"x14 GAGE STAPLE, 7/16" CROWN	32" O.C., FACE NAIL AT TOP AND BOTTOM. STAGGERED OM OPPOSITE SIDES 24" O.C., FACE NAIL AT TOP AND BOTTOM. STAGGERED OM OPPOSITE SIDES	
						AND: 2-20d COMMON (4"x0.192"); OR 3-10d BOX (3"x0.128"); OR 3-3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLE, 7/16" CROWN	ENDS AND AT EACH SPLICE, FACE NAIL	
6. RAFTER OR ROOF TRUSS TO TOP PLATE (SEE SECTION 2308.7.5, TABLE 2308.7.5)	3-10d COMMON (3 1/2"x0.148"); OR 3-16d BOX (3 1/2"x0.135"); OR 4-3"x0.131" NAILS; OR 4-3"x14 GAGE STAPLES, 7/16" CROWN	TOENAIL ^C			28. LEDGER SUPPORTING JOIST OF RAFTER	3-16d COMMON (3 1/2"x0.162"); OR 4-10d BOX (3"x0.128"); OR 4-3"x0.131" NAILS; OR 4-3"x14 GAGE STAPLE, 7/16" CROWN	EACH JOIST OR RAFTER, FACE NAIL	
						29. JOIST TO BAND JOIST OR RIM JOIST	3-16d COMMON (3 1/2"x0.162"); OR 4-10d BOX (3"x0.128"); OR 4-3"x0.131" NAILS; OR 4-3"x14 GAGE STAPLE, 7/16" CROWN	END NAIL
7. ROOF RAFTER TO RIDGE VALLEY OR HIP RAFTER; OR ROOF RAFTER TO 2-INCH RIDGE BEAM	2-16d COMMON (3 1/2"x0.162"); OR 3-10d BOX (3"x0.128"); OR 3-3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLES, 7/16" CROWN OR	END NAIL			30. BRIDGING OR BLOCKING TO JOIST, RAFTER OR TRUSS		2-8d COMMON (2 1/2"x0.131"); OR 2-10d BOX (3"x0.128"); OR 2-3"x0.131" NAILS; OR 2-3"x14 GAGE STAPLE, 7/16" CROWN	EACH END, TOENAIL
	2-10d COMMON (3 1/2"x0.148"); OR 3-16d BOX (3 1/2"x0.135"); OR 4-10d BOX (3 1/2"x0.128"); OR 4-3"x0.131" NAILS; OR 4-3"x14 GAGE STAPLES, 7/16" CROWN	TOENAIL						
WALL					WOOD STRUCTURAL PANELS (WSP), SUBFLOOR, ROOF AND INTERIOR WALL SHEATHING TO FRAMING AND PARTICLEBOARD WALL ^B SHEATHING FRAMING			
8. STUD TO STUD (NOT AT BRACED WALL PANEL)	16d COMMON (3 1/2"x0.162")	24" O.C. FACE NAIL					EDGE (INCHES)	INTERMEDIATE SUPPORTS (INCHES)
	10d BOX (3"x0.128") ; OR 3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLES, 7/16" CROWN	16" O.C. FACE NAIL			6d COMMON OR DEFORMED (2"x0.113") (SUBFLOOR AND WALL)	6	12	
9. STUD TO STUD AND ABUTTING STUDS AT INTERSECTING WALL CORNER (AT BRACE PANELS)	16d COMMON (3 1/2"x0.162"); OR 16d COMMON (3 1/2"x0.135"); OR 3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLE, 7/16" CROWN	16" O.C. FACE NAIL 12" O.C. FACE NAIL			31. 3/8" - 1/2"	8d BOX OR DEFORMED (2 1/2" X 0.113) (ROOF)	6	12
		12" O.C. FACE NAIL				2 3/8 X 0.113" NAIL (SUBFLOOR AND WALL)	6	12
10. BUILT-UP HEADER (2" TO 2" HEADER)	16d COMMON (3 1/2"x0.162"); OR 16d BOX (3"x0.128"); OR	16" O.C. EDGE, FACE NAIL TOENAIL			32. 19/32" - 3/4"	1 3/4" 16 GAGE STAPLE, 7/16" CROWN (SUBFLOOR AND WALL)	4	8
		TOENAIL				2 3/8 X 0.113" NAIL (ROOF)	4	8
11. CONTINUOUS HEADER TO STUD	4-8d COMMON (2 1/2"x0.131");OR 4-10d BOX (3"x0.128")	TOENAIL			33. 7/8" - 1 1/4"	1 3/4" 16 GAGE STAPLE, 7/16" CROWN (ROOF)	3	6
12. TOP PLATE TO PLATE	16d COMMON (3 1/2"x0.162"); OR 10d BOX (3"x0.128");OR 3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLE, 7/16" CROWN	16" O.C. FACE NAIL 12" O.C. FACE NAIL				34. 1/2" FIBER SHEATHING ^b	8d COMMON (2 1/2"x0.131"); OR 6d DEFORMED (2"x0.113")	6
					2 3/8X0.113" NAIL;OR 2" 16 GAGE STAPLE , 7/16" CROWN		4	8
13. TOP PLATE TO TOP PLATE, AT END JOINTS	8-16d COMMON (3 1/2"x0.162"); OR 12-10d BOX (3"x0.128"); OR 12-3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLE, 7/16" CROWN	EACH SIDE OF END JOINT, FACE NAIL (MINIMUM 24" LAP SPLICE LENGTH EACH SIDE OF END JOINT)			35. 25/32" FIBER SHEATHING ^b	10d COMMON (3"x0.148"); OR 8d DEFORMED (2 1/2"x0.131)	6	12
						OTHER EXTERIOR WALL SHEATHING		
14. BOTTOM PLATE TO JOIST, RIM JOIST OR BLOCKING (NOT AT BRACE WALL PANELS)	8-16d COMMON (3 1/2"x0.162"); OR 12-10d BOX (3"x0.128"); OR 12-3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLE, 7/16" CROWN	12" O.C. FACE NAIL			36. 3/4" AND LESS	1 1/2" GALVANIZED ROOF NAIL (7/16" HEAD DIAMETER); OR 1 1/4" 16 GAGE STAPLE WITH 7/16" OR 1" CROWN	3	6
						37. 7/8" - 1"	1 3/4" GALVANIZED ROOF NAIL (7/16" HEAD DIAMETER); OR 1 1/2" 16 GAGE STAPLE WITH 7/16" OR 1" CROWN	3
15. BOTTOM PLATE TO JOIST, RIM JOIST OR BLOCKING AT BRACED WALL PANELS	2-16d COMMON (3 1/2"x0.162"); OR 3-16d BOX (3 1/2"x0.135"); OR 4-3"x0.131" NAILS; OR 4-3"x14 GAGE STAPLE, 7/16" CROWN	12" O.C. FACE NAIL			WOOD STRUCTURAL PANELS, COMBINATION SUBFLOOR UNDERLAYMENT TO FRAMING			
					38. 1 1/8" - 1 1/4"	8d COMMON (2 1/2"x0.131"); OR 6d DEFORMED (2"x0.113)	6	12
16. STUD TO TOP OR BOTTOM PLATE	4-8d COMMON (2 1/2"x0.131"); OR 4-10d BOX (3"x0.128"); OR 4-3"x0.131" NAILS; OR 4-3"x14 GAGE STAPLE, 7/16" CROWN; OR	TOENAIL				39. 1/2" OR LESS	8d COMMON (2 1/2"x0.131"); OR 8d DEFORMED (2 1/2"x0.131)	6
	2-16d COMMON (3 1/2"x0.162"); OR 3-10d BOX (3"x0.128"); OR 3-3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLE, 7/16" CROWN	END NAIL			40. 5/8"		8d CORROSION-RESISTANT SIDING (2 3/8"x0.128"); OR 8d CORROSION-RESISTANT CASING (2 1/2"x0.113")	6
17. TOP OR BOTTOM PLATE TO STUD	2-16d COMMON (3 1/2"x0.162"); OR 3-10d BOX (3"x0.128"); OR 3-3"x0.131" NAILS; OR 3-3"x14 GAGE STAPLE, 7/16" CROWN	FACE NAIL				PANEL SIDING TO FRAME		
					41. 1/4"	6d CORROSION-RESISTANT SIDING (1 7/8"x0.106"); OR 6d CORROSION-RESISTANT CASING (2"x0.099")	6	12
18. TOP TO PLATES, LAPS AT CORNER AND INTERSECTIONS	2-8d COMMON (2 1/2"x0.131"); OR 2-10d BOX (3"x0.128"); OR 2-3"x0.131" NAILS; OR 2-3"x14 GAGE STAPLE, 7/16" CROWN	FACE NAIL				42. 3/8"	8d CORROSION-RESISTANT SIDING (2 3/8"x0.128"); OR 8d CORROSION-RESISTANT CASING (2 1/2"x0.113")	6
					INTERIOR PANELING			
19. 1" BRACE TO EACH STUD AND PLATE	2-8d COMMON (2 1/2"x0.131"); OR 2-10d BOX (3"x0.128"); OR 2-3"x0.131" NAILS; OR 2-3"x14 GAGE STAPLE, 7/16" CROWN	FACE NAIL			4d CASING (1 1/2"x0.080"); OR 4d FINISH (1 1/2"x0.072")	6	12	
					6d CASING (2"x0.099"); OR 6d FINISH (PANEL SUPPORTS AT 24 INCHES)	6	12	

ASCE 7-10 / ULTIMATE COMPONENT AND CLADDING ROOF PRESSURE

ZONE	EFFECTIVE WIND AREA	COEFFICIENT	ULTIMATE DWP		NOMINAL DWP	
			PNET (psf)		PNET (psf)	
1	10	0.90	16.63	-40.88	9.98	-24.53
1	20	0.90	16.00	-40.88	9.60	-24.53
1	50	0.90	16.00	-39.15	9.60	-23.49
1	100	0.90	16.00	-37.41	9.60	-22.45
2	10	0.90	40.88	-68.59	24.53	-41.15
2	20	0.90	39.15	-61.66	23.49	-37.00
2	50	0.90	36.37	-51.27	21.82	-30.76
2	100	0.90	34.64	-44.34	20.79	-26.61
3	10	0.90	40.88	-68.59	24.53	-41.15
3	20	0.90	39.15	-61.66	23.49	-37.00
3	50	0.90	36.37	-51.27	21.82	-30.76
3	100	0.90	34.64	-44.34	20.79	-26.61


ASCE 7-10 / ULTIMATE COMPONENT AND CLADDING WALL PRESSURE

ZONE	EFFECTIVE WIND AREA	COEFFICIENT	ULTIMATE DWP		NOMINAL DWP	
			PNET (psf)		PNET (psf)	
4	10	0.90	40.88	-44.34	24.53	-26.61
4	20	0.90	39.15	-42.61	23.49	-25.57
4	50	0.90	36.37	-40.18	21.82	-24.11
4	100	0.90	34.64	-38.11	20.79	-22.86
4	200	0.90	33.26	-36.72	19.95	-22.03
5	10	0.90	40.88	-54.73	24.53	-32.84
5	20	0.90	39.15	-51.27	23.49	-30.76
5	50	0.90	36.37	-46.07	21.82	-27.64
5	100	0.90	34.64	-42.61	20.79	-25.57
5	200	0.90	33.26	-39.15	19.95	-23.49

ASCE 7-10 / ULTIMATE COMPONENT AND CLADDING ROOF OVERHANG PRESSURE

ZONE	EFFECTIVE WIND AREA	COEFFICIENT	ULTIMATE DWP		NOMINAL DWP	
			PNET		PNET	
1	10	0.90	-65.13		-39.08	
1	20	0.90	-64.43		-38.66	
1	50	0.90	-62.36		-37.41	
1	100	0.90	-61.66		-37.00	
2	10	0.90	-65.13		-39.08	
2	20	0.90	-64.43		-38.66	
2	50	0.90	-62.36		-37.41	
2	100	0.90	-61.66		-37.00	
3	10	0.90	-103.23		-61.94	
3	20	0.90	-82.45		-49.47	
3	50	0.90	-54.73		-32.84	
3	100	0.90	-33.95		-20.37	

- FOR SI: 1 INCH = 25.4 MM.
- a. NAILS SPACED AT 6 INCHES AT INTERMEDIATE SUPPORTS WHERE SPANS ARE 48 INCHES OR MORE. FOR NAILING OF WOOD STRUCTURAL PANEL AND PARTICLEBOARD DIAPHRAGMS AND SHEAR WALL, REFER TO SECTION 2305. NAILS FOR WALL SHEATHING ARE PERMITTED TO BE COMMON, BOX OR CASING.
- b. SPACING SHALL BE 6 INCHES ON CENTER ON THE EDGE AND 12 INCHES ON CENTER AT INTERMEDIATE SUPPORTS FOR NONSTRUCTURAL APPLICATIONS. PANEL SUPPORTS AT 16 INCHES (20 INCHES IF STRENGTH AXIS IN THE LONG DIRECTION OF THE PANEL, UNLESS OTHERWISE MARKED).
- c. WHERE A RAFTER IS FASTENED TO AN ADJACENT PARALLEL CEILING JOIST IN ACCORDANCE WITHTHIS SCHEDULE AND THE CEILING JOIST IS FASTENED TO THE TOP PLATE IN ACCORDANCE WITH THIS SCHEDULE. THE NUMBER OF TOENAILS IN THE RAFTER SHALL BE PERMITTED TO BE REDUCED BY ONE NAIL.

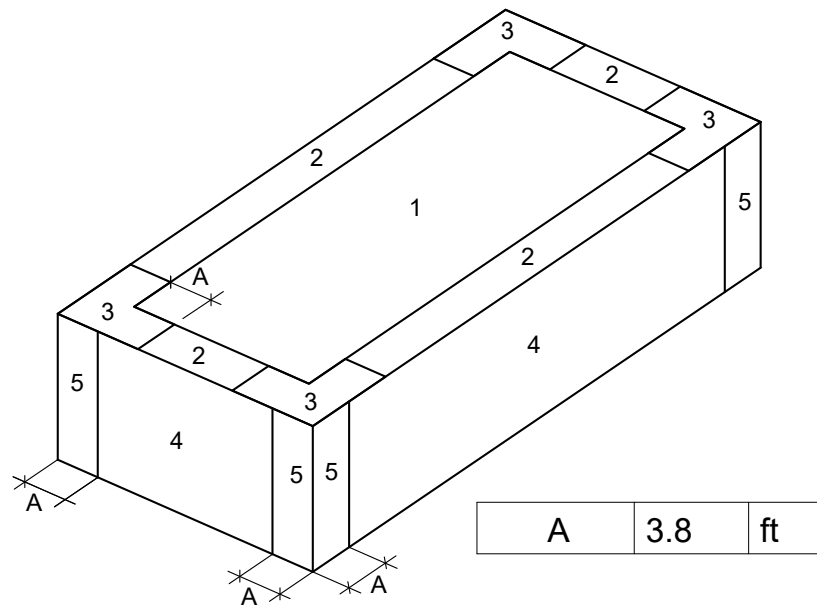

PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

1	CHECK SET	12-15-20
2	PERMIT SET	12-18-20
3	BID SET	02-01-21

ISSUE DATE:

1	CHECK SET	12-15-20
2	PERMIT SET	12-18-20
3	BID SET	02-01-21

DRAWN BY: DAS

PANDA PROJECT #: S8-21-D8043
ARCH PROJECT #: P7356.2



PANDA EXPRESS
TRUE WARM & WELCOME 2300
2599 S WOODLAND BLVD
DELAND, FL 32720

S-001
STRUCTURAL NOTES AND
SPECIAL INSPECTIONS


TRUE WARM & WELCOME 2300 R1



REVISIONS:

	<p>Plans Prepared By: CPH, Inc.</p>
<p>www.cphcorp.com</p>	<p>500 West Fulton St. Sanford, FL 32771 Ph: 407.322.6841</p>
<p>A Full Service A & E Firm</p>	<p>Licenses: Eng. C.O.A. No. 3215 Survey L.B. No. 7143 Arch. Lic. No. AA2600926 Lndscp. Lic. No. LC000025</p>

TRUE WARM & WELCOME 2300 R1



1. REF. SHEET S-000 FOR STRUCTURAL NOTES AND SPECIAL INSPECTIONS.
2. REF. 3/S-201 FOR TYPICAL PIPE AND TRENCH DETAIL AS REQUIRED.
3. REF. 4/S-201 FOR TYPICAL SILL PLATE BOLT DETAIL AS REQUIRED.
4. REF. 5/S-201 FOR TYPICAL STEP FOOTING DETAIL AS REQUIRED.
5. REF. 6/S-201 FOR TYPICAL REINFORCING BAR DETAIL AS REQUIRED.
6. REF. 7/S-201 FOR TYPICAL CORNER BAR DETAIL AS REQUIRED.
7. REF. 8/S-200 FOR TYPICAL NON-BEARING WALL CONNECTION AT SLAB AS REQUIRED.
8. REF. 3/S-301 FOR TYPICAL FRAMING NOTCHED DETAIL AS REQUIRED.
9. REF. 4/S-301 FOR TYPICAL WALL FRAMING DETAILS AS REQUIRED.
10. REF. 11/S-200 FOR TYPICAL TRASH ENCLOSURE DETAIL AS REQUIRED.
11. REF. 9/S-201 FOR TYPICAL CURB DETAIL AS REQUIRED.
12. REF. 15/S-200 FOR TYPICAL LIGHT POLE BASE DETAIL AS REQUIRED.
13. REF. 10/S-201 FOR TYPICAL TRENCH DRAIN DETAIL AS REQUIRED.
14. REF. 11/S-201 FOR TYPICAL DRAIN DETAIL AS REQUIRED.
15. COORDINATE WITH ARCHITECTURAL, MECHANICAL AND PLUMBING DRAWINGS FOR LOCATIONS OF ALL DEPRESSIONS, CURBS, DRAINS, ETC. IN FLOOR SLAB.

SHEARWALL SCHEDULE			
TYPE	NAIL SPACING	HOLDOWN	ANCHOR BOLTS
①	10d @ 4" O.C.	HDU14-SDS2.5	¾"Ø @ 24" O.C.
②	10d @ 4" O.C.	HDU14-SDS2.5	¾"Ø @ 24" O.C.
③	10d @ 6" O.C.	HDU8-SDS2.5	¾"Ø @ 32" O.C.
④	10d @ 4" O.C.	HDU14-SDS2.5	¾"Ø @ 24" O.C.

NOTES:

1. USE 10d COMMON NAILS.
2. NAIL PANEL FACES @ 12" O.C.
3. USE 1/2" PLYWOOD.
4. STAGGER PLYWOOD JOINT AND SILL PLATE NAILING.
5. FRAMING MEMBERS OR BLOCKING SHALL BE PROVIDED AT THE EDGES OF ALL SHEETS IN SHEARWALLS.
6. REFER TO 9/5-200 FOR HOLD DOWN ANCHOR EMBEDMENT.
7. HOLD DOWN ANCHORS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.
8. FRAMING AT ADJOINING PANEL EDGES SHALL BE 3 INCH NOMINAL OR THICKER AND NAILS SHALL BE STAGGERED WHERE NAILS ARE SPACED AT 3" O.C. OR ARE ON EACH FACE.

Scale: NO SCALE

S-100

Scale: 1/4"=1'-0"

S-100

TRUE WARM & WELCOME 2300 R1



REVISIONS:

ISSUE DATE:

DRAWN BY: DAS


PANDA PROJECT #: S8-21-D8043
ARCH PROJECT #: P7356.2



PANDA EXPRESS
TRUE WARM & WELCOME 2300
2599 S WOODLAND BLVD
DELAND, FL 32720

S-101
ROOF FRAMING PLAN


TRUE WARM & WELCOME 2300 R1

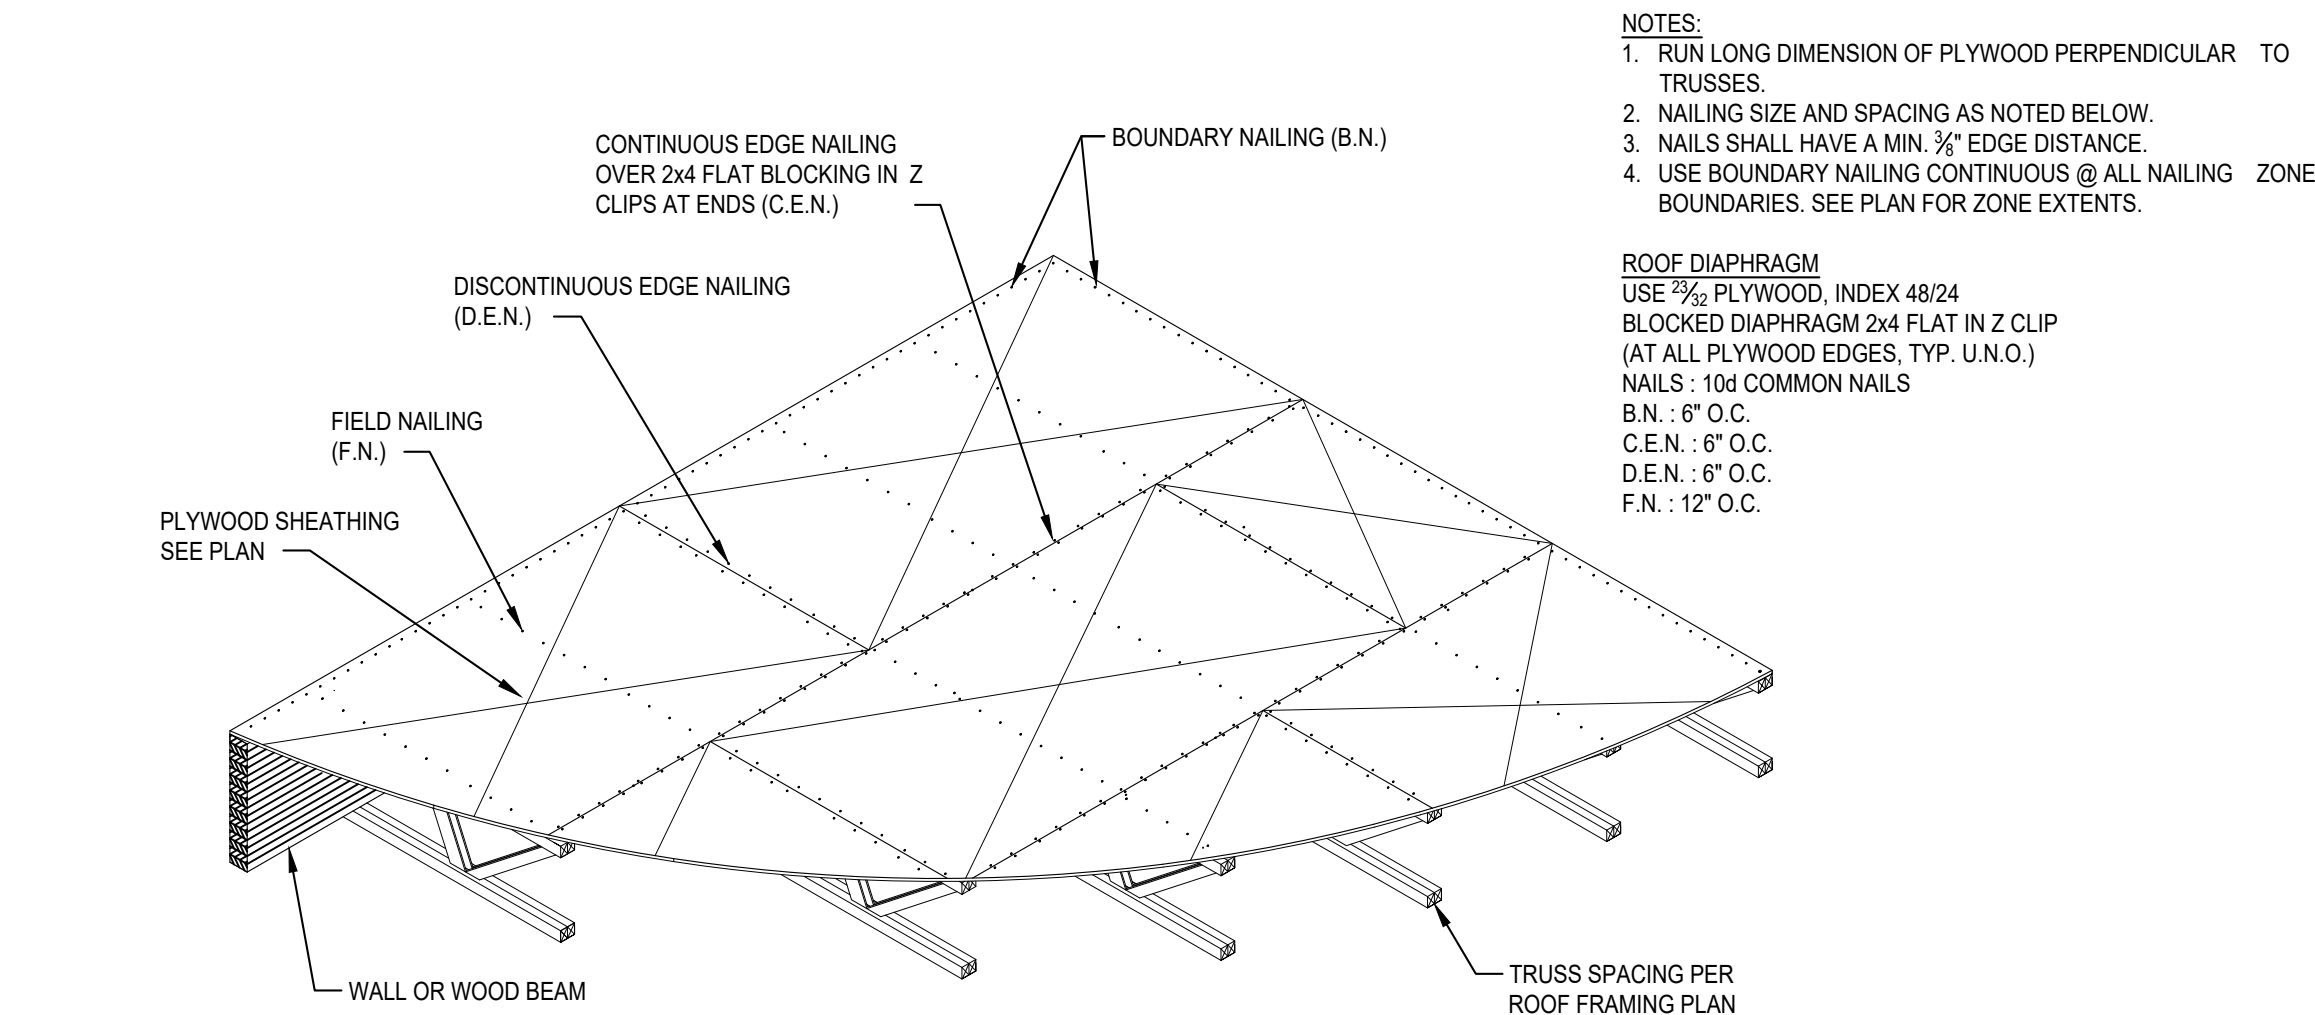


TYPICAL ROOF DIAPHRAGM DETAIL	2
	S-101

PLAN NOTES

1. REF. SHEET S-000 FOR STRUCTURAL NOTES AND SPECIAL INSPECTIONS.
2. REF. 9/5-301 FOR TYPICAL SUSPEND THREADED ROD SUPPORT DETAIL AS REQUIRED.
3. REF. 7/5-301 & 12/5-301 FOR TYPICAL SOFFIT FRAMING AT SERVICE COUNTER. REFER TO ARCH. FOR LOCATION.
4. REF. 6/5-301 FOR TYPICAL HEADER DETAIL AS REQUIRED.
5. REF. 8/5-301 FOR TYPICAL MECHANICAL UNIT SUPPORT DETAIL AS REQUIRED.
6. REF. 6/5-301 FOR TYPICAL BRIDGING AND BRACING DETAIL AS REQUIRED.
7. REF. 10/5-301 FOR TYPICAL PARTITION WALL SUPPORT PARALLEL TO TRUSS DETAIL AS REQUIRED.
8. REF. 11/5-301 FOR TYPICAL PARTITION WALL SUPPORT PERPENDICULAR TO TRUSS DETAIL AS REQUIRED.
9. REF. 1/5-100 FOR SHEARWALL SCHEDULE.
10. REF. 12/5-201 FOR METAL STUD PARTITION BLOCKING.

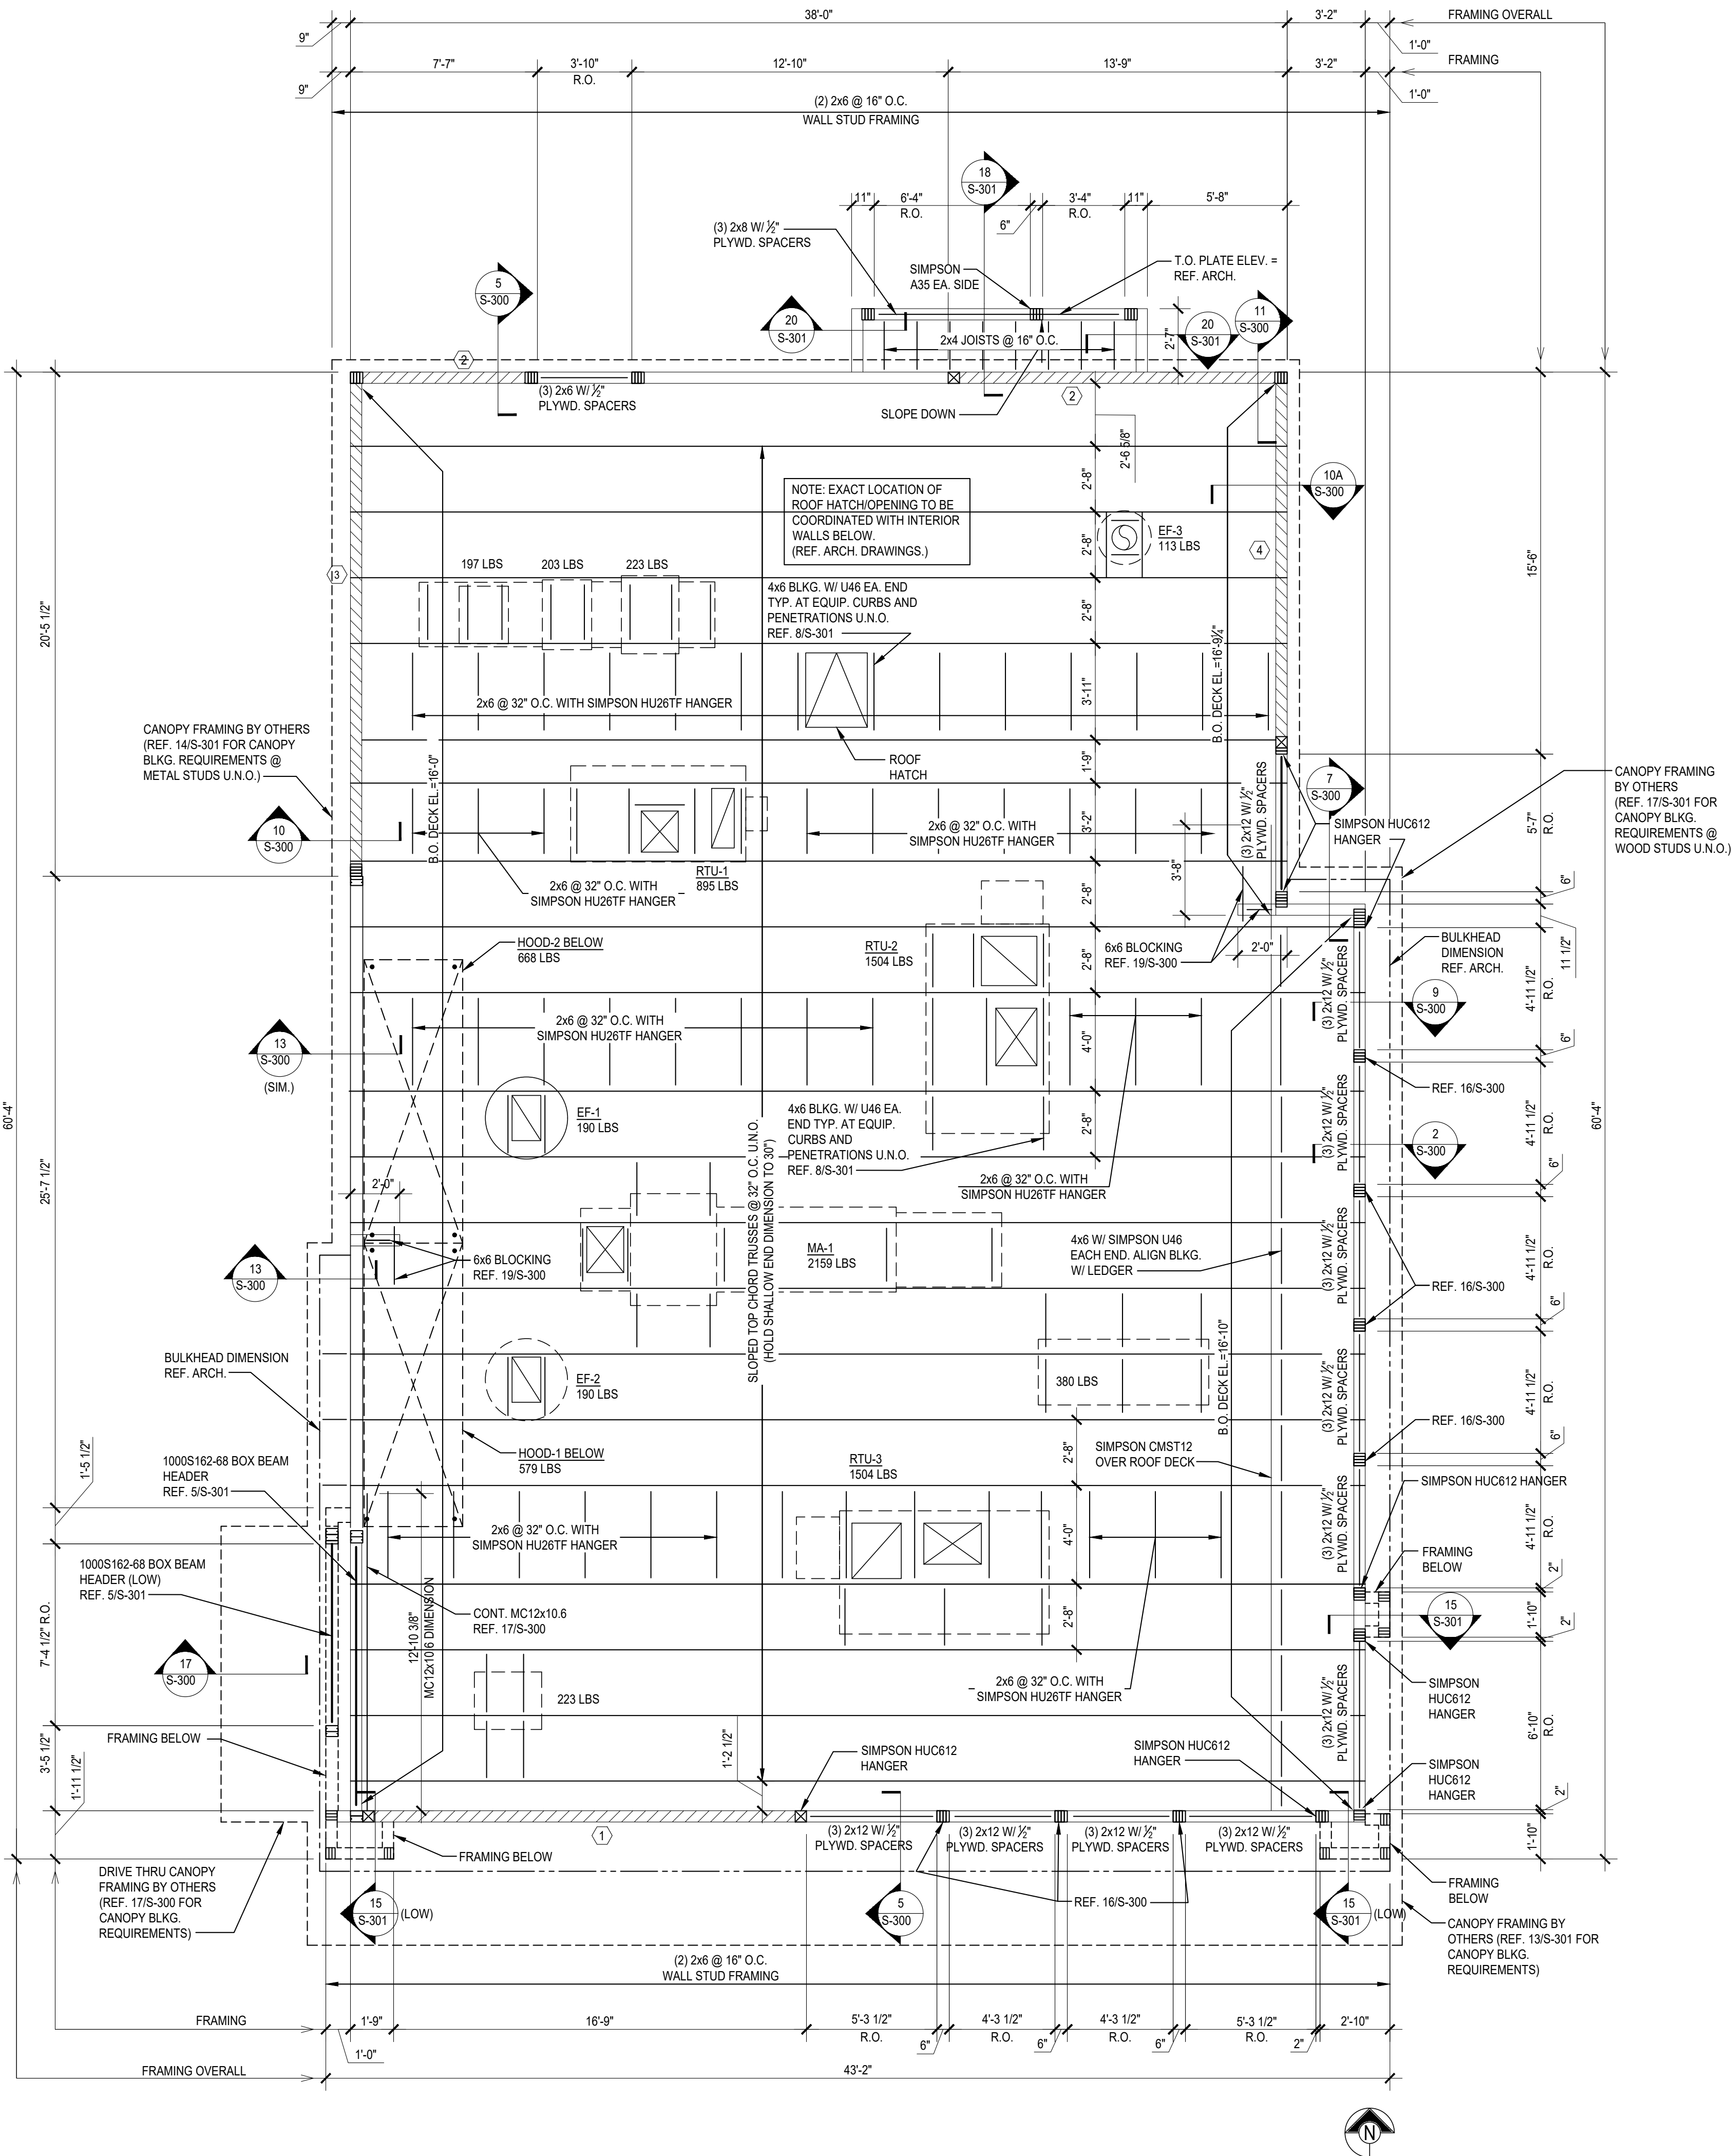

ROOF NOTES	1	ROOF FRAMING PLAN	A
	S-101	1/4"=1'-0"	S-101

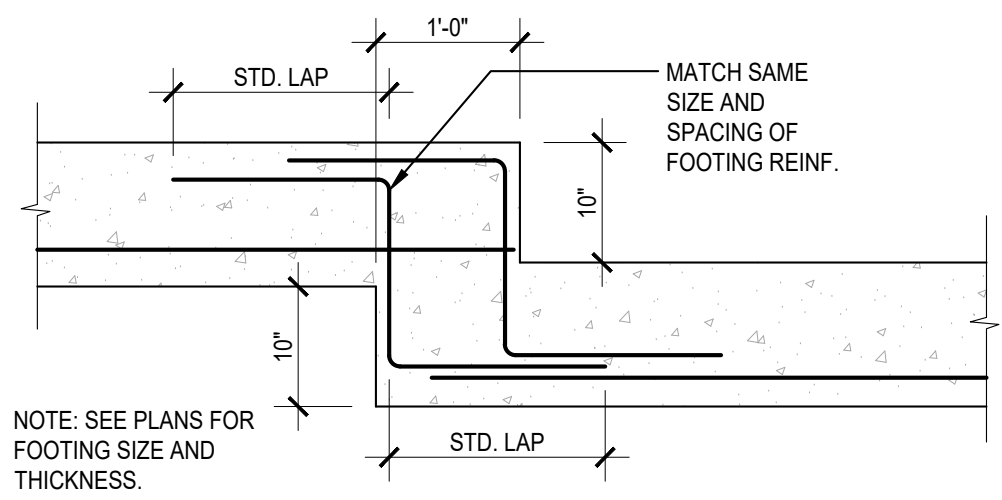


STEP FOOTING DETAIL

20

SCALE: 3/4"=1'-0"

S-200

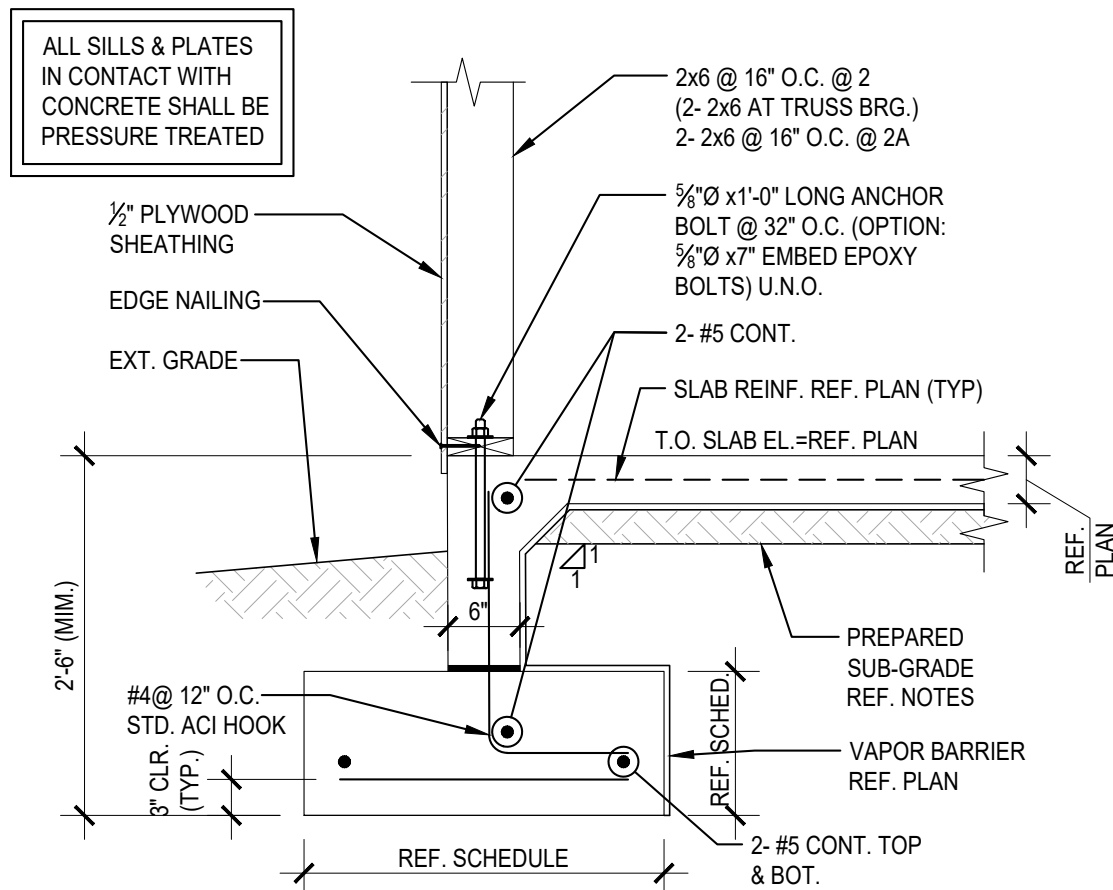


FOUNDATION DETAIL (2/S-200 ALTERNATE)

16

SCALE: 3/4"=1'-0"

S-200

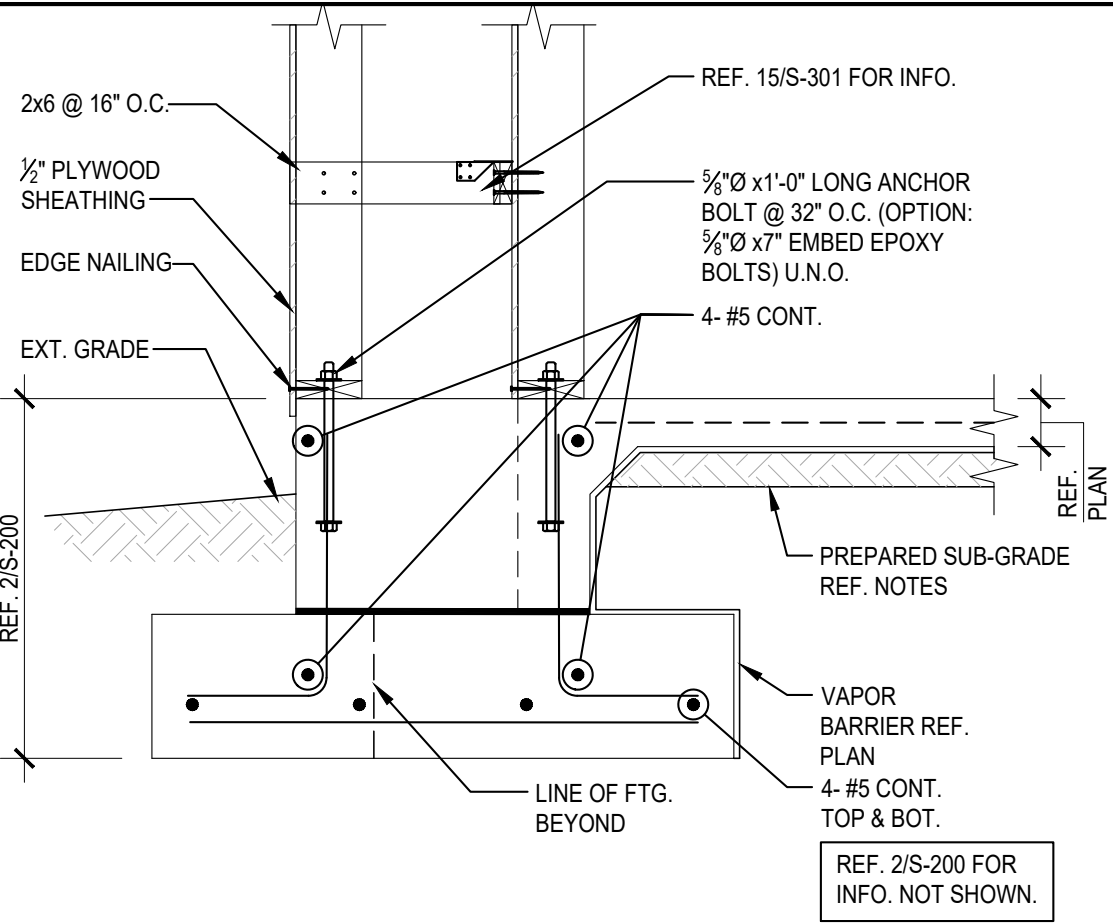


FOUNDATION DETAIL (4/S-200 ALTERNATE)

12

SCALE: 3/4"=1'-0"

S-200

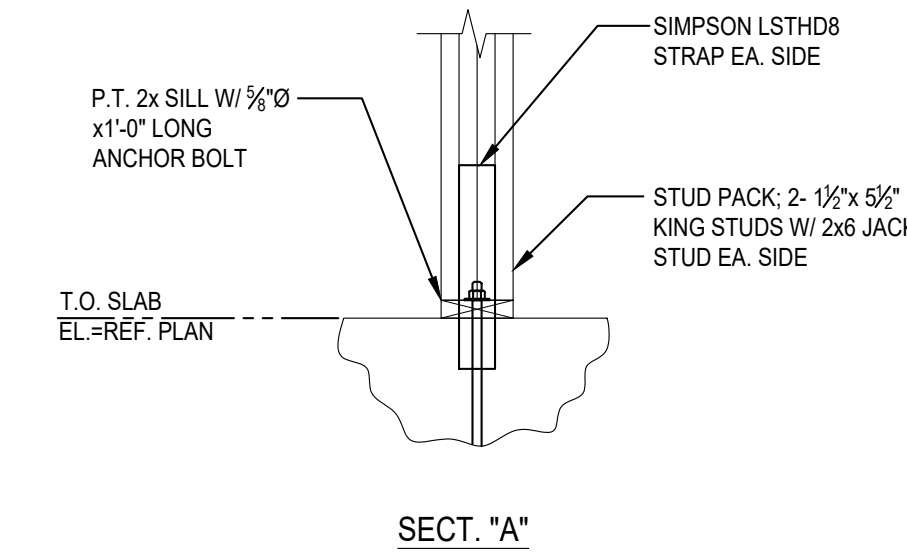


SECTION "A"

7

SCALE: 3/4"=1'-0"

S-200

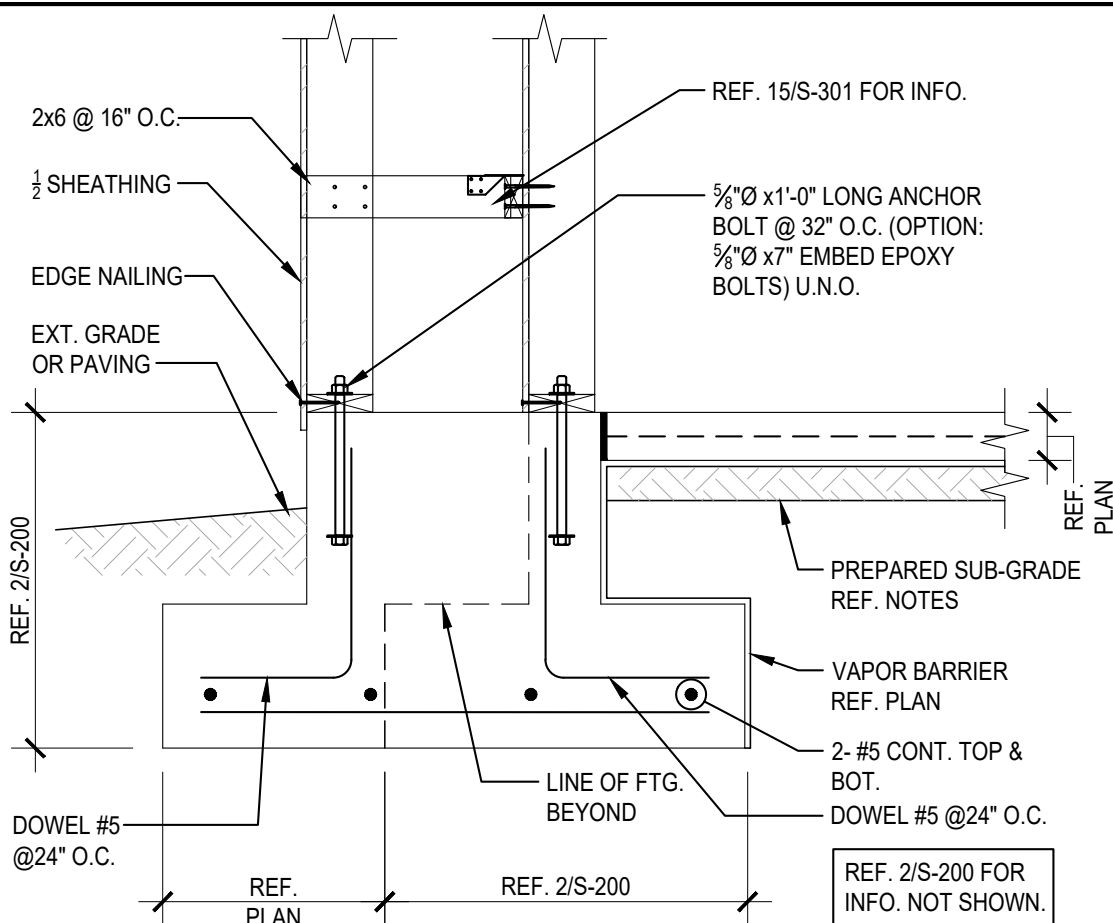


SECTION

4

SCALE: 3/4"=1'-0"

S-200

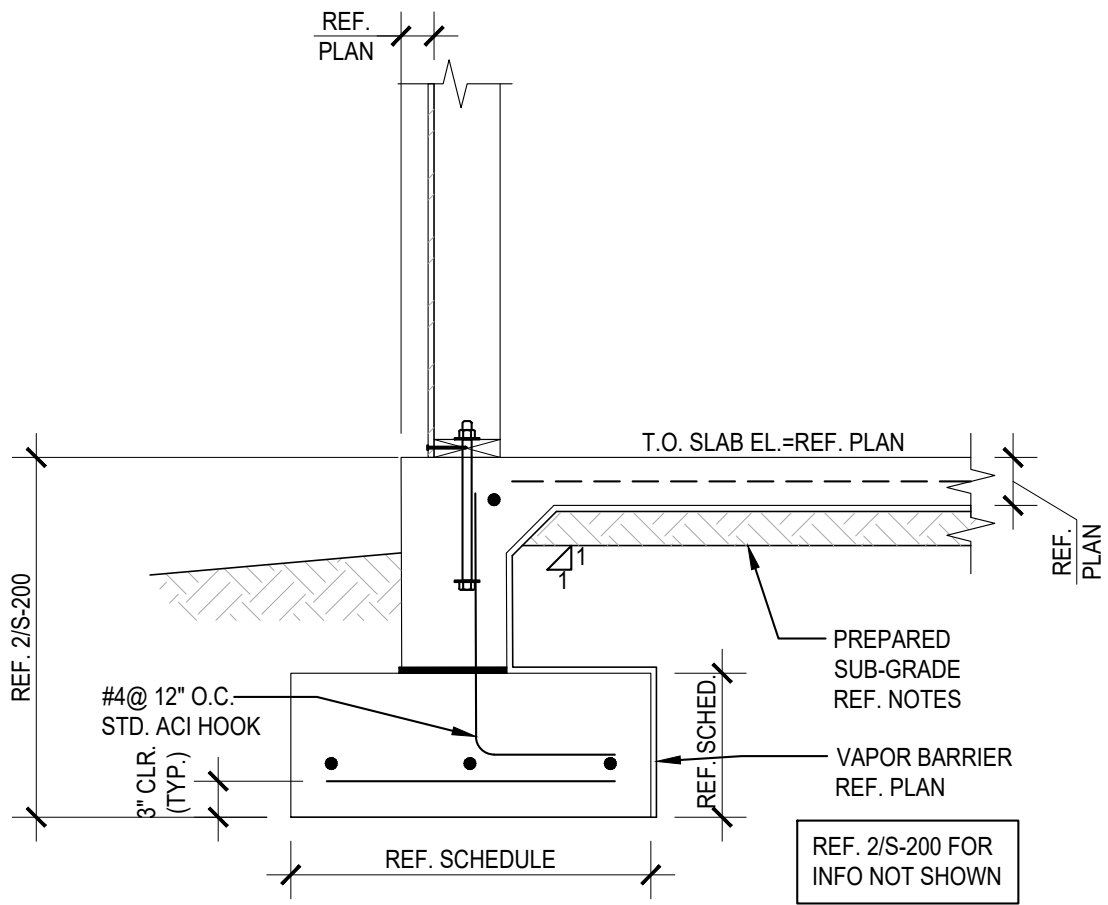


SECTION

19

SCALE: 3/4"=1'-0"

S-200

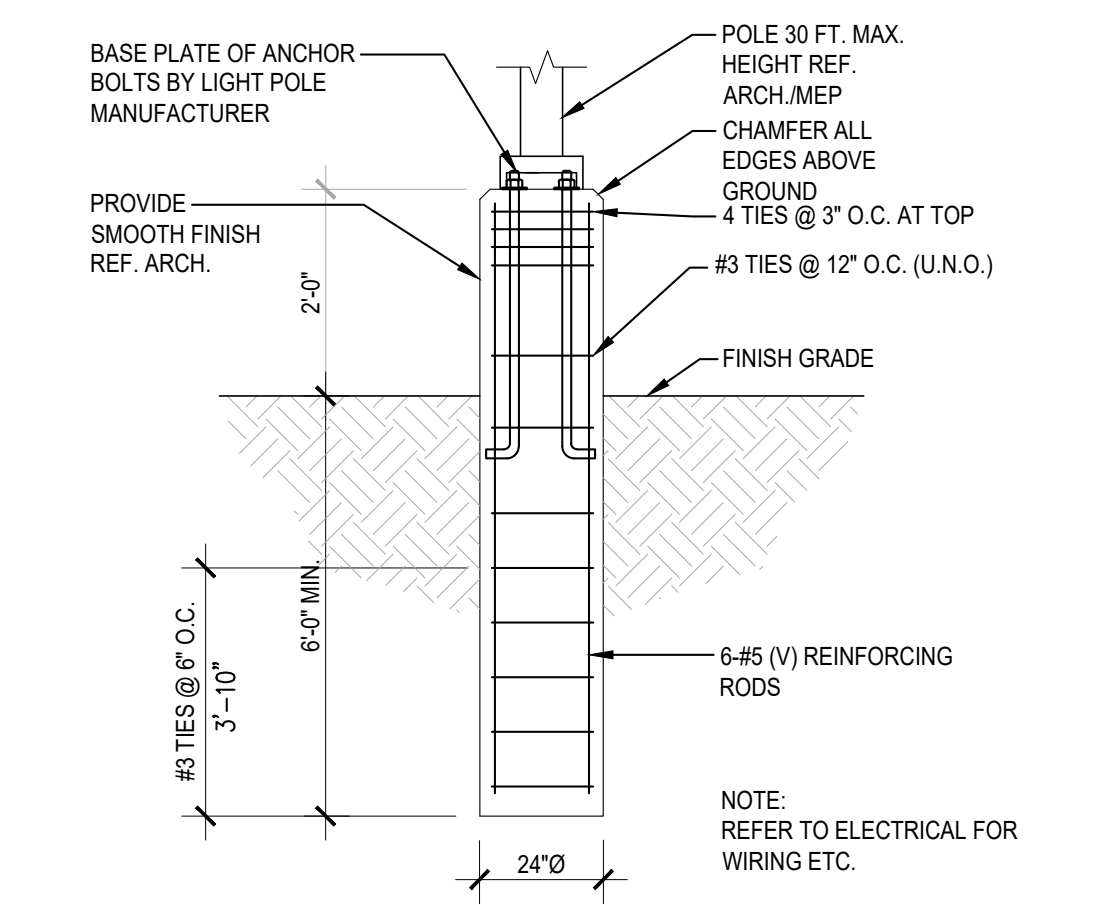


TYPICAL LIGHT POLE SECTION

15

SCALE: 3/4"=1'-0"

S-200

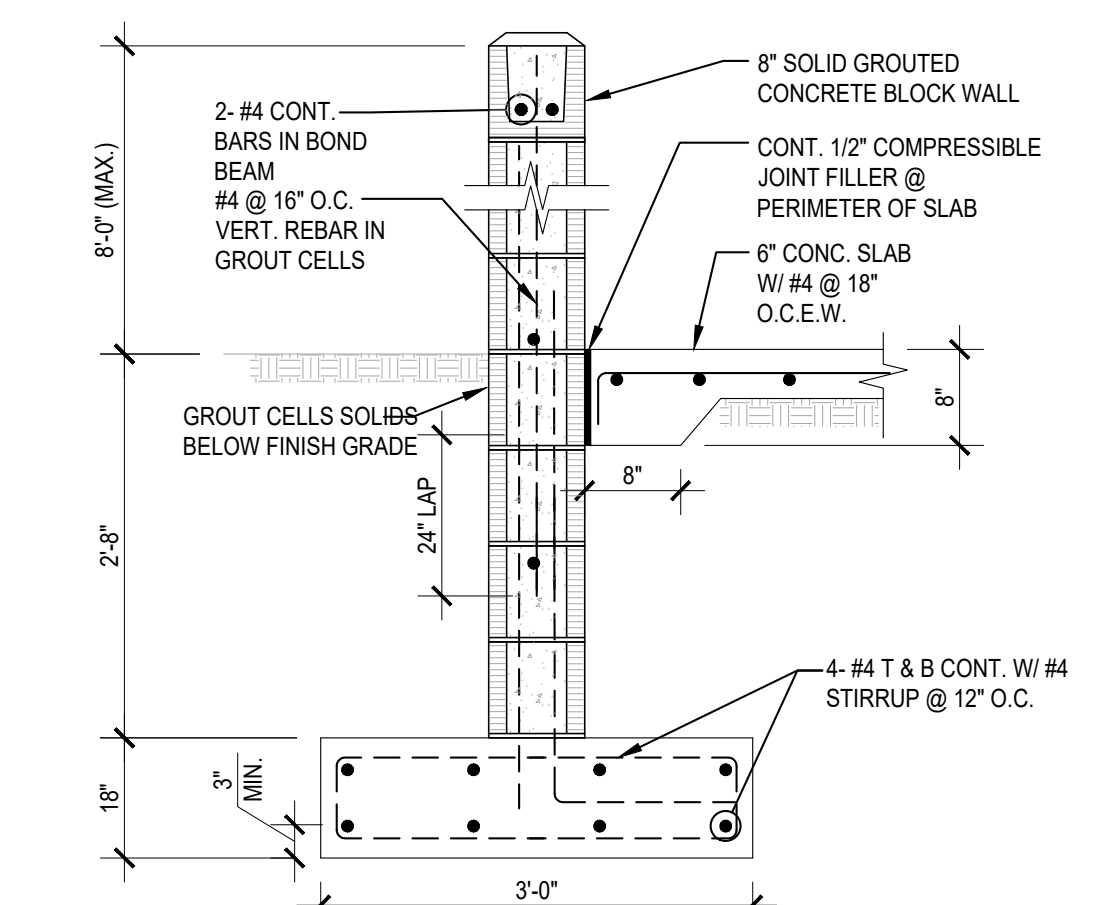


TRASH ENCLOSURE WALL

11

SCALE: 3/4"=1'-0"

S-200

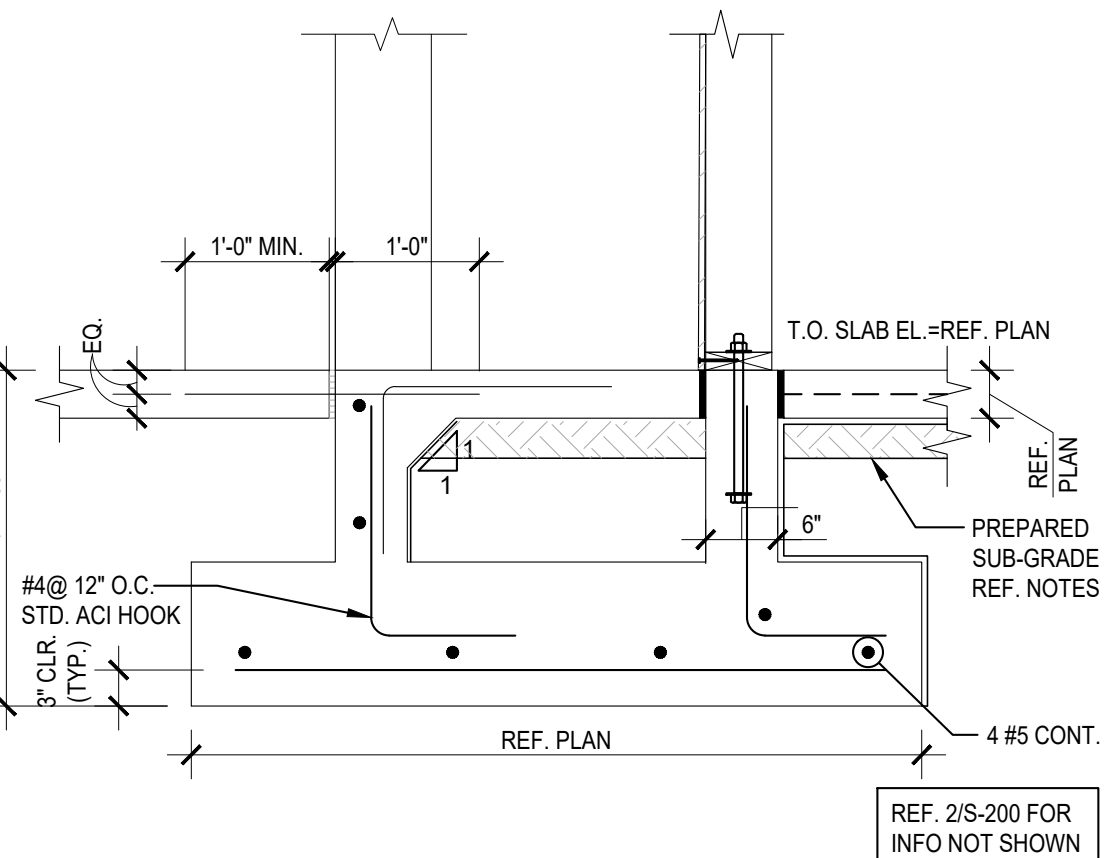


SECTION

18

SCALE: 3/4"=1'-0"

S-200

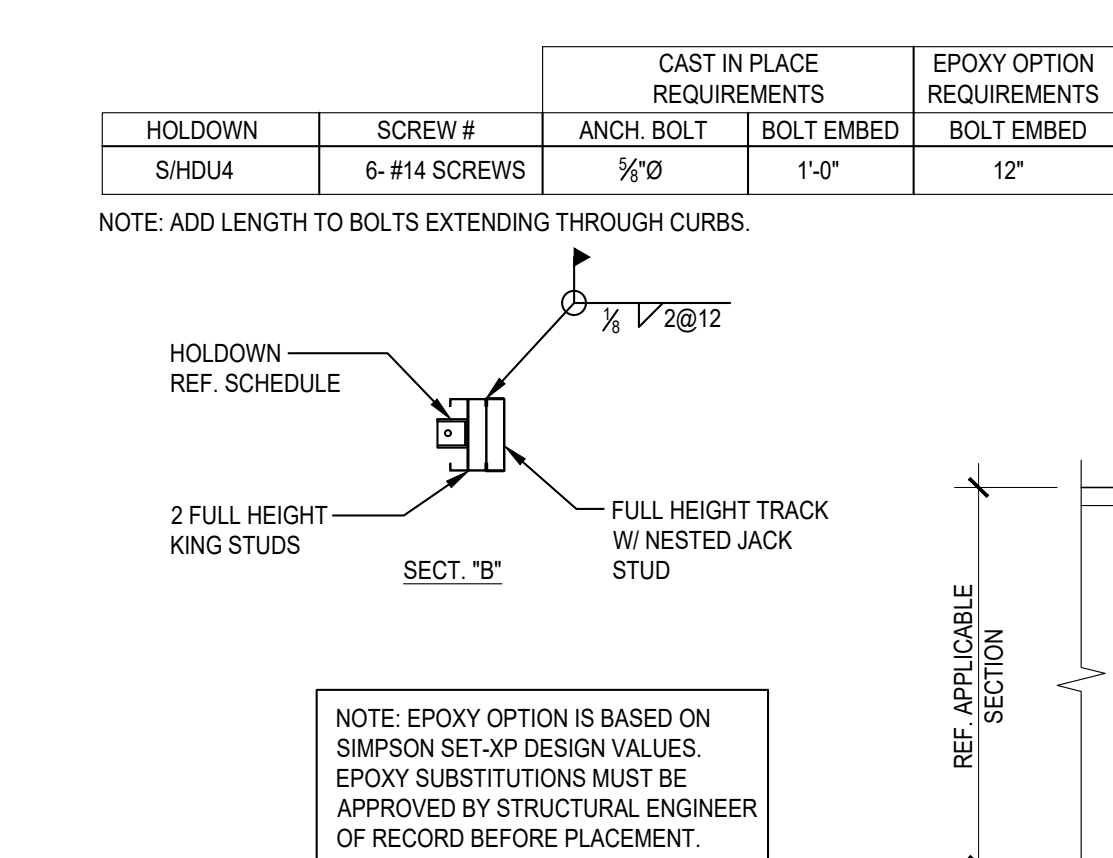

TYPICAL HOLDOWN DETAIL- LIGHT GAGE


10

SCALE: 3/4"=1'-0"

S-200

HOLDOWN	STUDS	SCREW #	CAST IN PLACE REQUIREMENTS		EPOXY OPTION REQUIREMENTS	
			ANCH. BOLT	BOLT EMBED	BOLT EMBED	BOLT EMBED
HU2-SDS2.5	3	6- SDS 1/2"x2 1/2"	3/8"	1'-0"	1'-0"	10"
HU5-SDS2.5	3	14- SDS 3/8"x2 1/2"	3/8"	1'-0"	1'-0"	12"
HU8-SDS2.5	3	20- SDS 3/8"x2 1/2"	3/8"	1'-0"	1'-0"	12"
HU11-SDS2.5	6x6	30- SDS 3/8"x2 1/2"	1"	1'-0"	1'-0"	16"
HU14-SDS2.5	6x6	36- SDS 3/8"x2 1/2"	1"	1'-0"	1'-0"	16"

NOTE: ADD LENGTH TO BOLTS EXTENDING THROUGH CURBS.

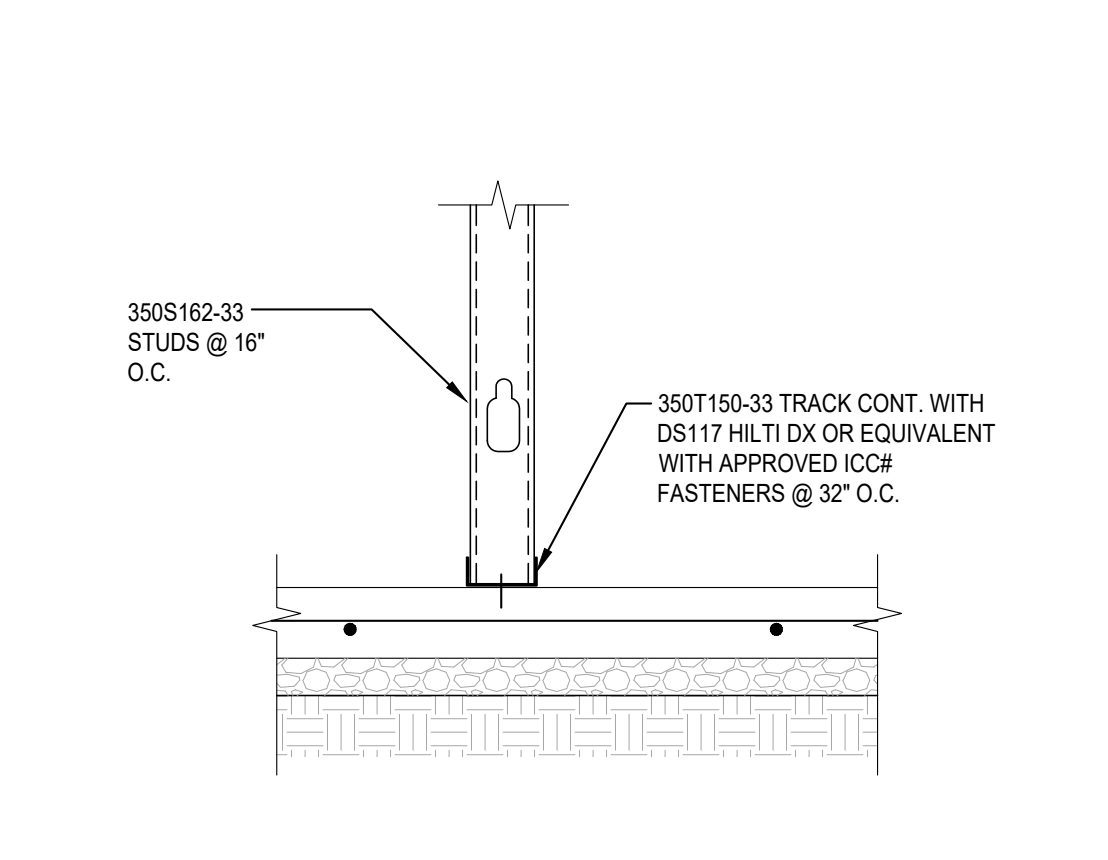


SLAB AT NON BEARING WALL

17

SCALE: N.T.S.

S-200

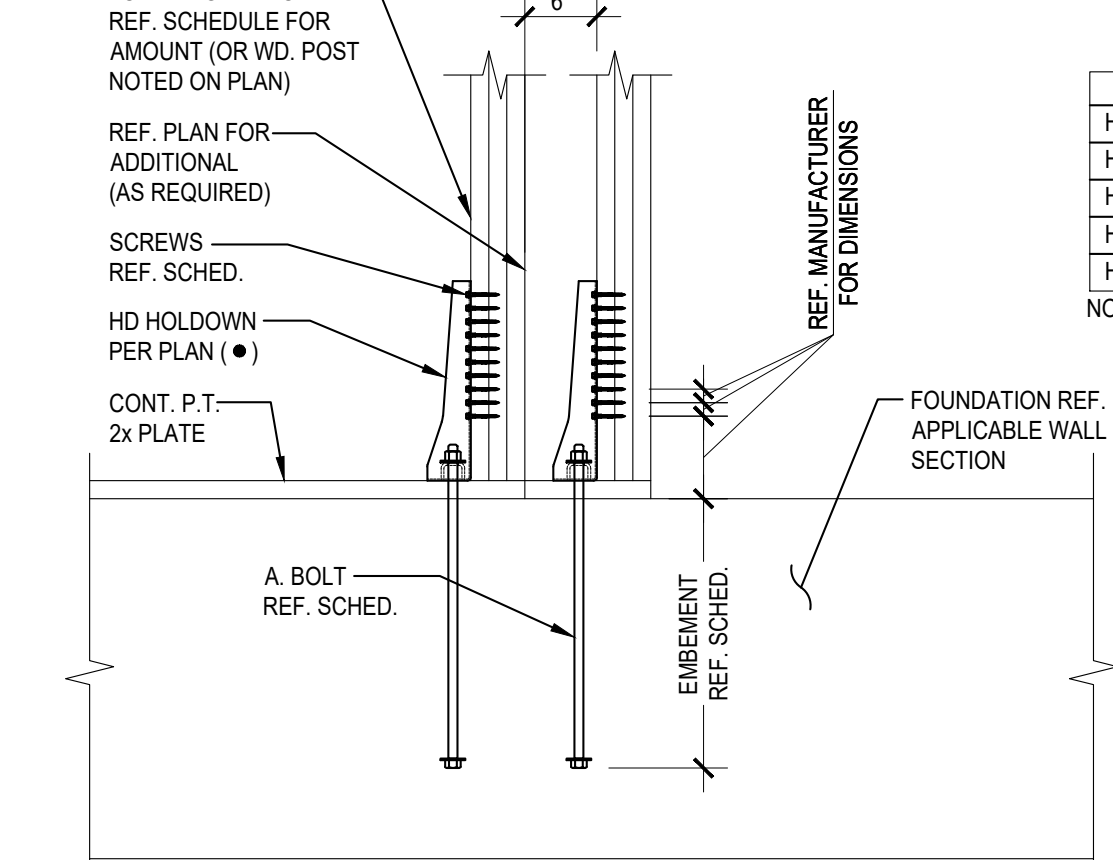


TYPICAL HOLDOWN DETAIL- WOOD

9

SCALE: N.T.S.

S-200

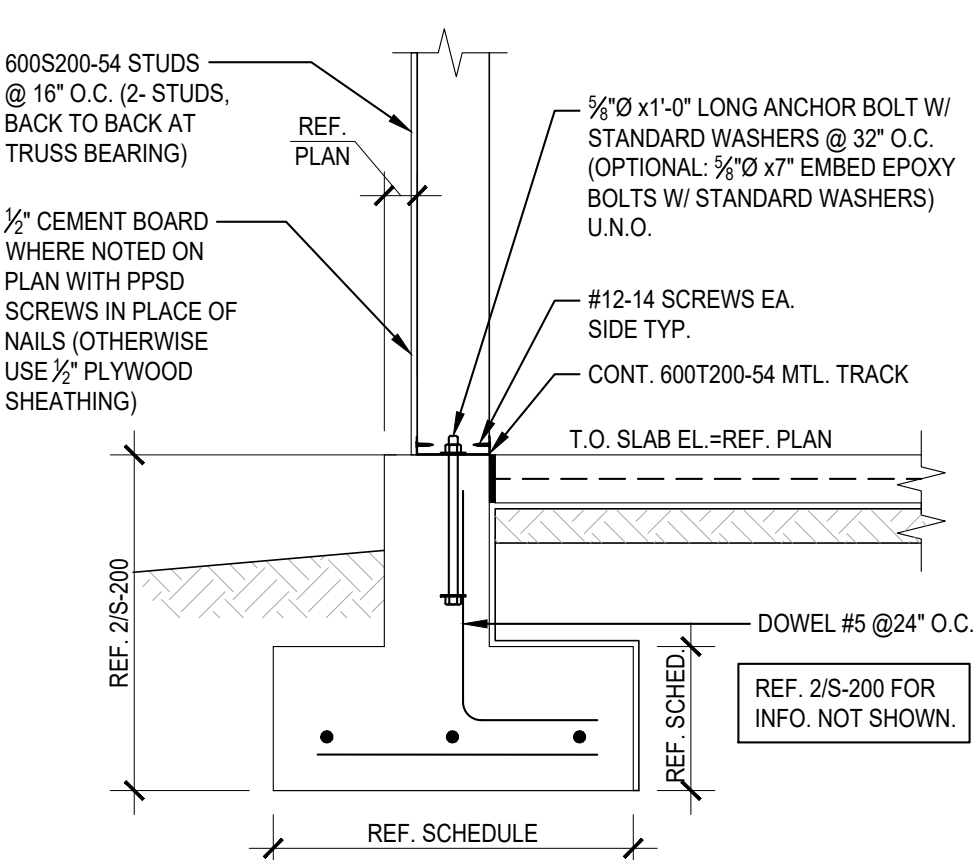


SECTION

5

SCALE: 3/4"=1'-0"

S-200

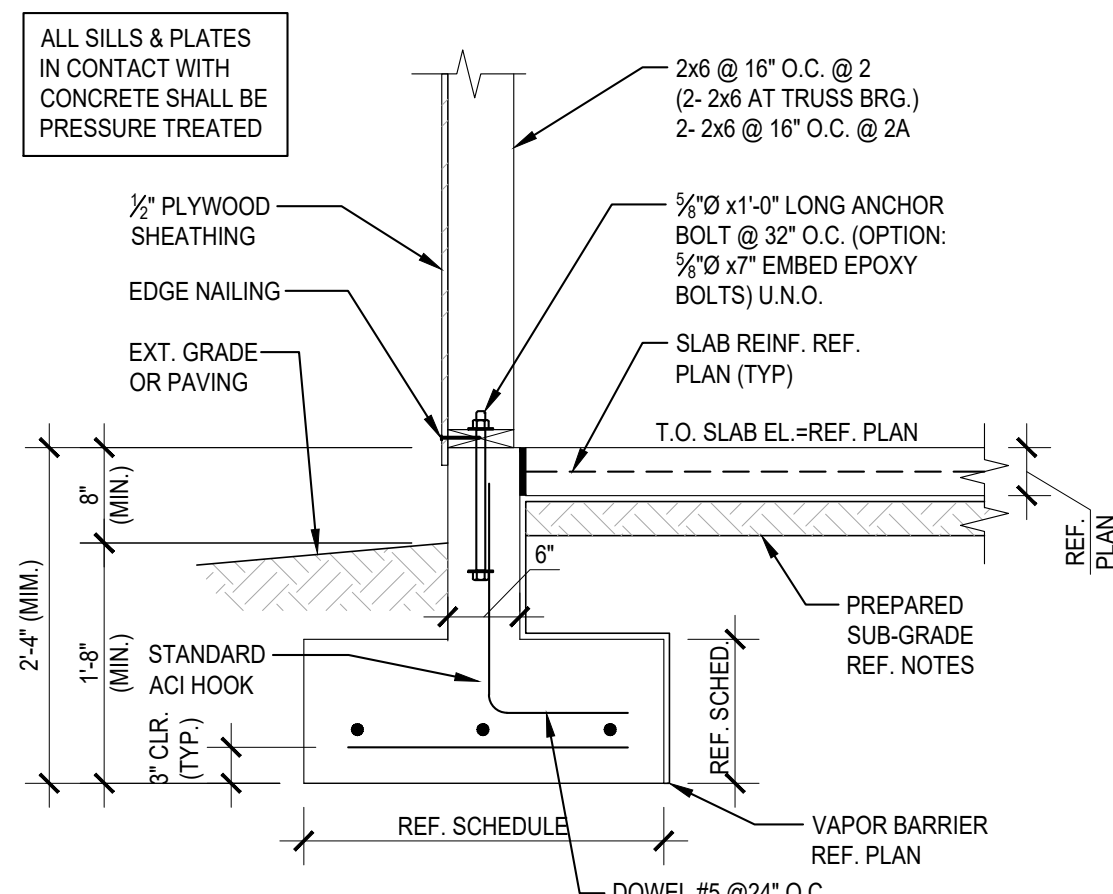


SECTION

2, 2A

SCALE: 3/4"=1'-0"

S-200

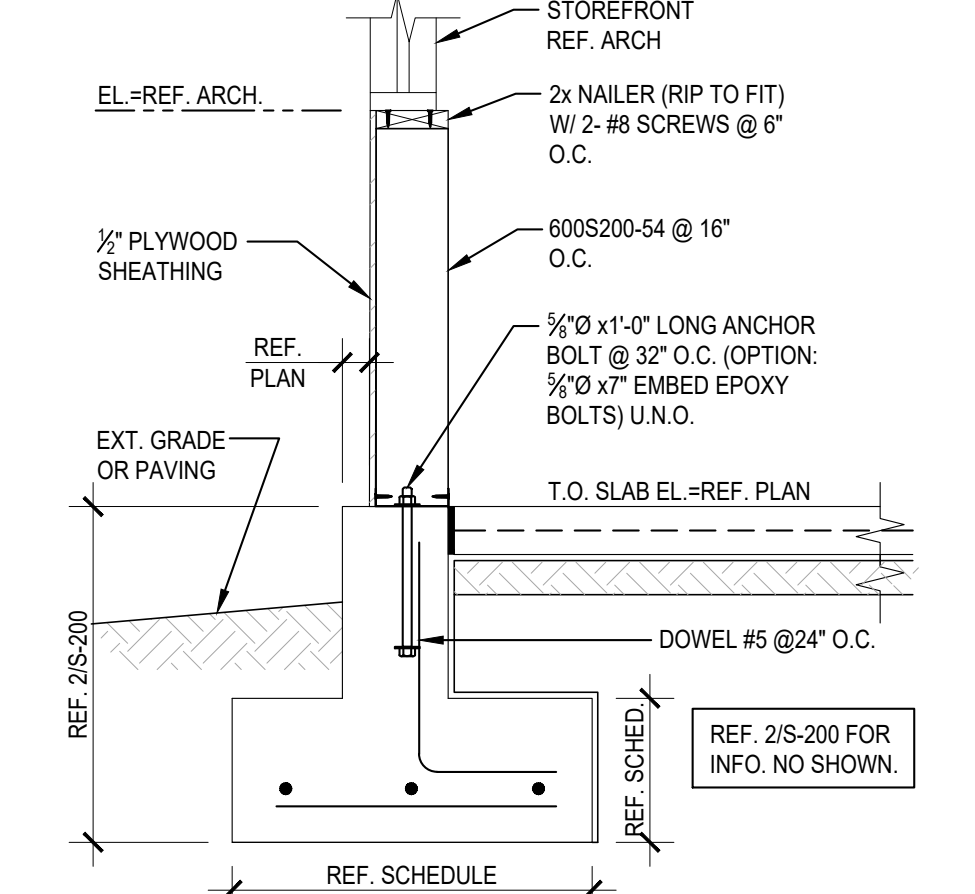

SECTION

6

SCALE: 3/4"=1'-0"

S-200



PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

1	CHECK SET	12-15-20
2	PERMIT SET	12-18-20
3	BID SET	02-01-21

DRAWN BY: DAS

PANDA PROJECT #: S8-21-D8043
ARCH PROJECT #: P7356.2













PANDA EXPRESS
TRUE WARM & WELCOME 2300
2599 S WOODLAND BLVD
DELAND, FL 32720

S-200

FOUNDATION DETAILS

TRUE WARM & WELCOME 2300 R1

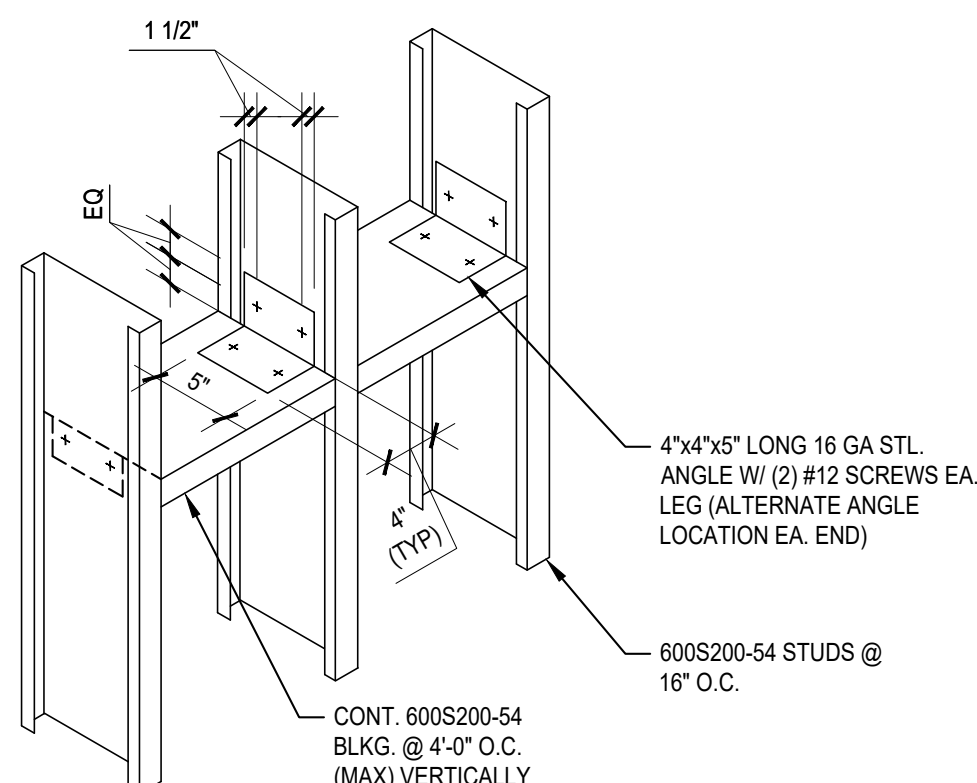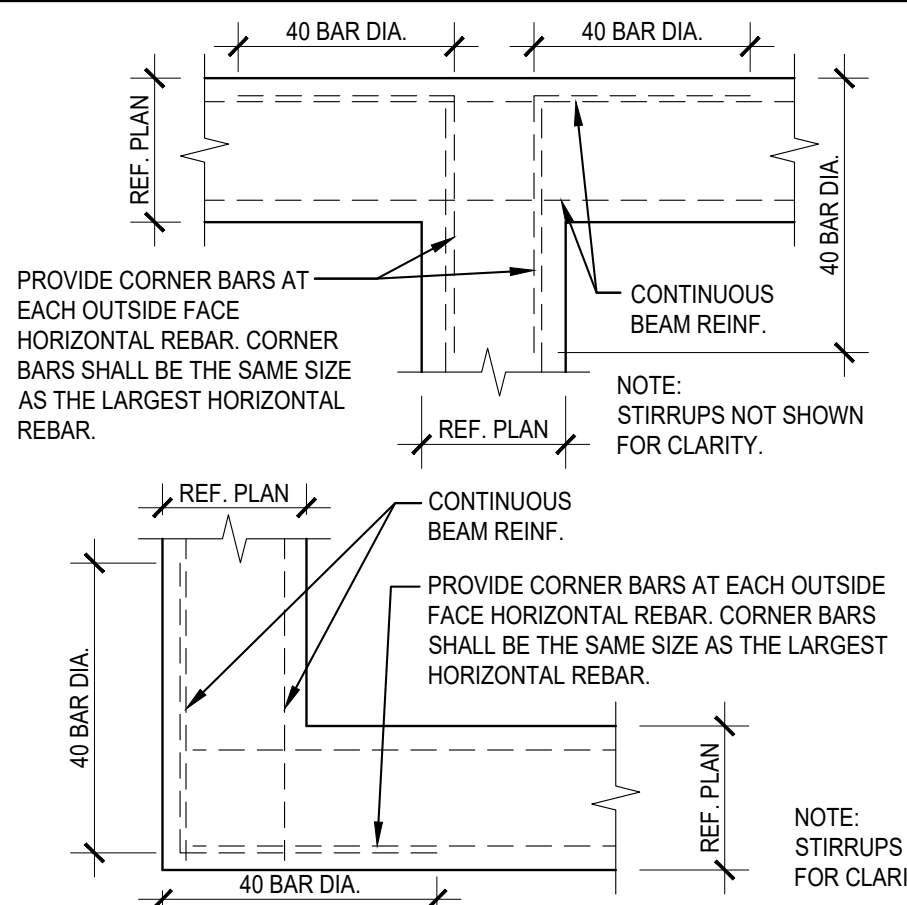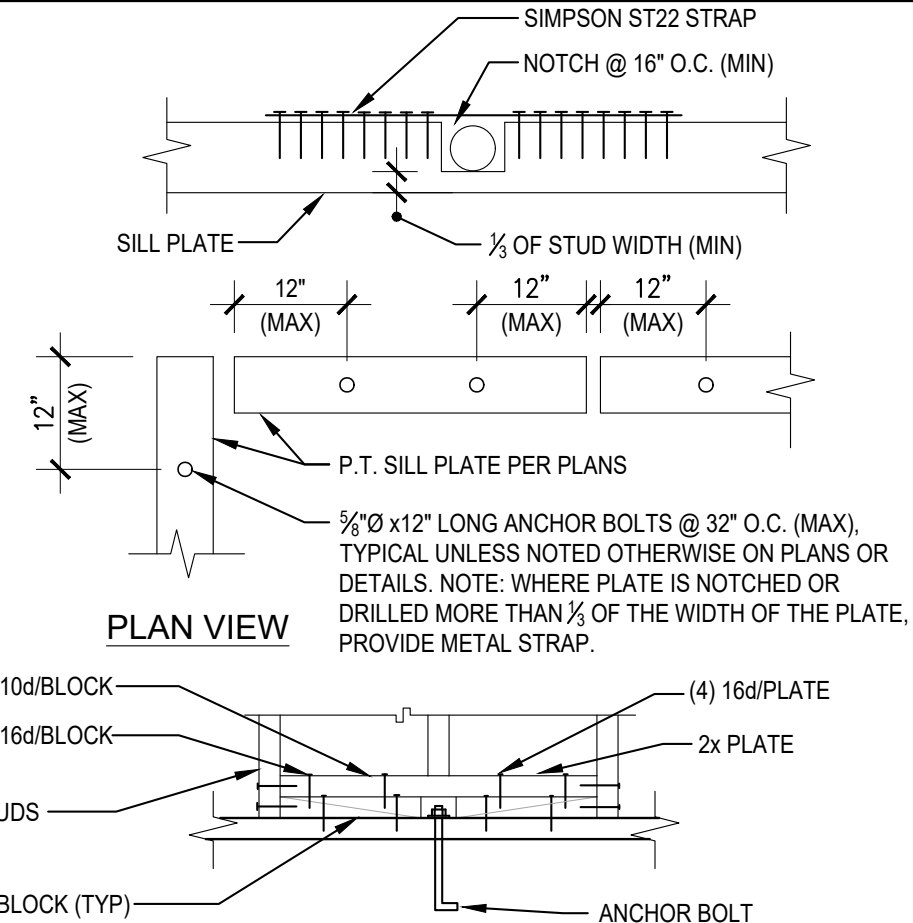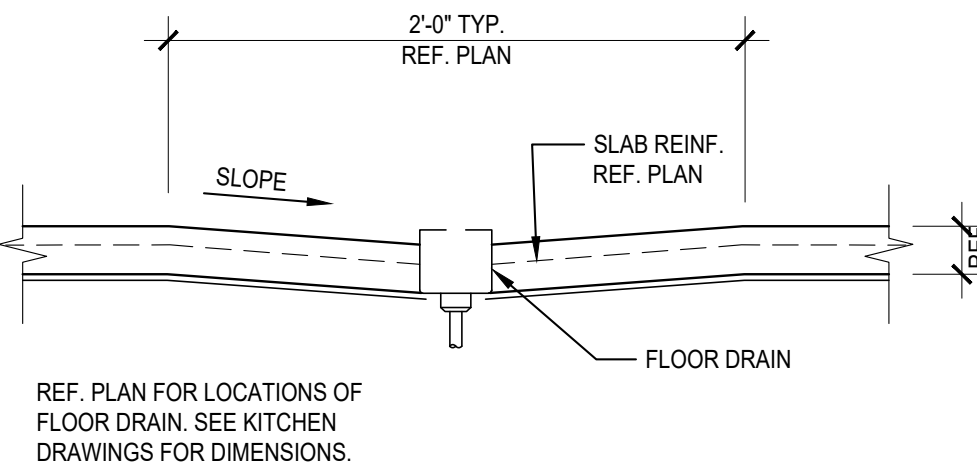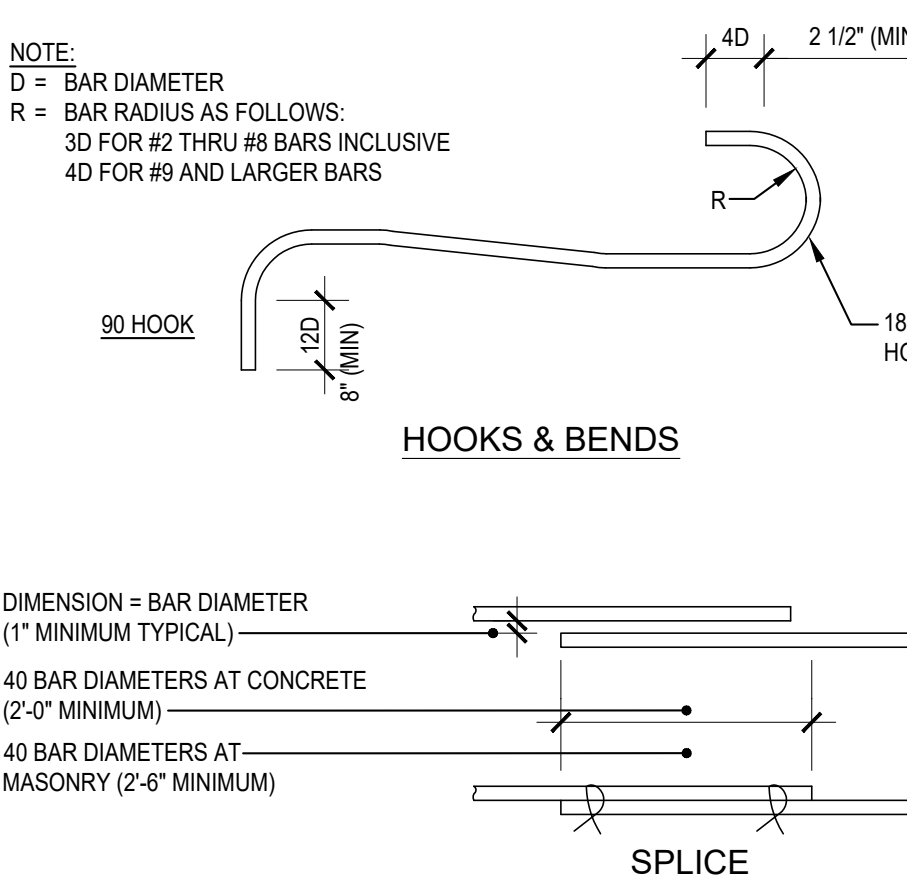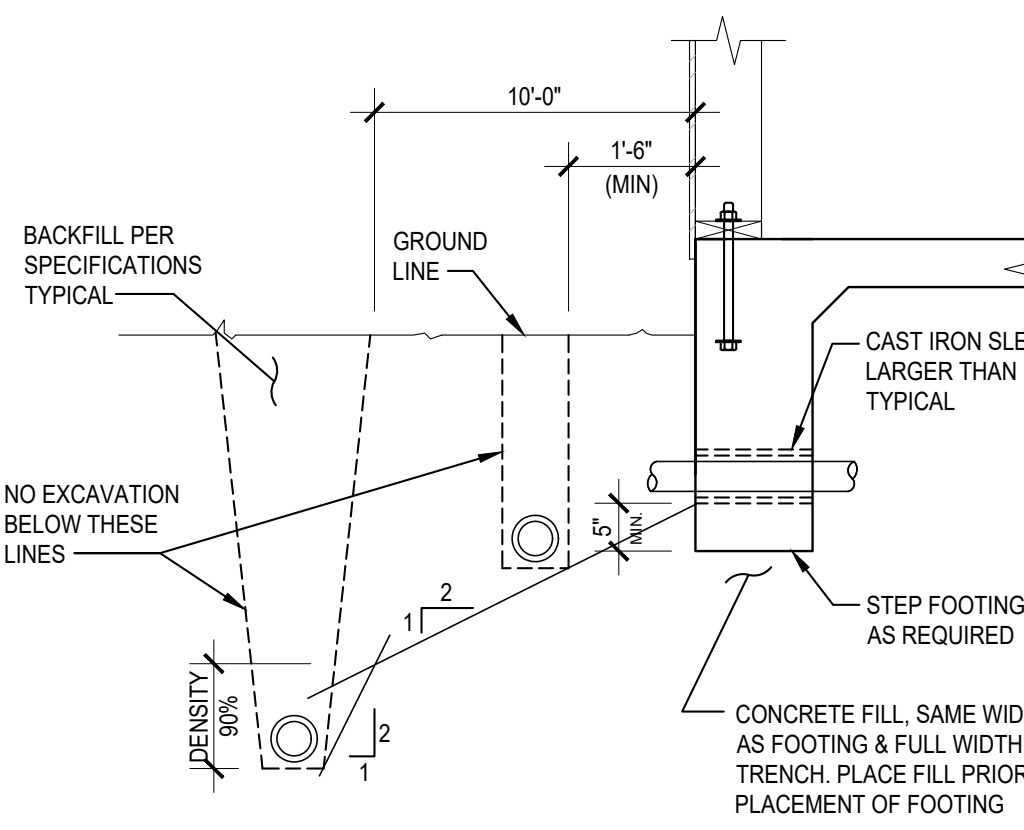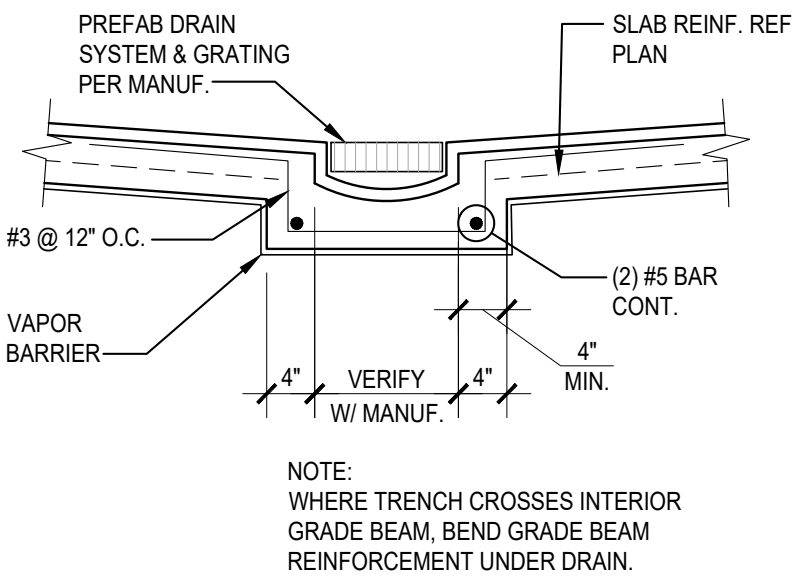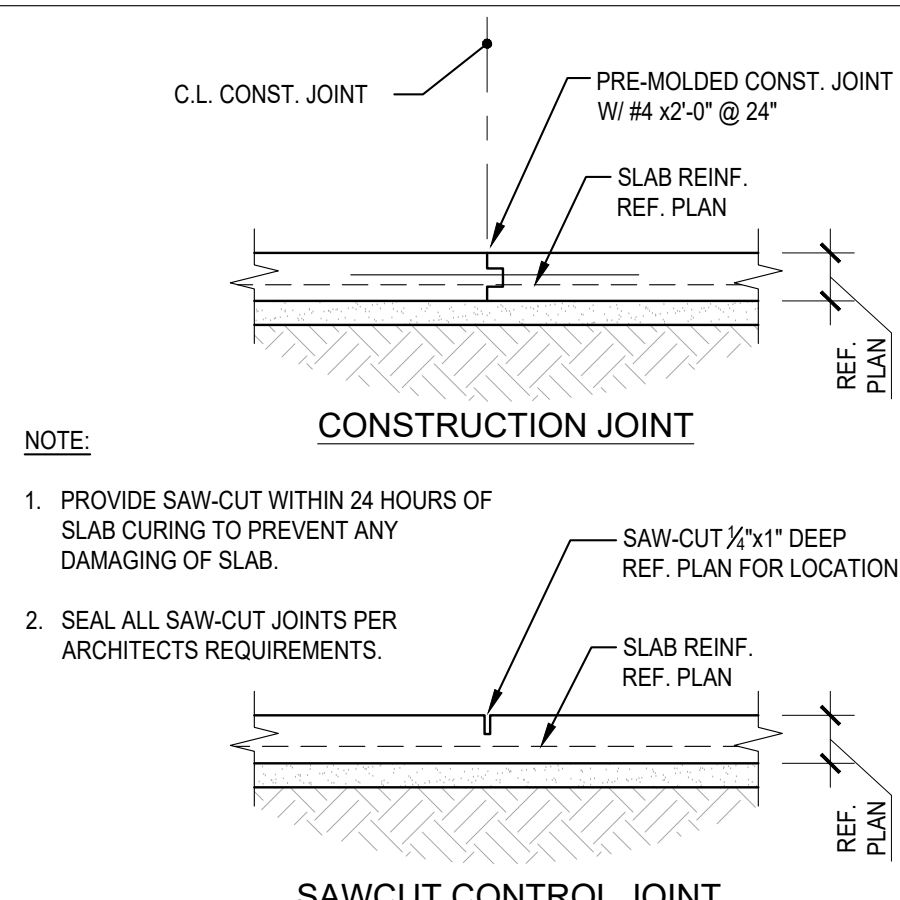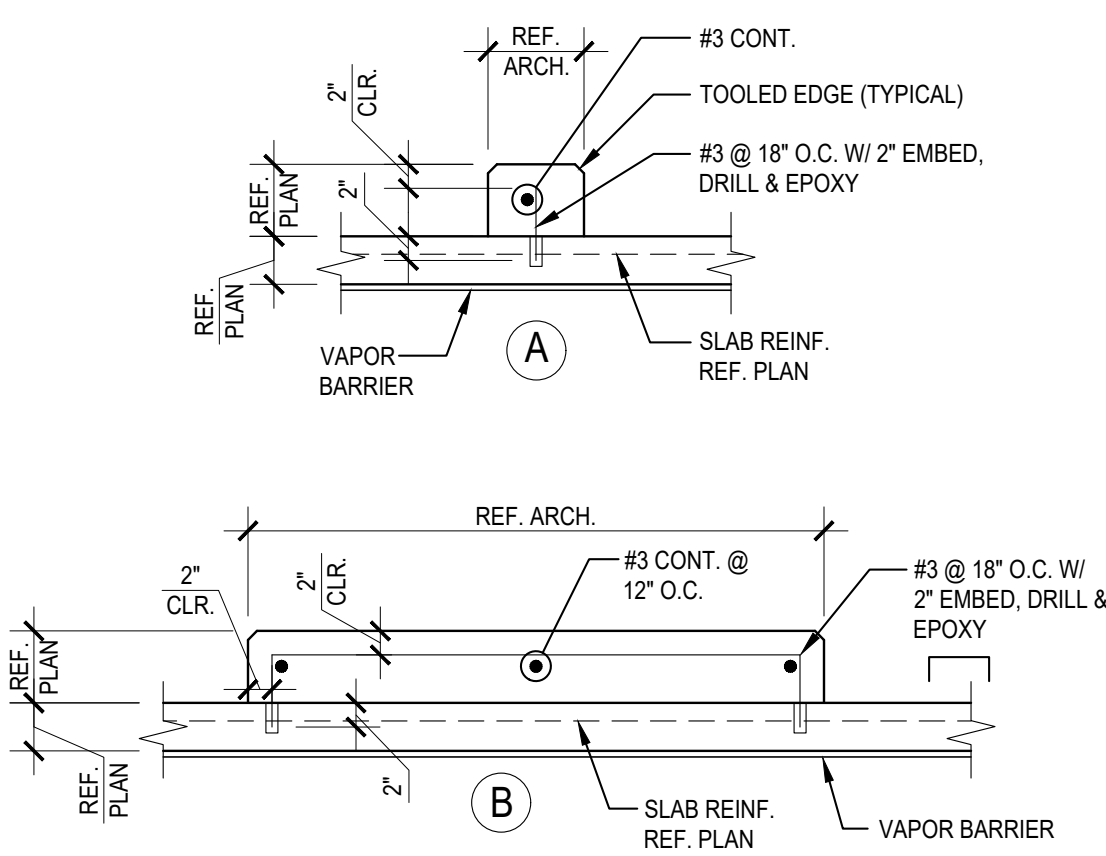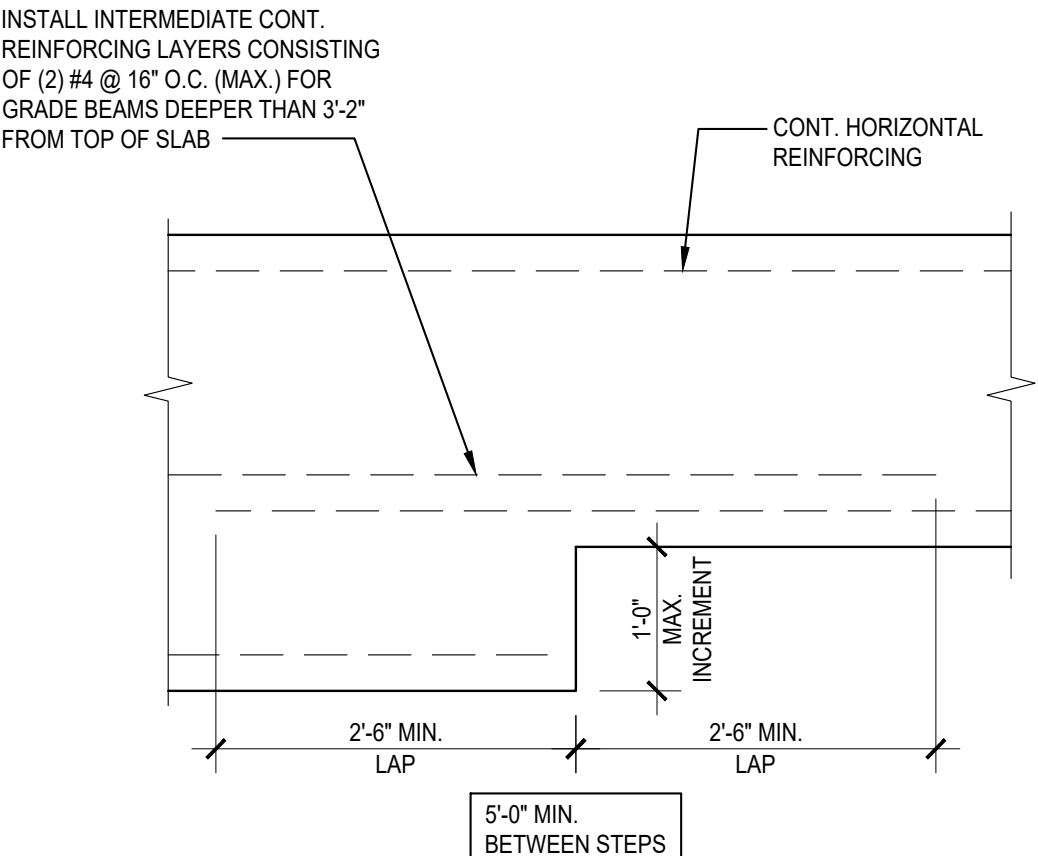											
NOT USED	20	NOT USED	16	TYPICAL METAL STUD VERTICAL	12	TYPICAL CORNER BAR	8	TYPICAL SILL PLATE BOLTS	4		
SCALE: 3/4"=1'-0"	S-201	SCALE: 3/4"=1'-0"	S-201	BLOCKING	SCALE: 3/4"=1'-0"	SCALE: N.T.S.	S-201	SCALE: N.T.S.	S-201		
											
NOT USED	19	NOT USED	15	TYPICAL FLOOR DRAIN	11	TYPICAL REINFORCING BAR	7	TYPICAL PIPE & TRENCH DETAIL	3		
SCALE: 3/4"=1'-0"	S-201	SCALE: 3/4"=1'-0"	S-201	SCALE: N.T.S.	S-201	SCALE: N.T.S.	S-201	SCALE: N.T.S.	S-201		
											
NOT USED	18	NOT USED	14	TYPICAL TRENCH DRAIN	10	NOT USED	6	TYPICAL JOINT DETAIL	2		
SCALE: 3/4"=1'-0"	S-201	SCALE: 3/4"=1'-0"	S-201	SCALE: 3/4"=1'-0"	S-201	SCALE: N.T.S.	S-201	SCALE: 3/4"=1'-0"	S-201		
											
NOT USED	17	NOT USED	13	TYPICAL CURB	9	TYPICAL STEP FOOTING	5				
SCALE: 3/4"=1'-0"	S-201	SCALE: N.T.S.	S-201	SCALE: 3/4"=1'-0"	S-201	SCALE: N.T.S.	S-201				



PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:		
ISSUE DATE:		
1	CHECK SET	12-15-20
2	PERMIT SET	12-18-20
3	BID SET	02-01-21

DRAWN BY: DAS

PANDA PROJECT #: S8-21-D8043

ARCH PROJECT #: P7356.2



Plans Prepared By
CPH, Inc.
500 West Fulton St.
Sanford, FL 32771
Ph: 407.322.6841
Licenses:
Eng. C.O.A. No. 3215
Survey L.B. No. 7143
Arch. Lic. No. AA2600926
Lndscp. Lic. No. LC0000298

www.cphcorp.com

**A Full Service
A & E Firm**


PANDA EXPRESS

TRUE WARM & WELCOME 2300
2599 S WOODLAND BLVD
DELAND, FL 32720


S-201

TYPICAL FOUNDATION DETAILS


TRUE WARM & WELCOME 2300 R1

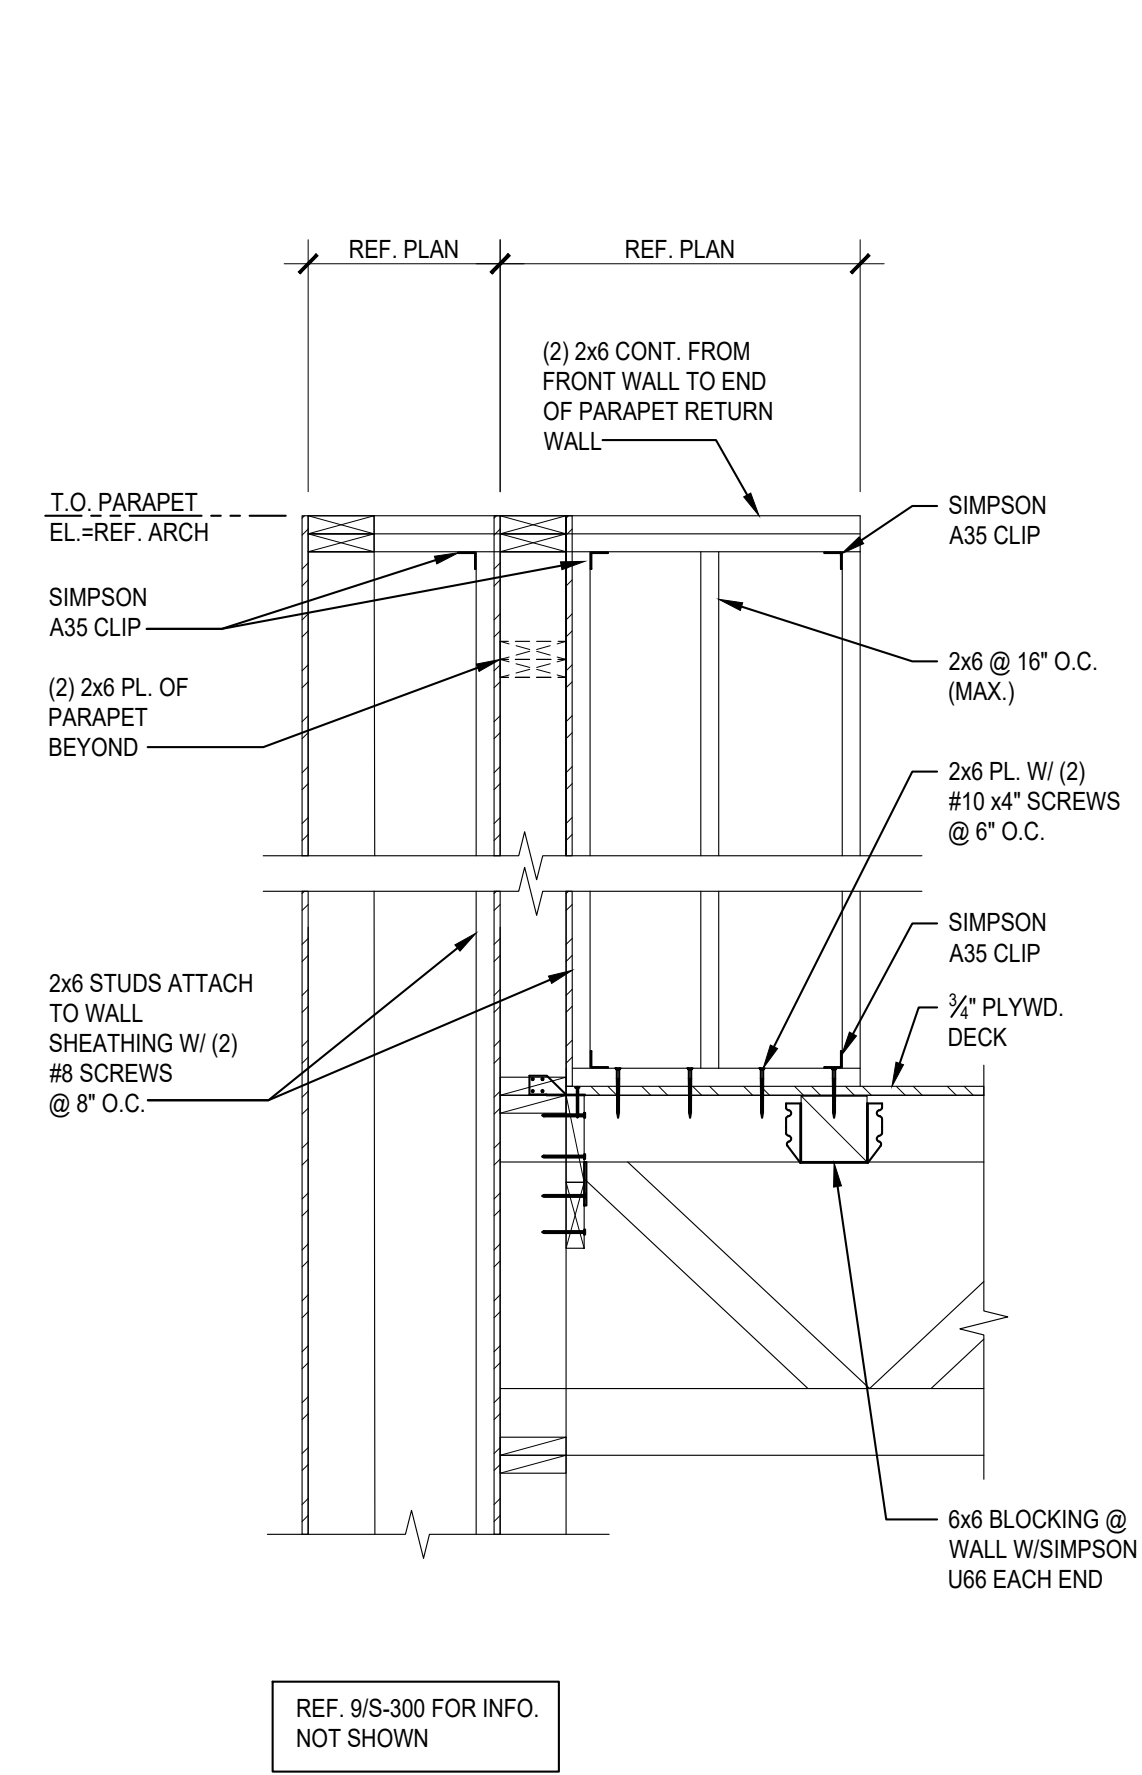


SECTION 19
SCALE: 3/4"=1'-0"
S-300

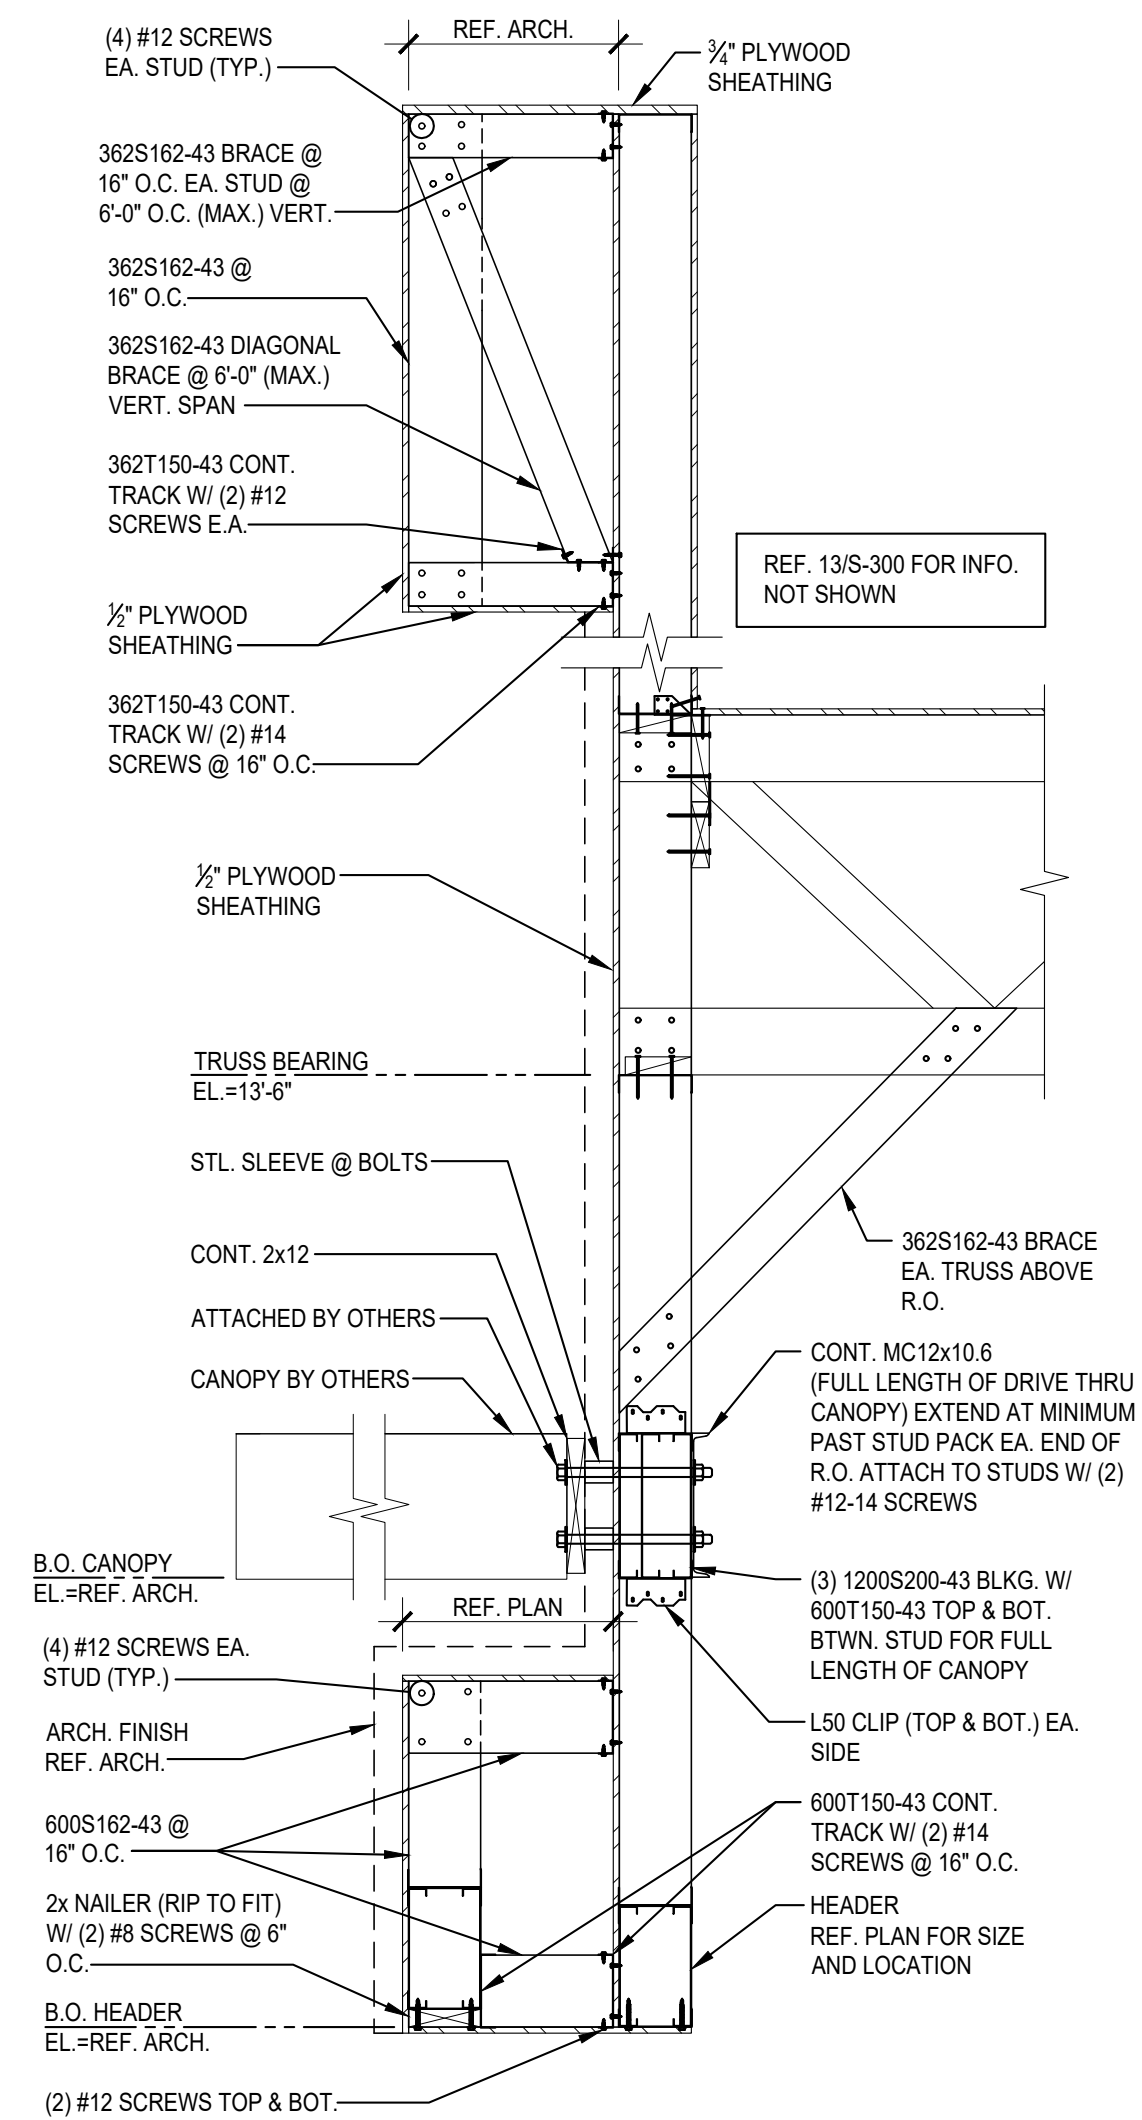


SECTION 17
SCALE: 3/4"=1'-0"
S-300

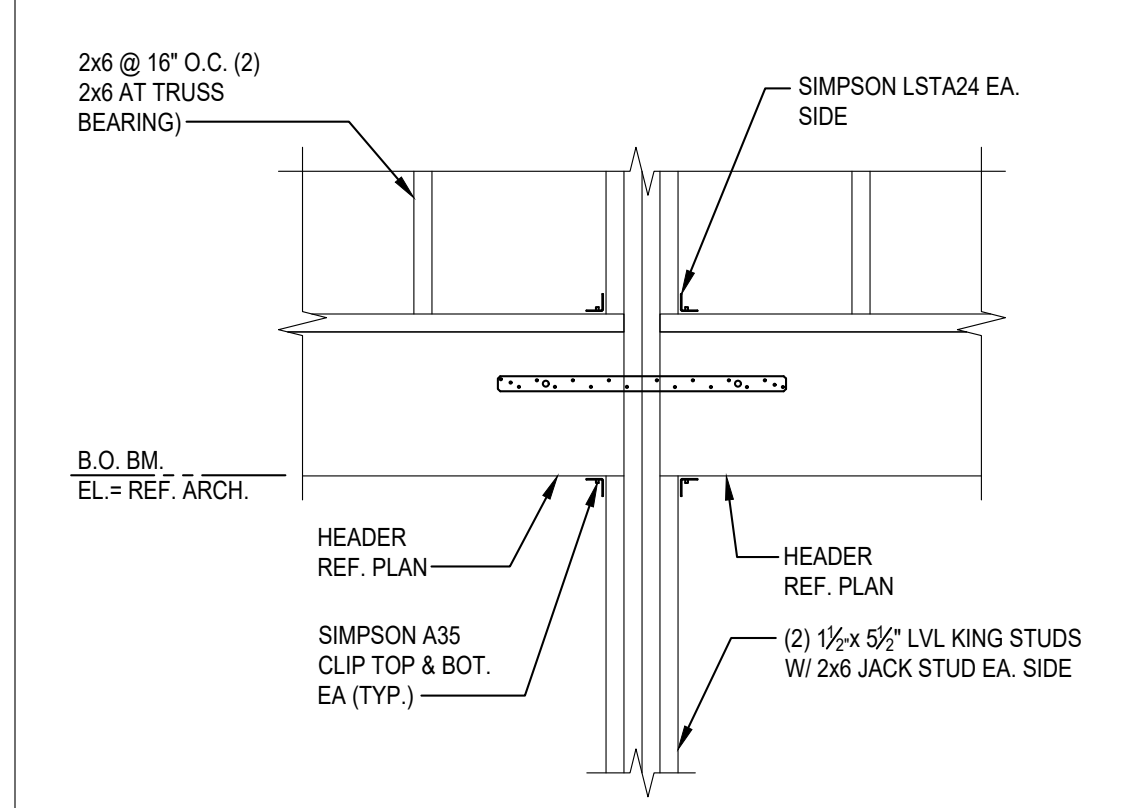


SECTION 16
SCALE: 3/4"=1'-0"
S-300

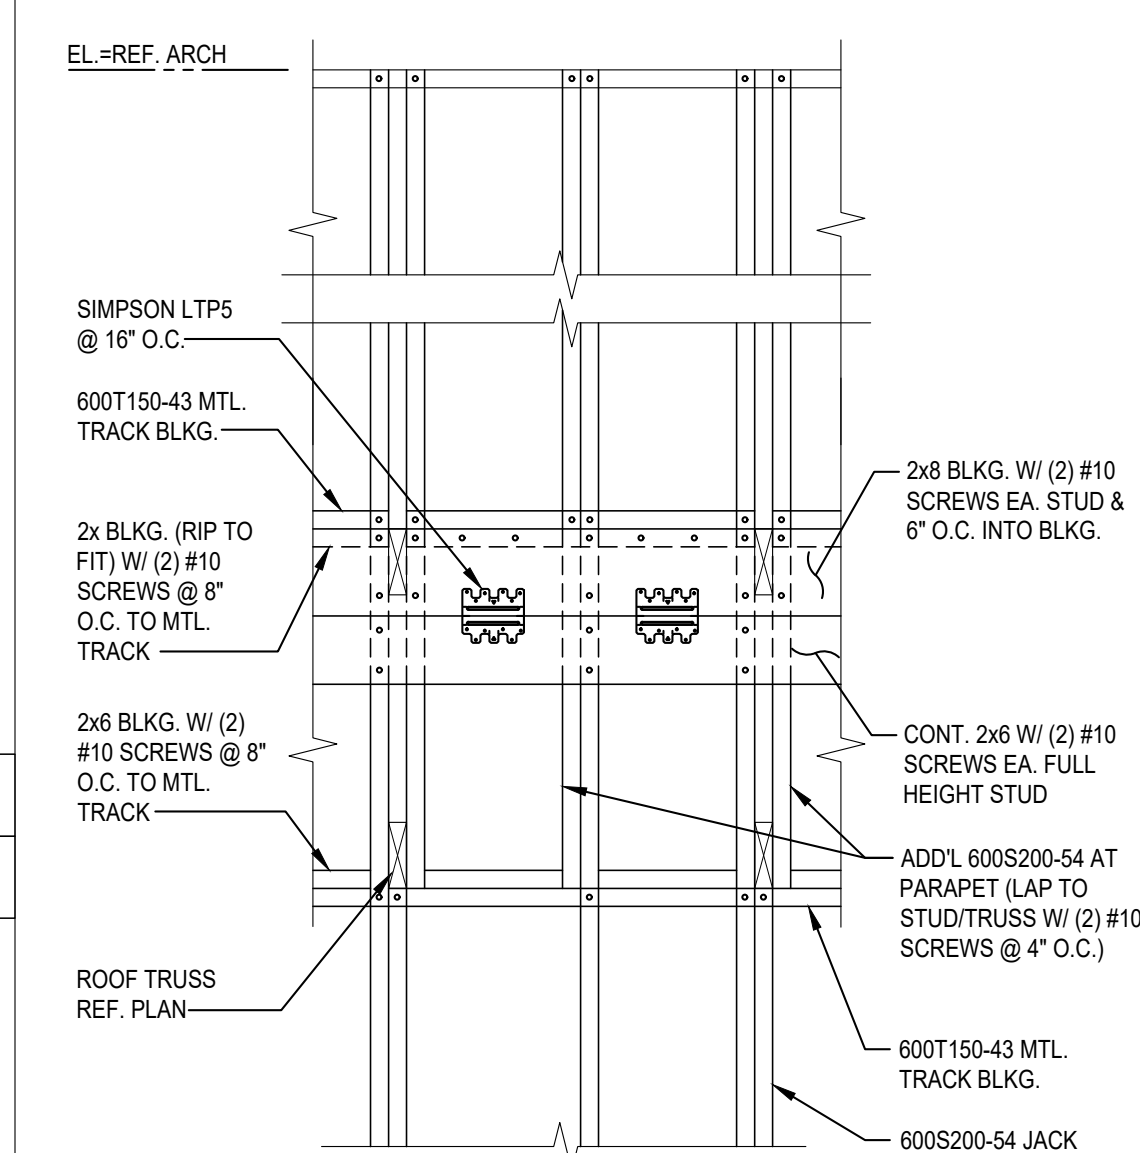


SECTION 11
SCALE: 3/4"=1'-0"
S-300

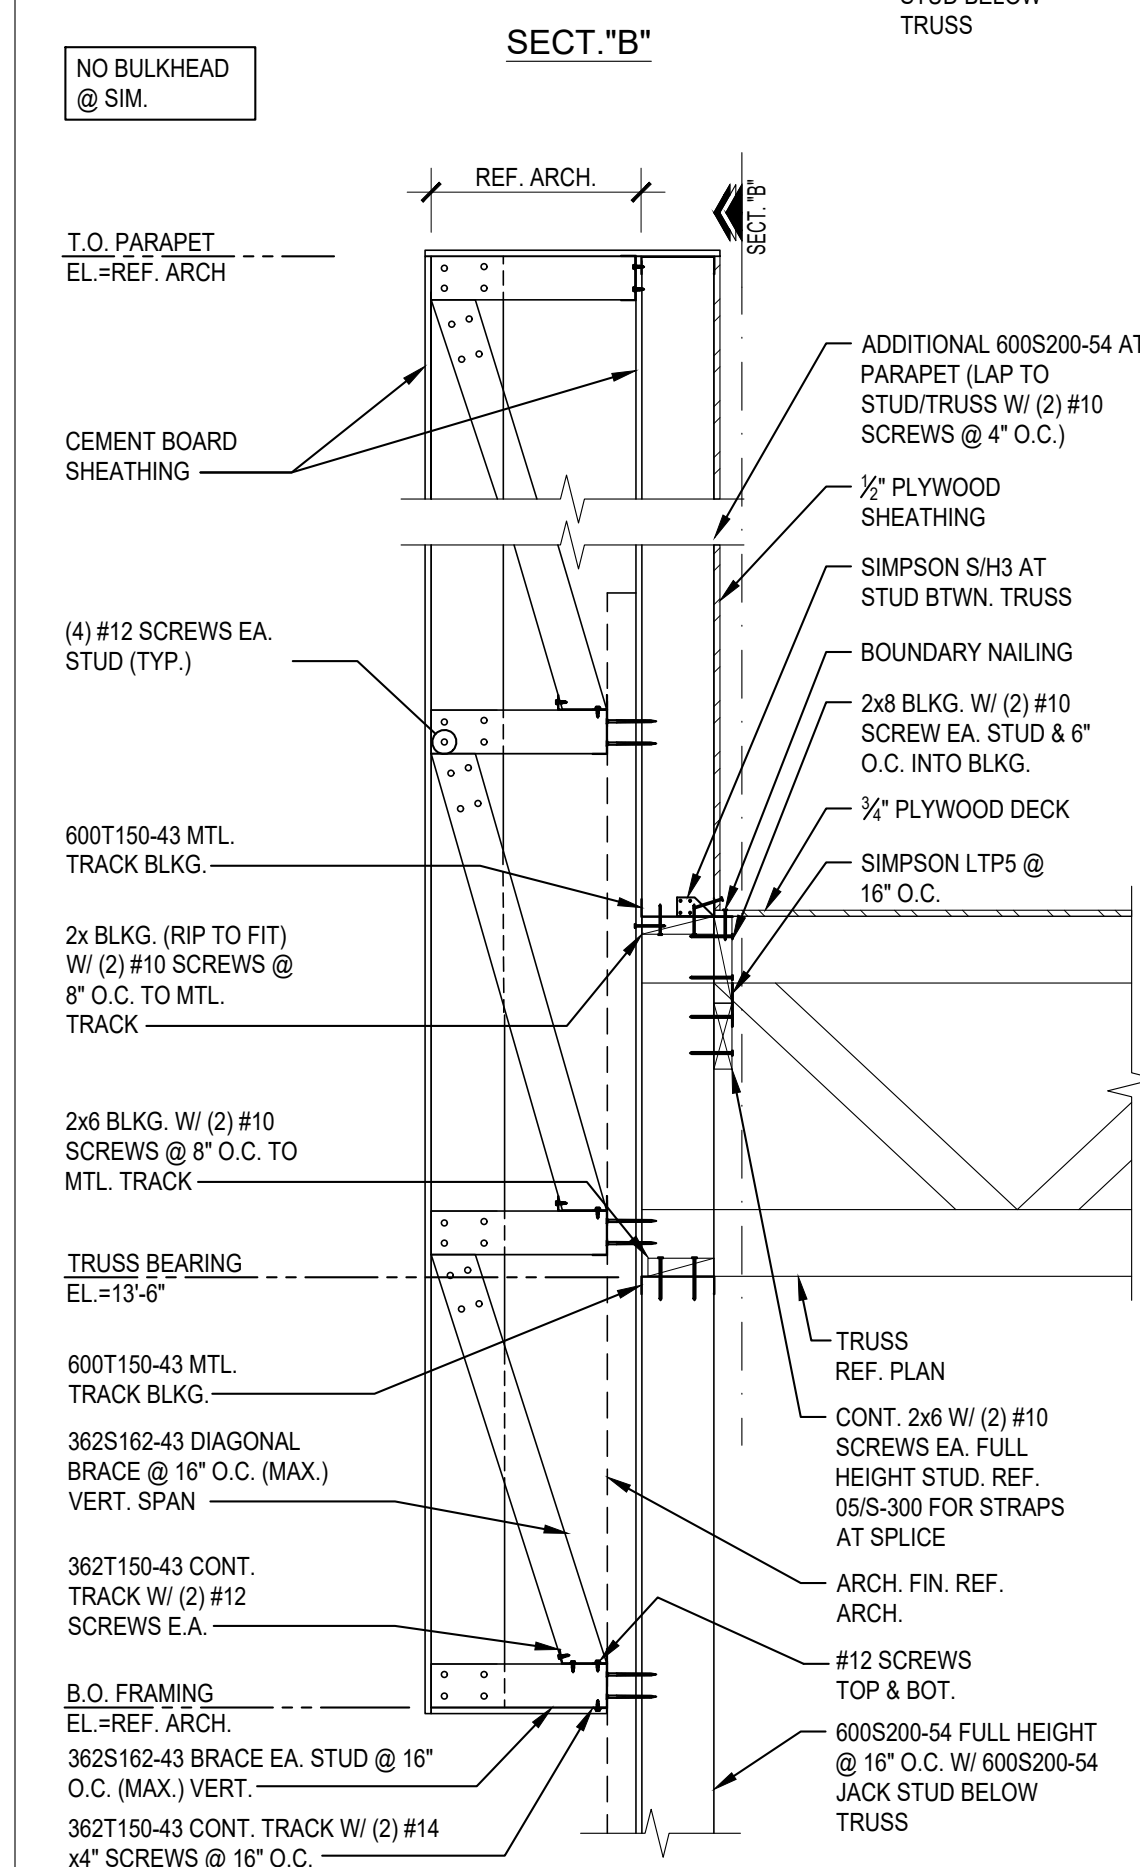


SECTION 13
SCALE: 3/4"=1'-0"
S-300

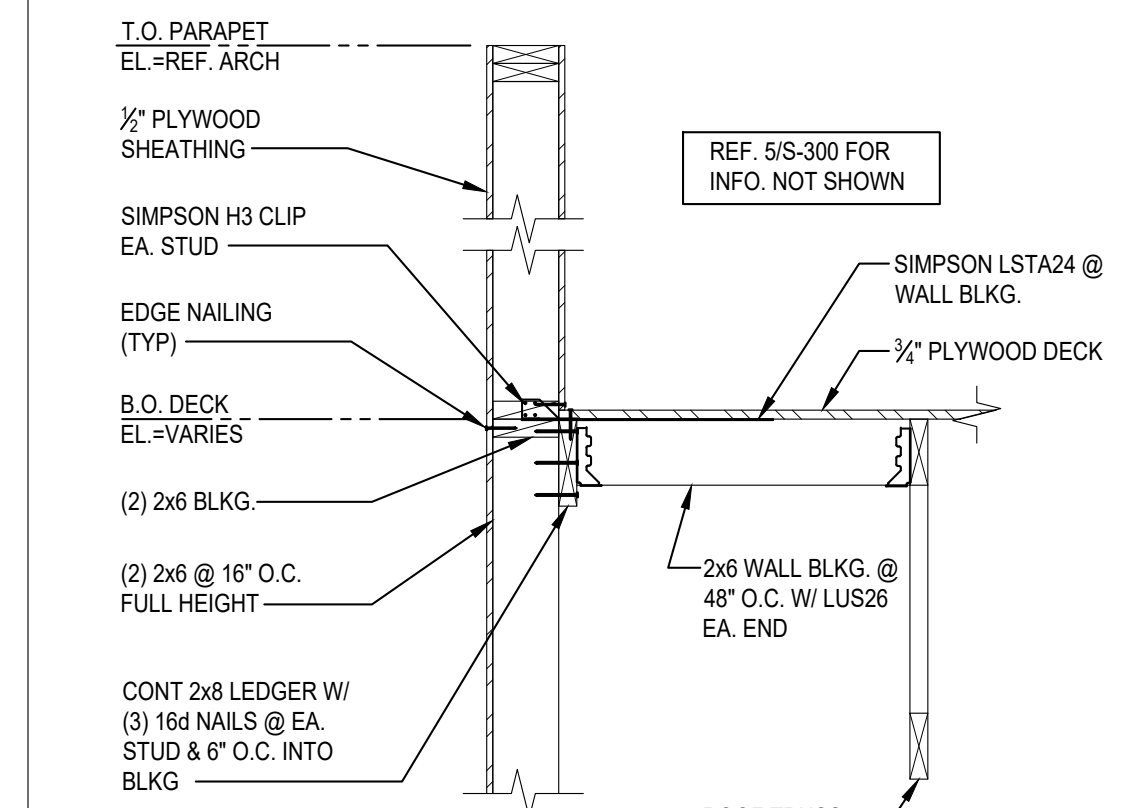


SECTION 10, 10A
SCALE: 3/4"=1'-0"
S-300

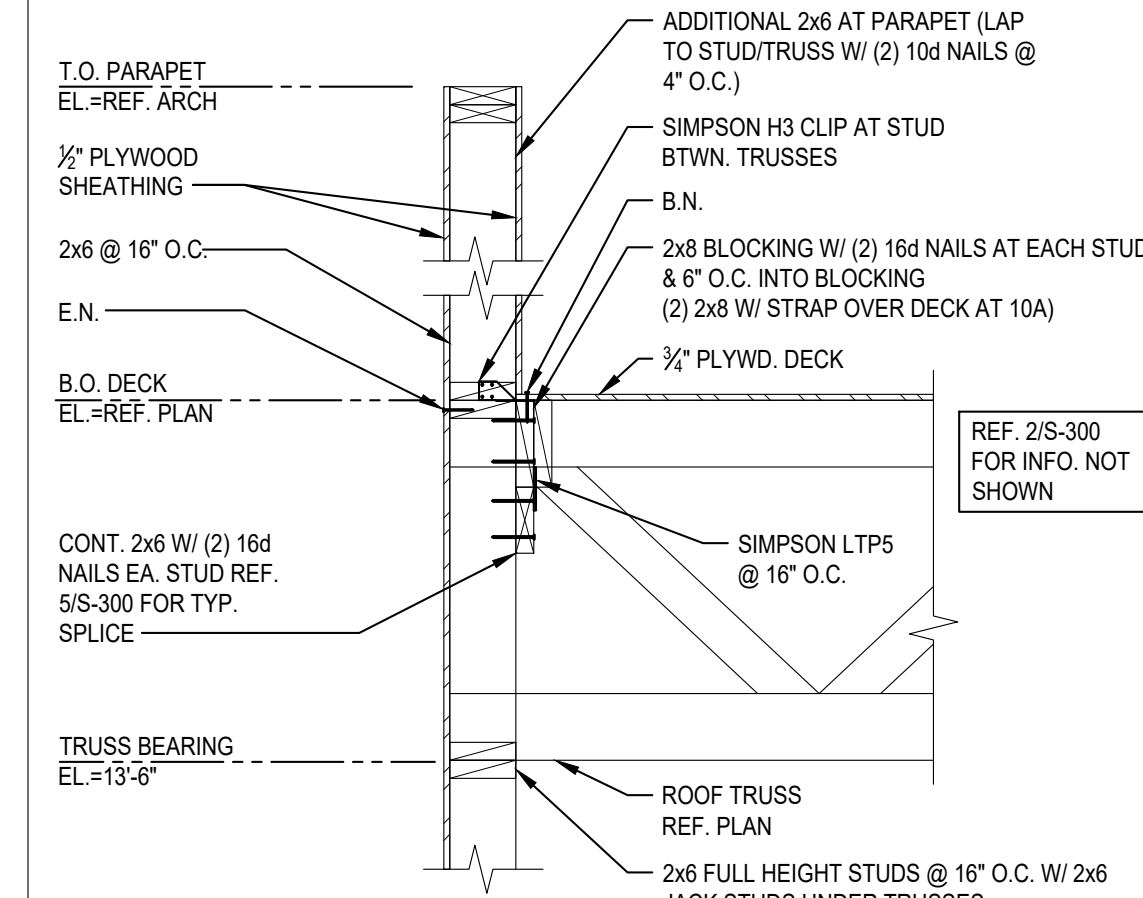


SECTION 7
SCALE: 3/4"=1'-0"
S-300

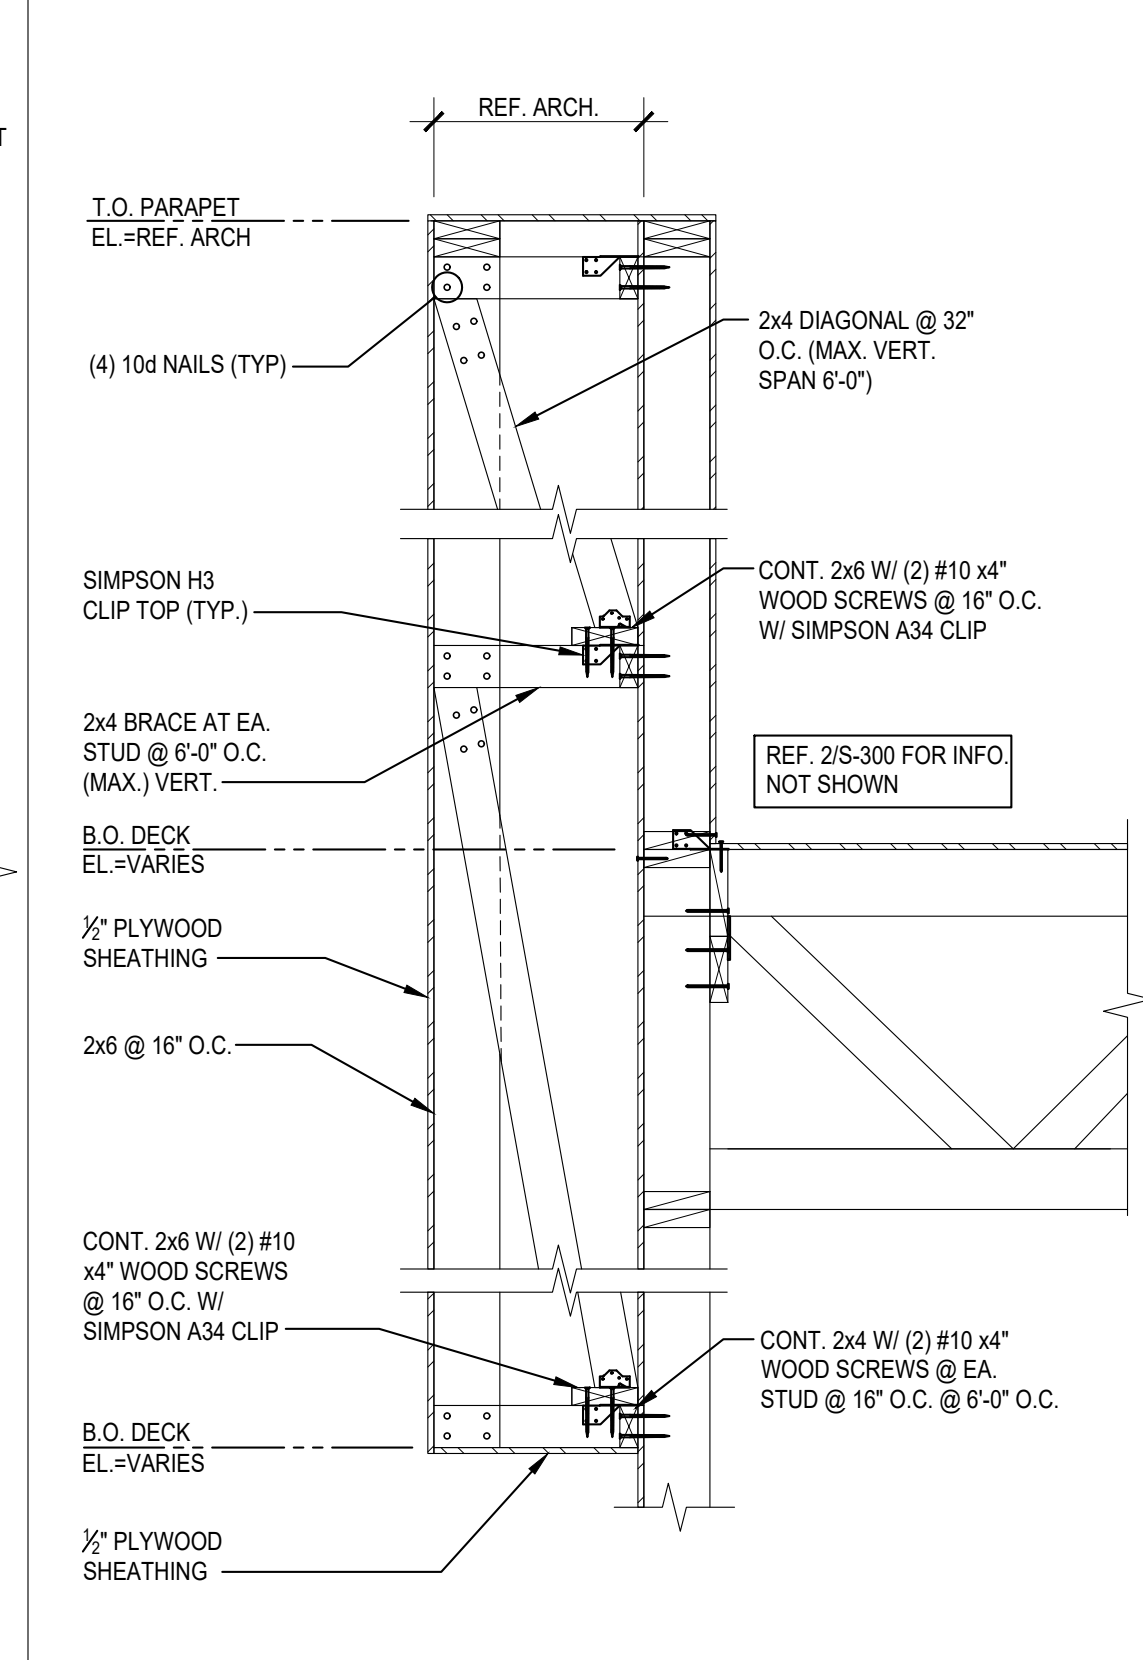


SECTION 9
SCALE: 3/4"=1'-0"
S-300

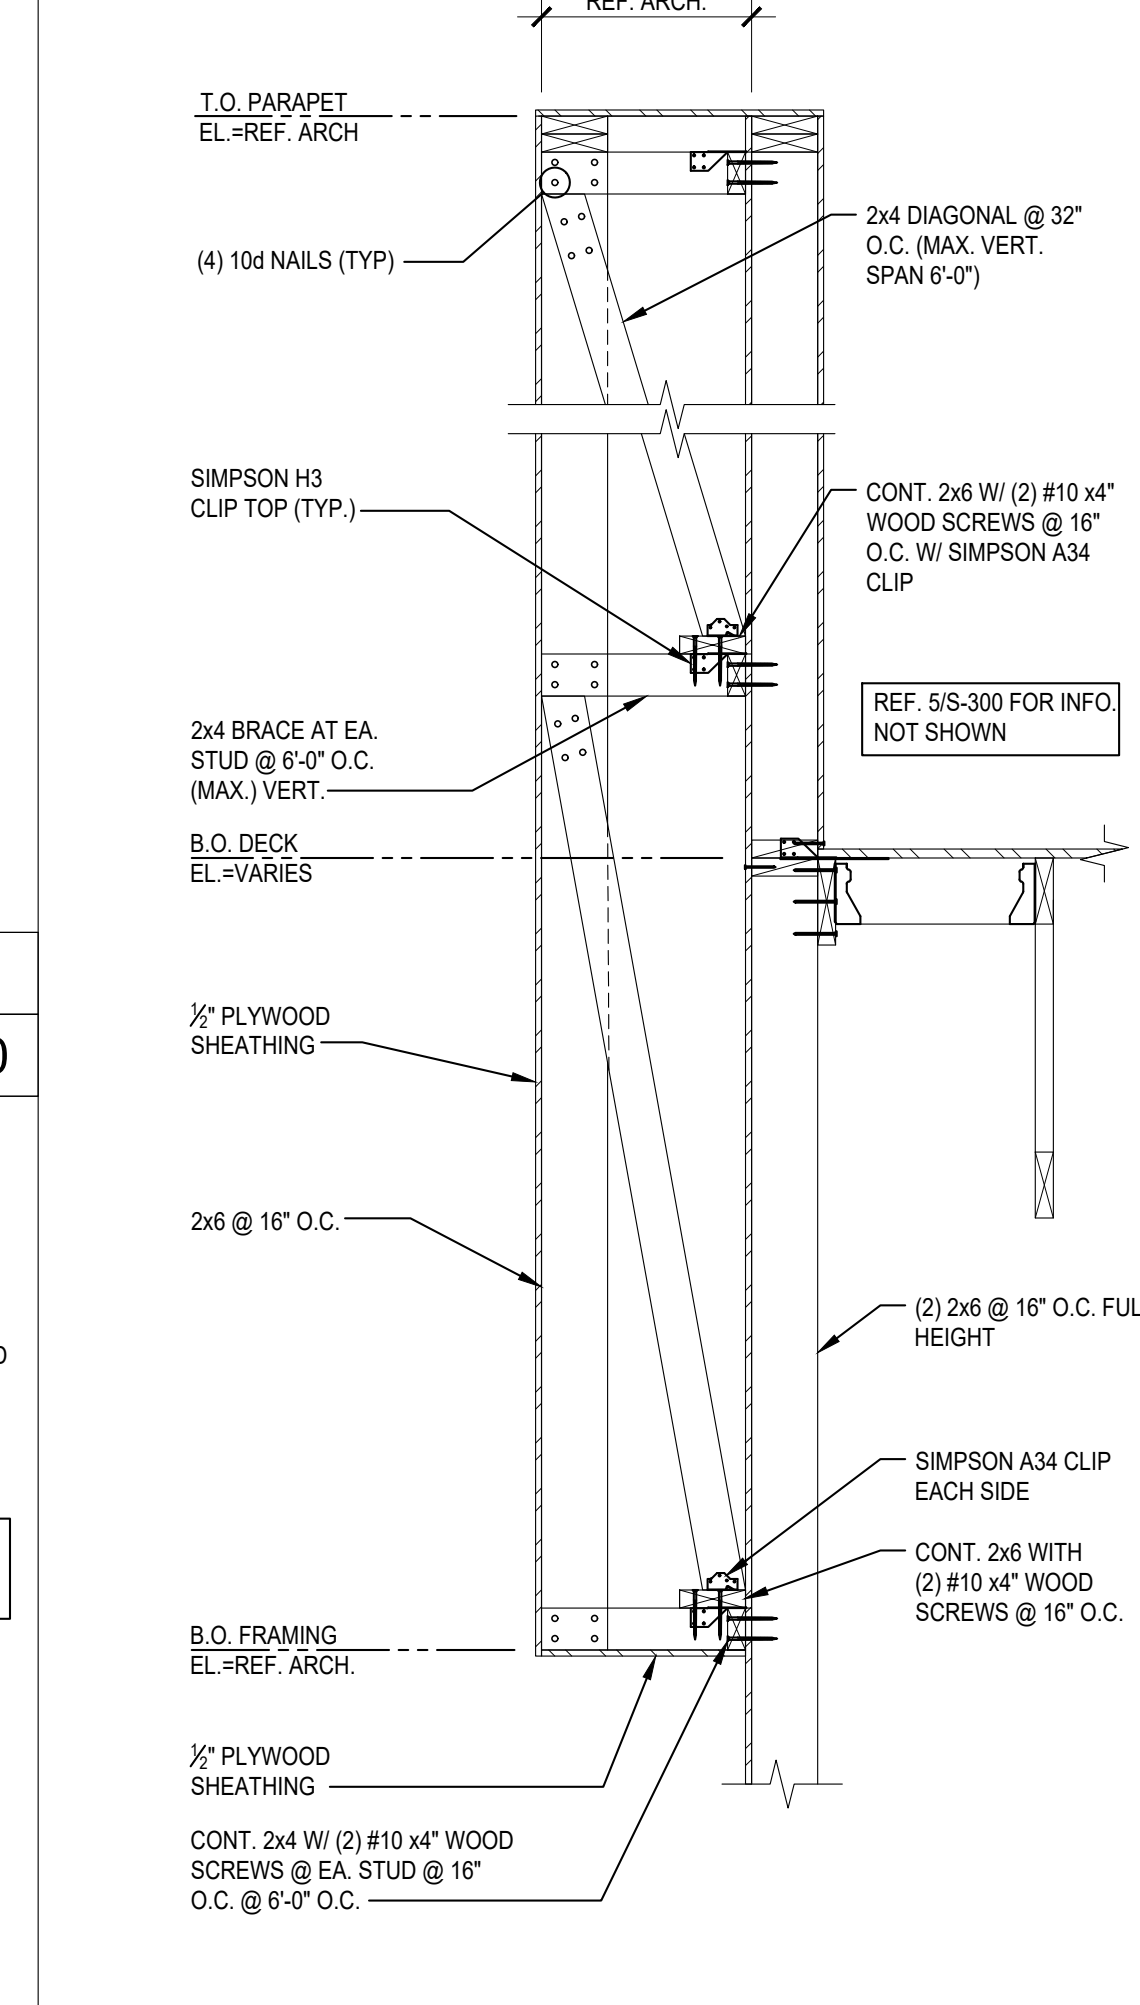


SECTION 5
SCALE: 3/4"=1'-0"
S-300

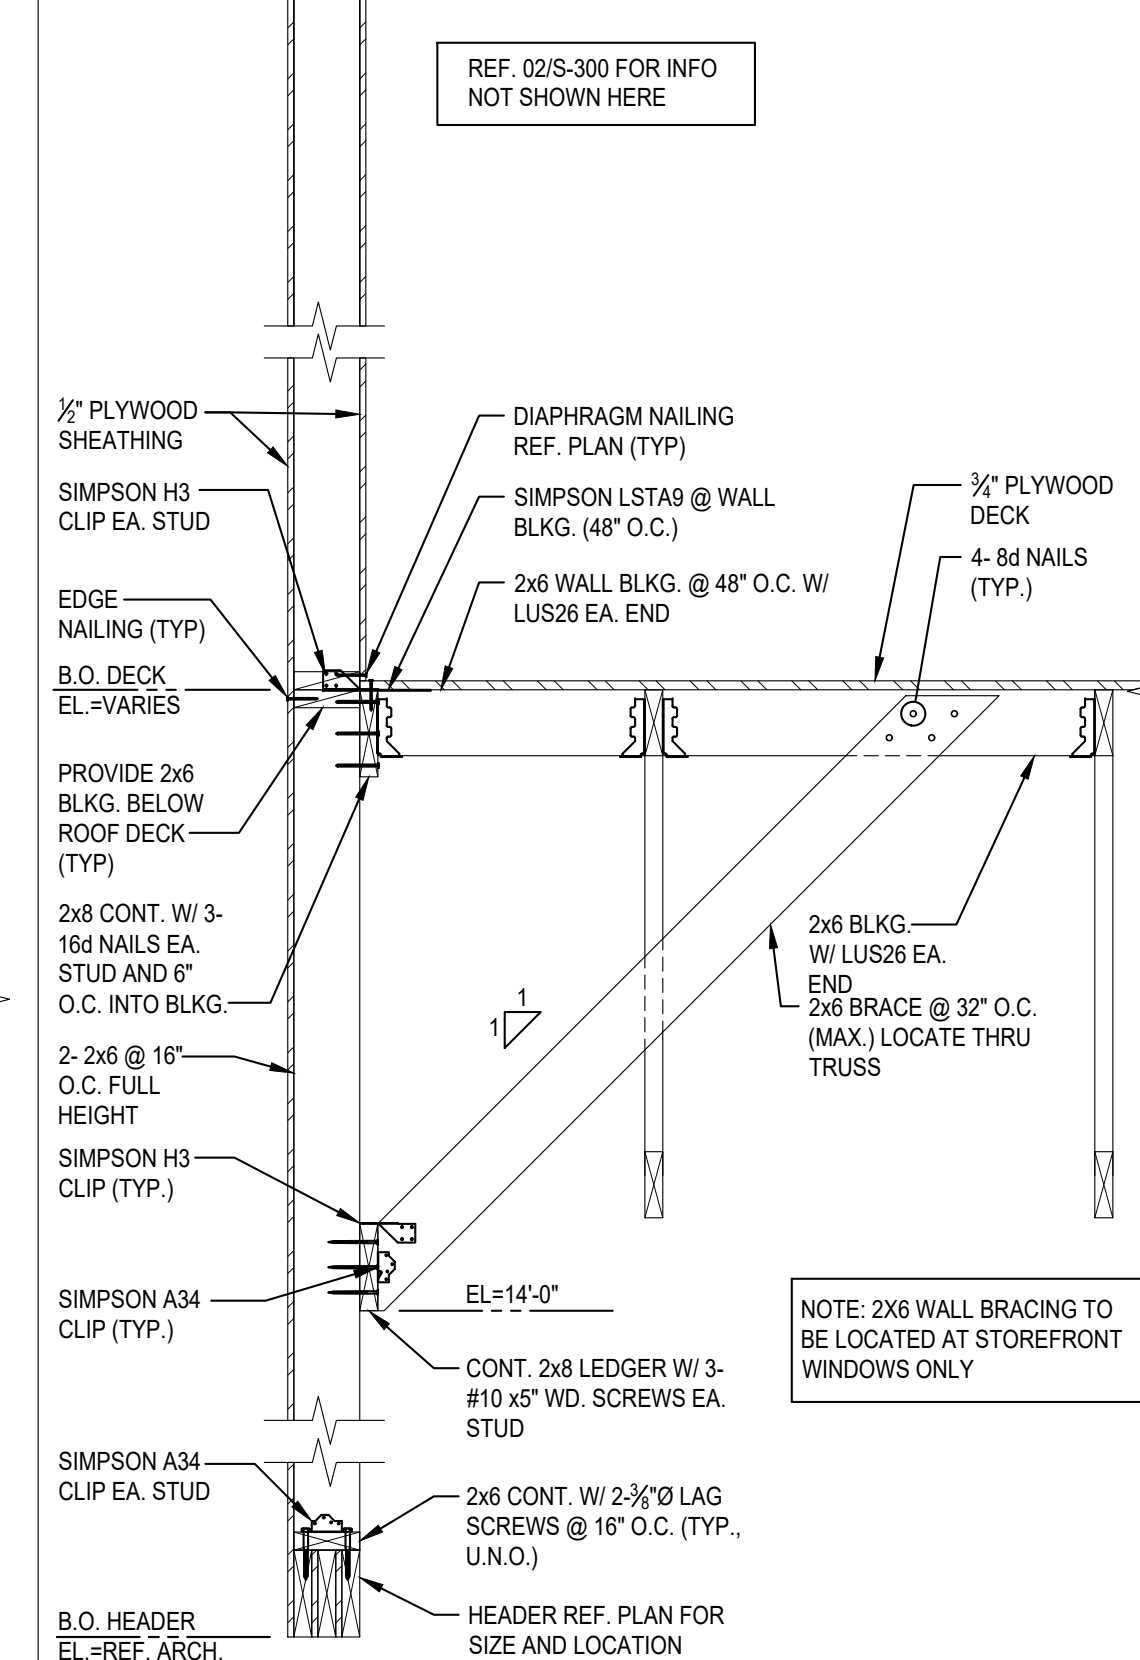


SECTION 2
SCALE: 3/4"=1'-0"
S-300

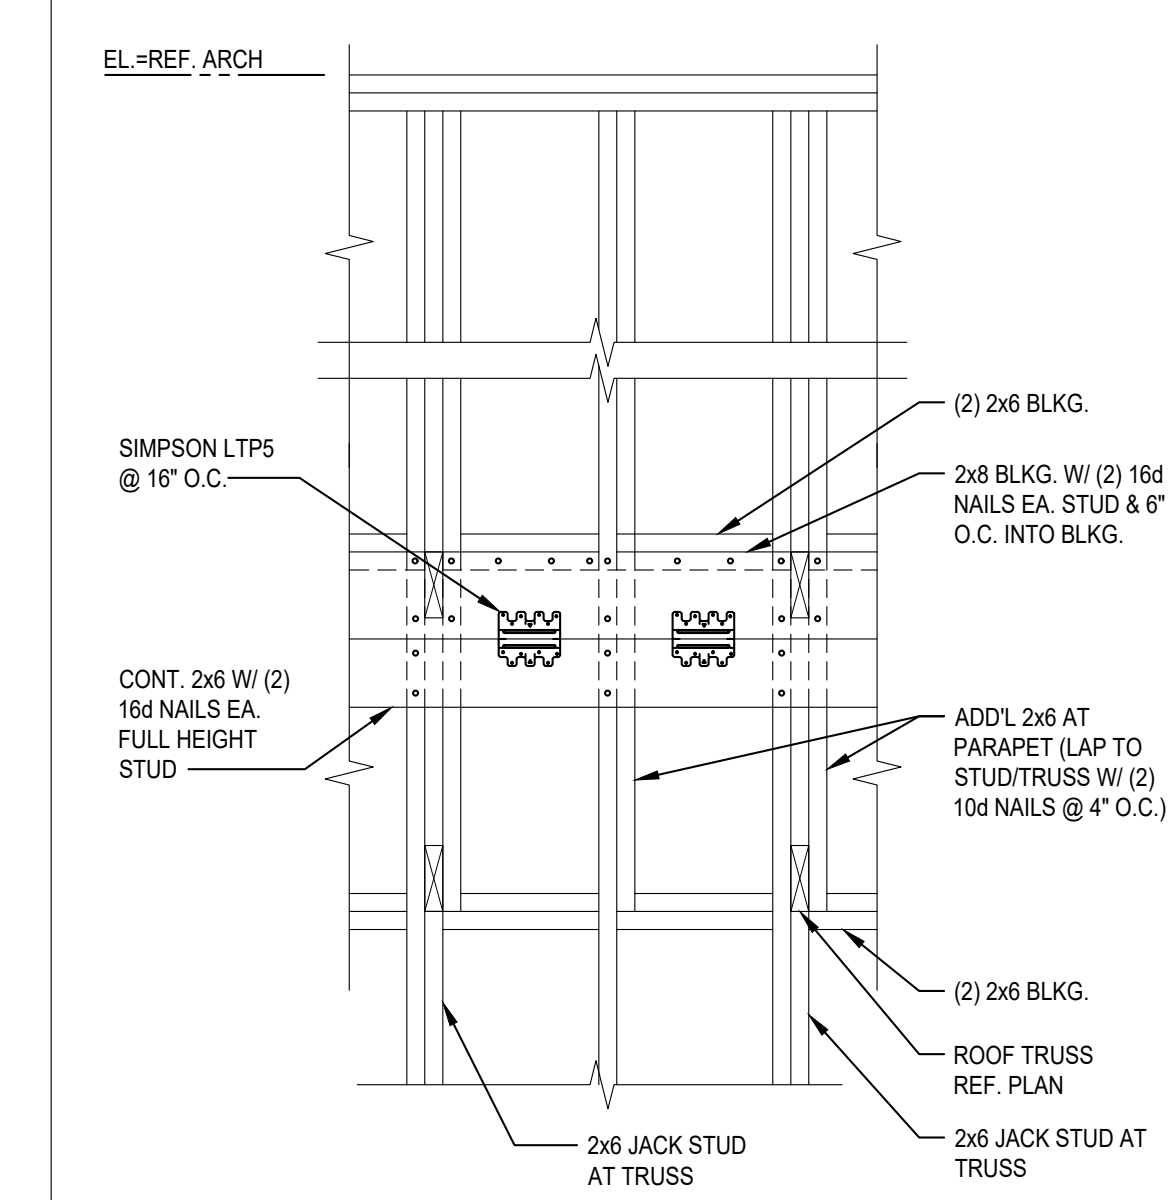

SECTION 11
SCALE: 3/4"=1'-0"
S-300

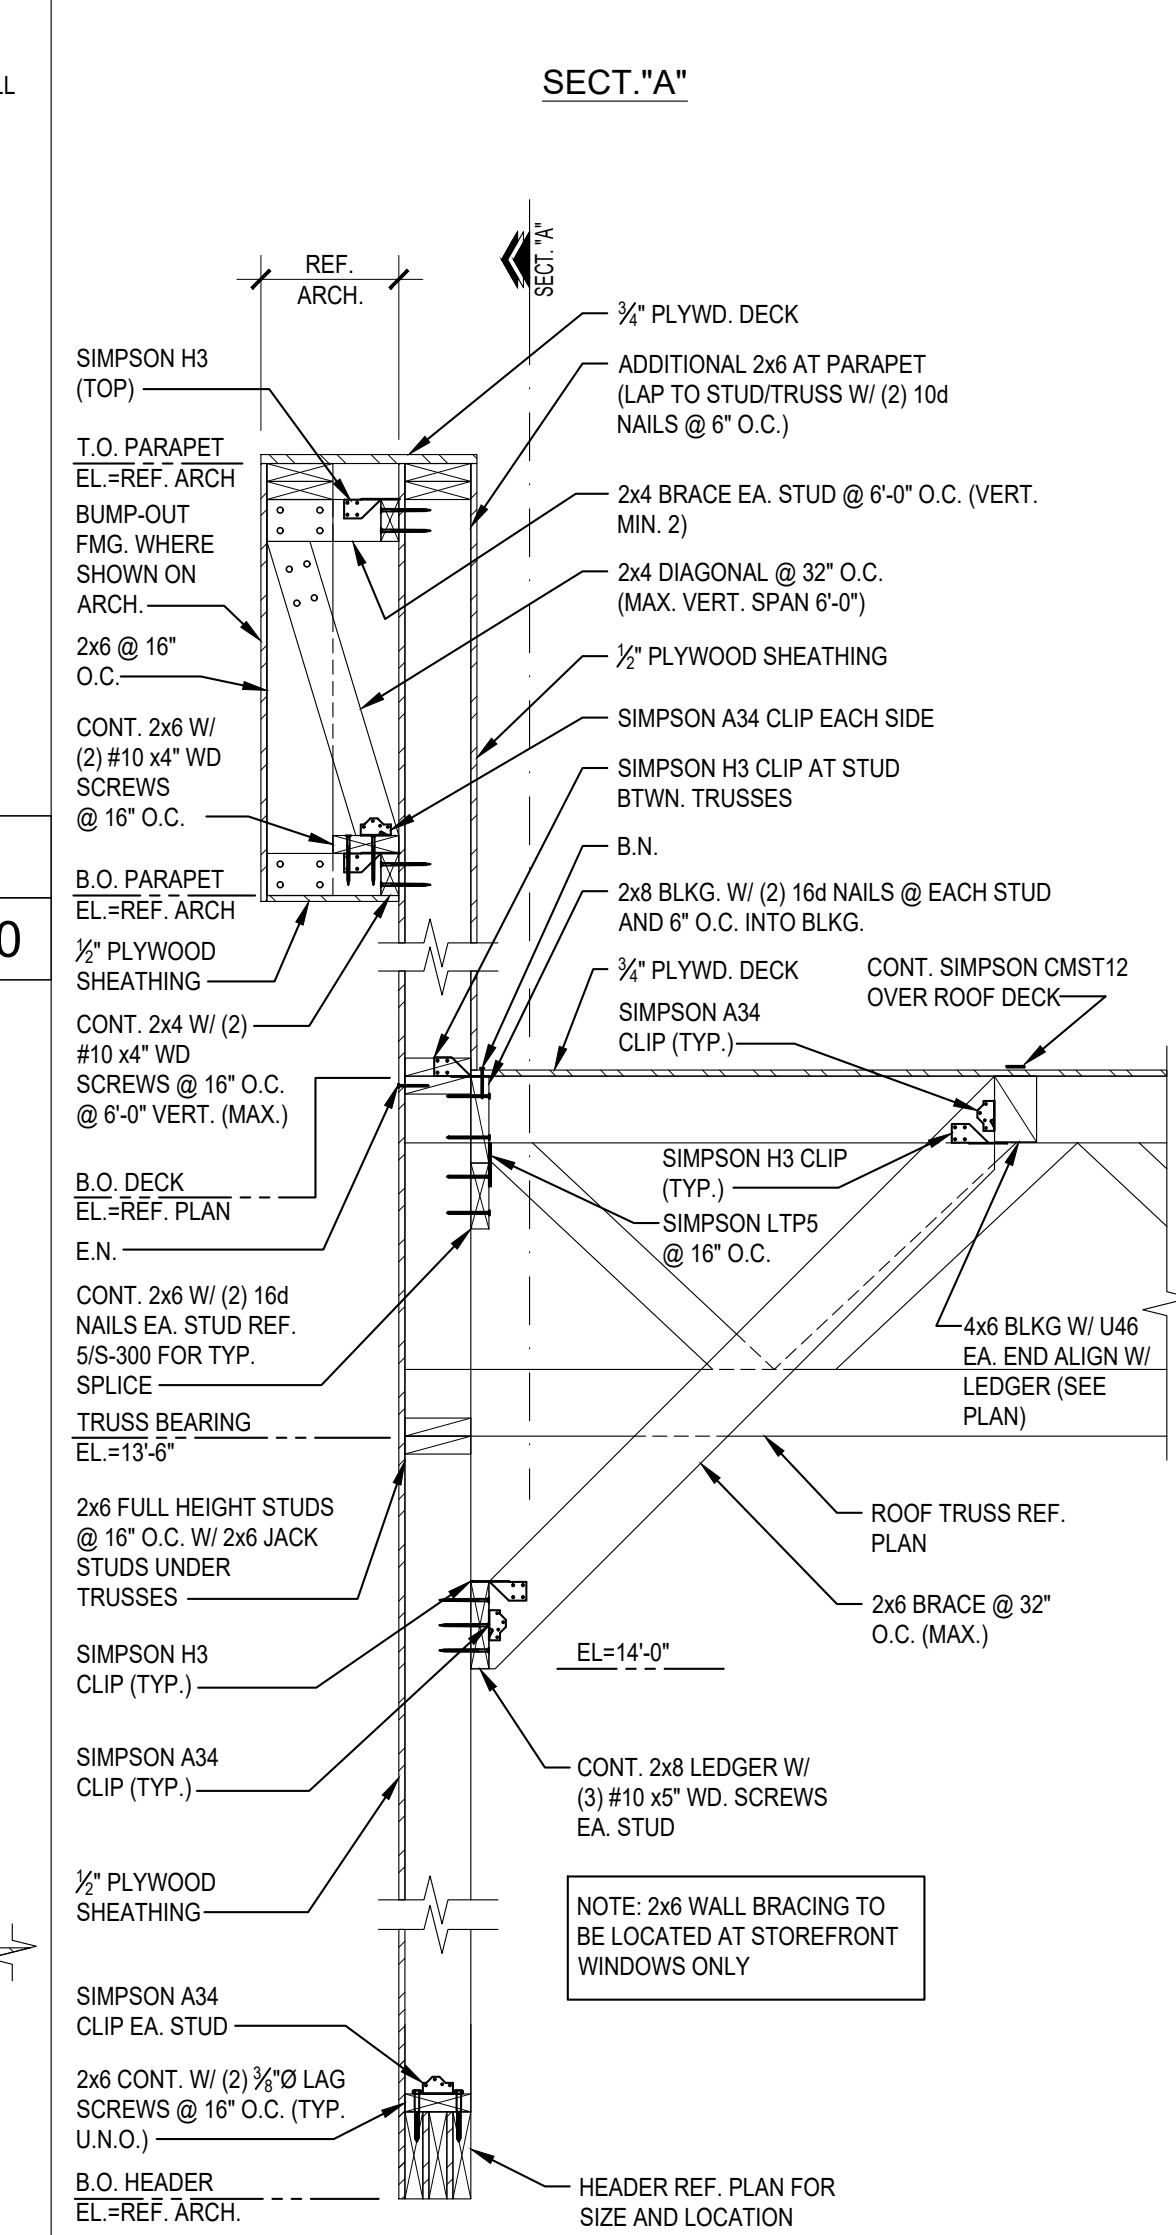

SECTION 16
SCALE: 3/4"=1'-0"
S-300

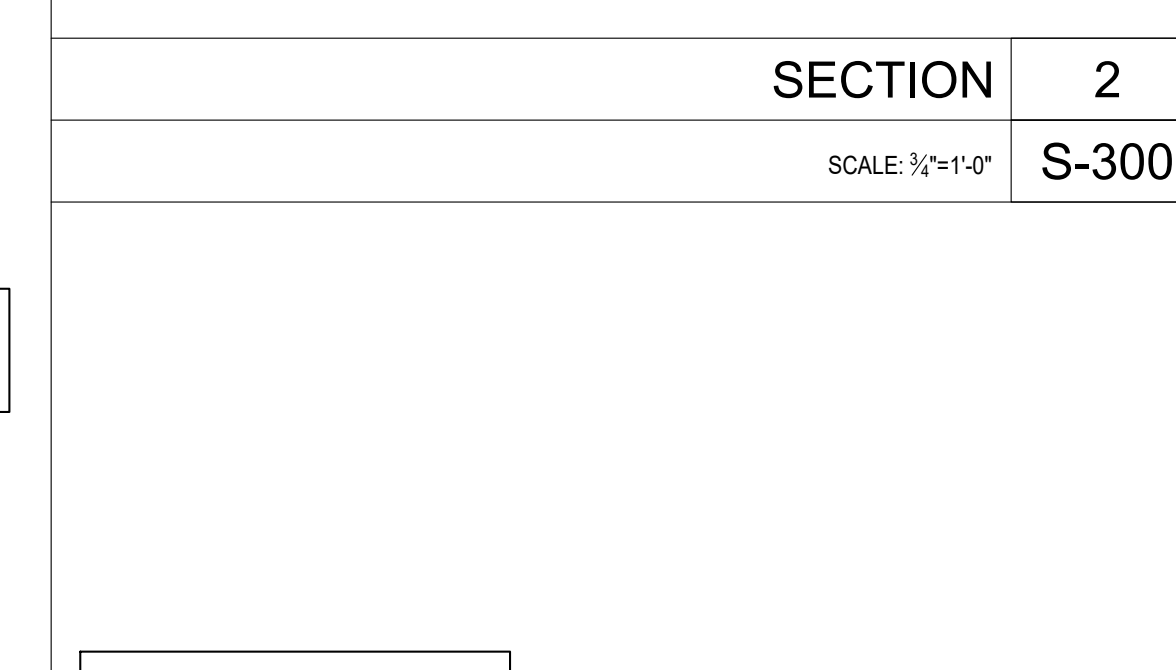

SECTION 19
SCALE: 3/4"=1'-0"
S-300



PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California 91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:		
ISSUE DATE:		
1	CHECK SET	12-15-20
2	PERMIT SET	12-18-20
3	BID SET	02-01-21

DRAWN BY: DAS

PANDA PROJECT #: S8-21-D8043
ARCH PROJECT #: P7356.2




PANDA EXPRESS
TRUE WARM & WELCOME 2300
2599 S WOODLAND BLVD
DELAND, FL 32720

S-300


FRAMING SECTIONS

TRUE WARM & WELCOME 2300 R1

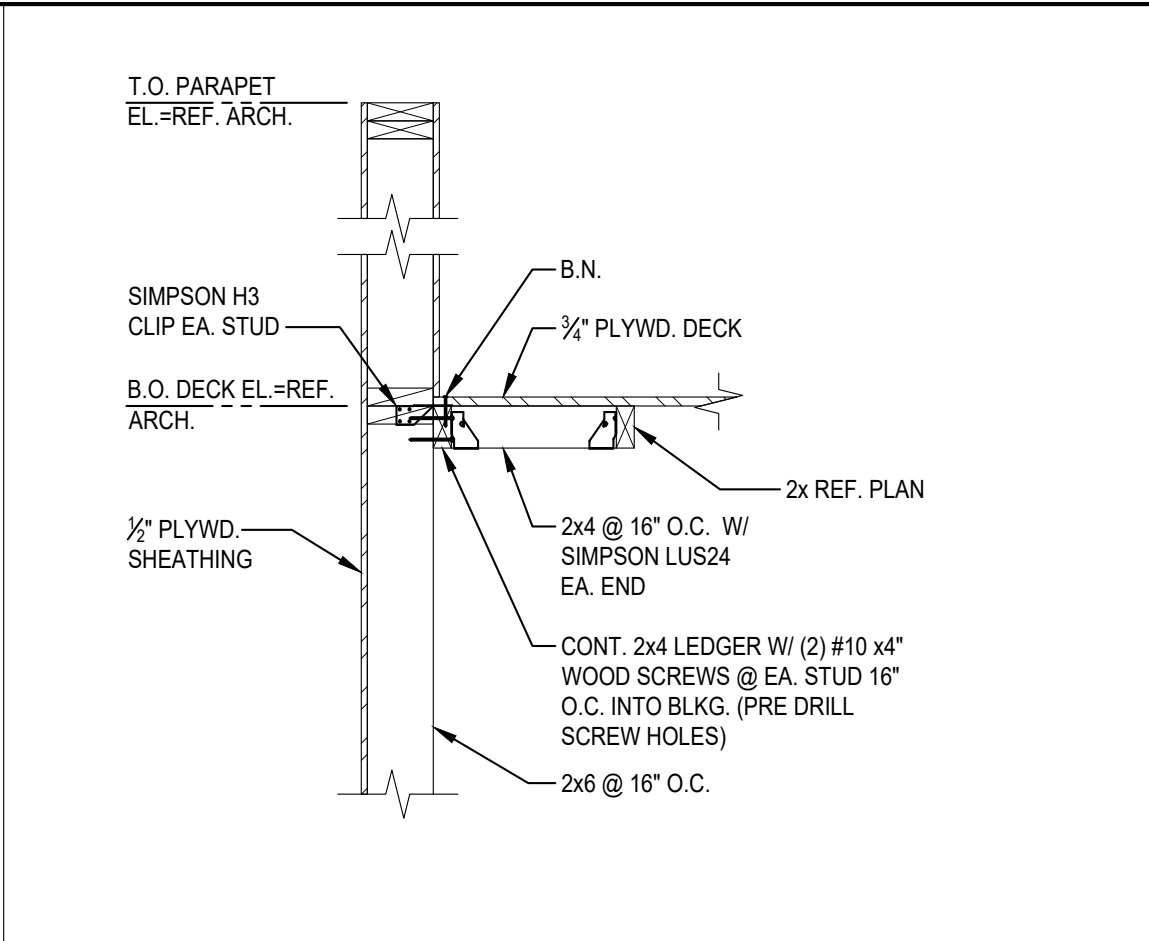


SECTION 20

SCALE: 3/4"=1'-0" S-301

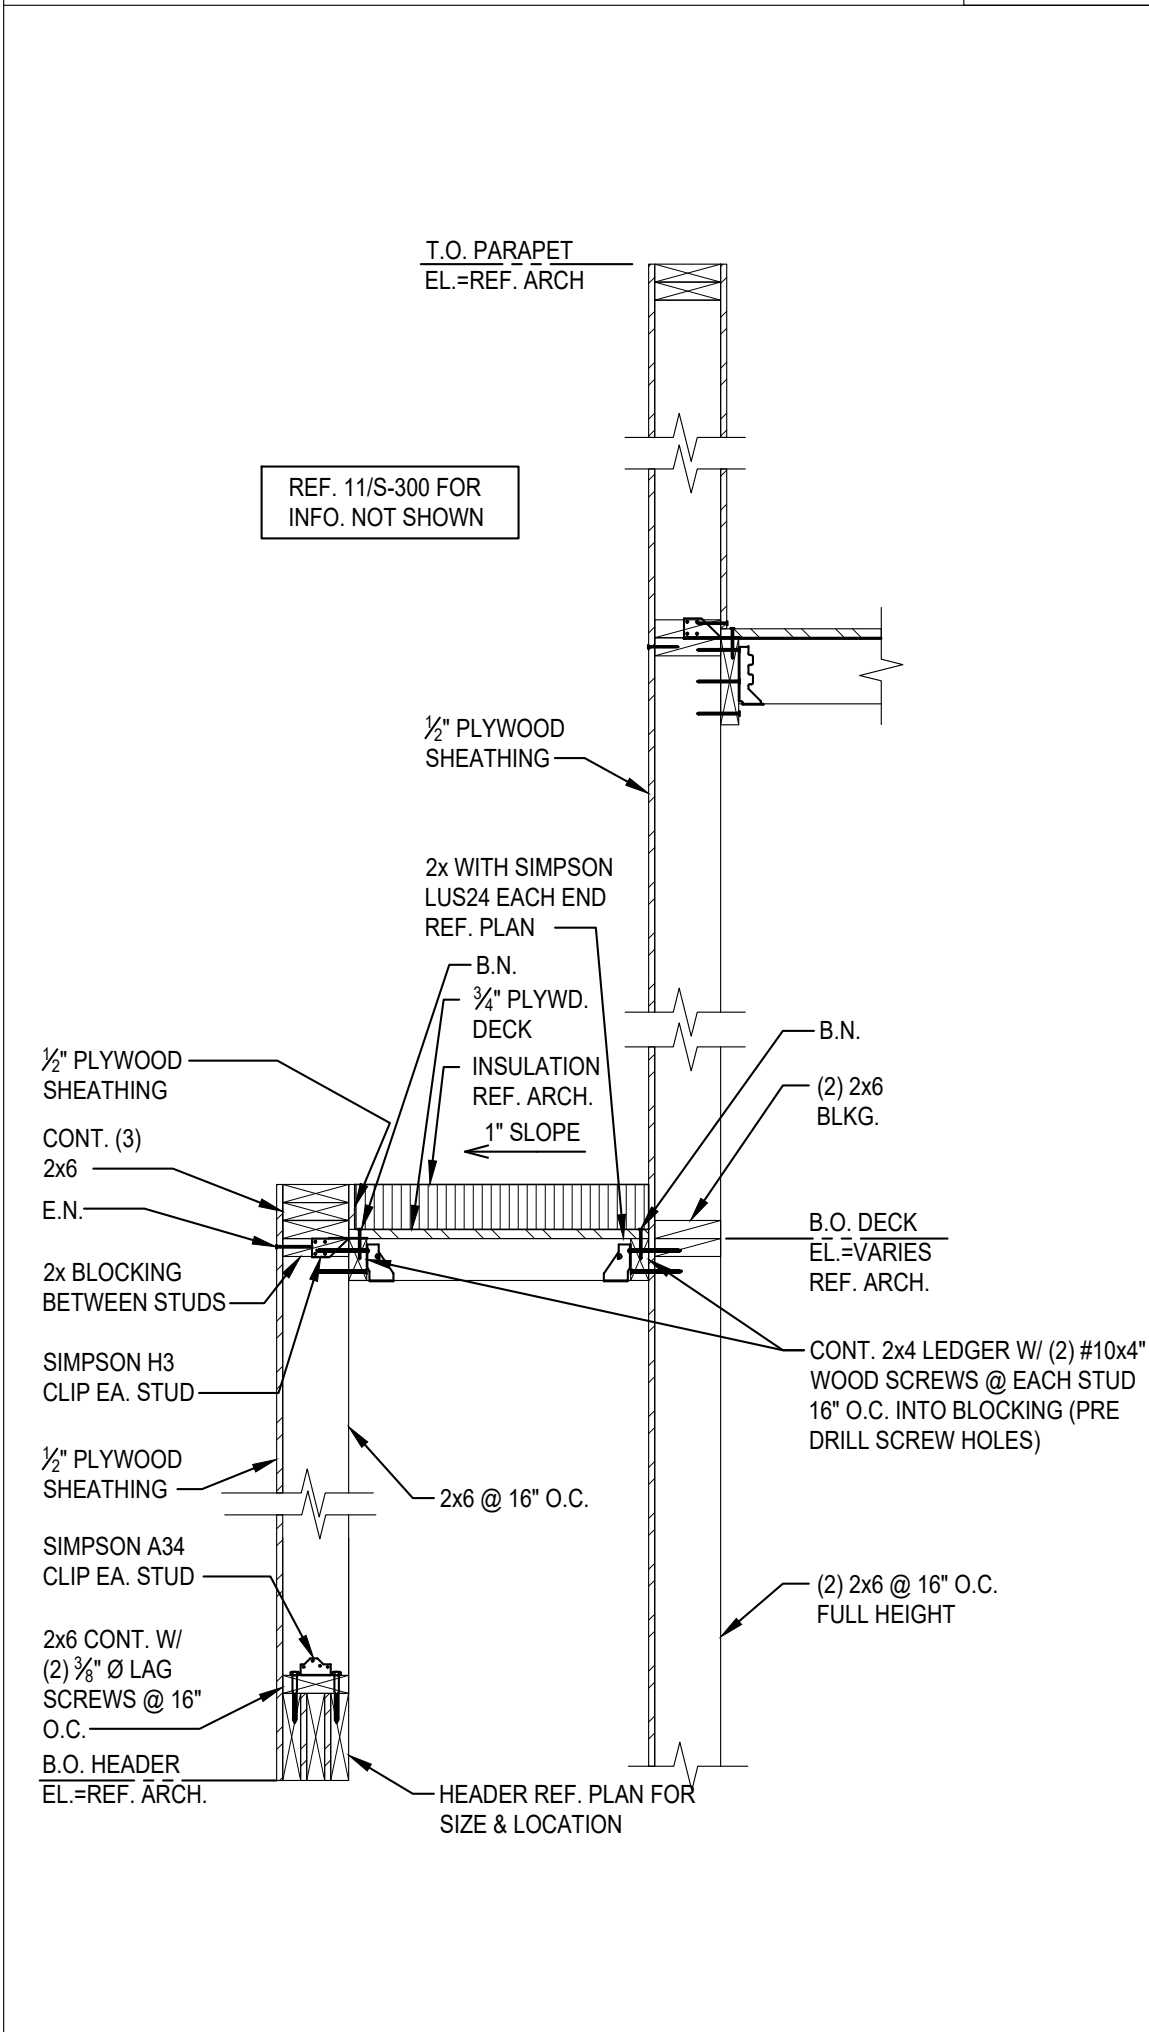


SECTION 18

SCALE: 3/4"=1'-0" S-301

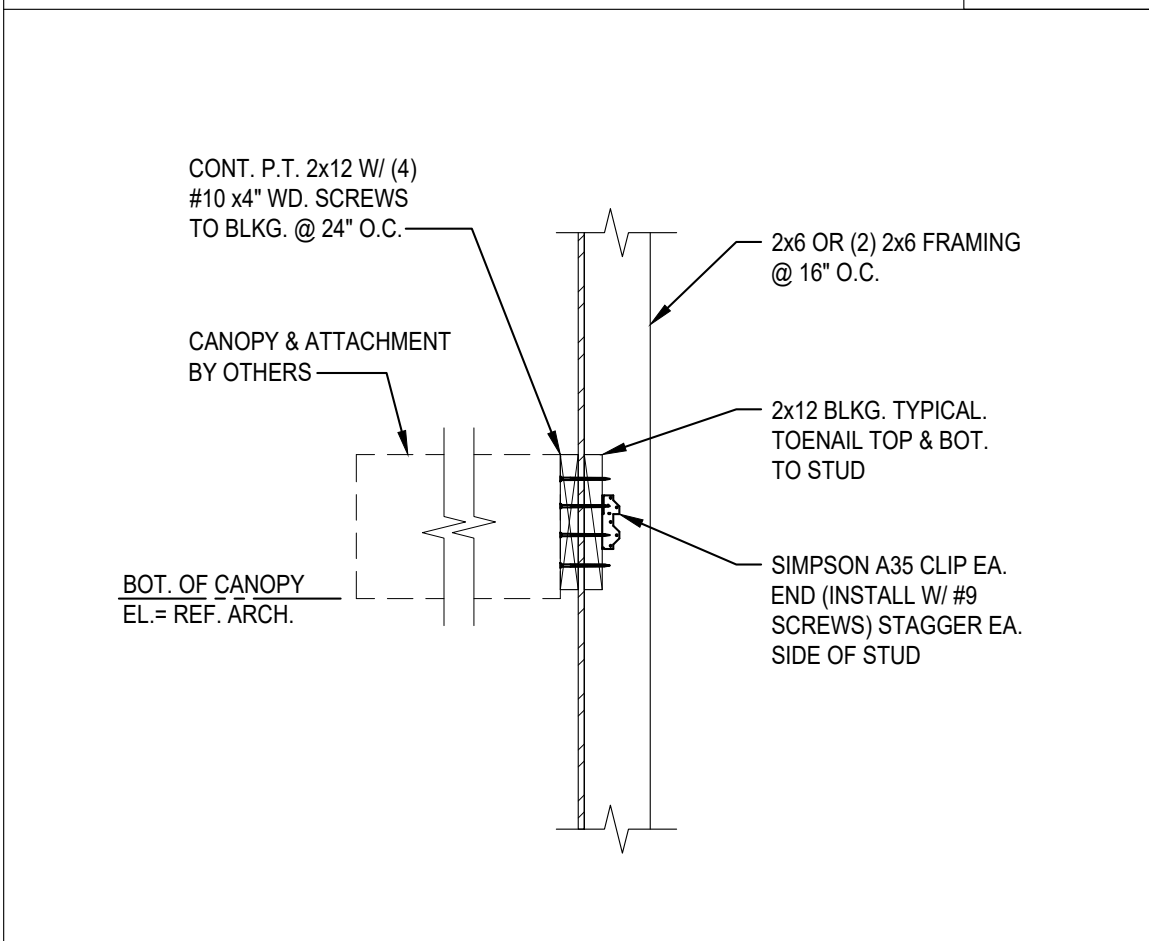


TYPICAL CANOPY BLOCK (U.N.O.) 17

SCALE: 3/4"=1'-0" S-301

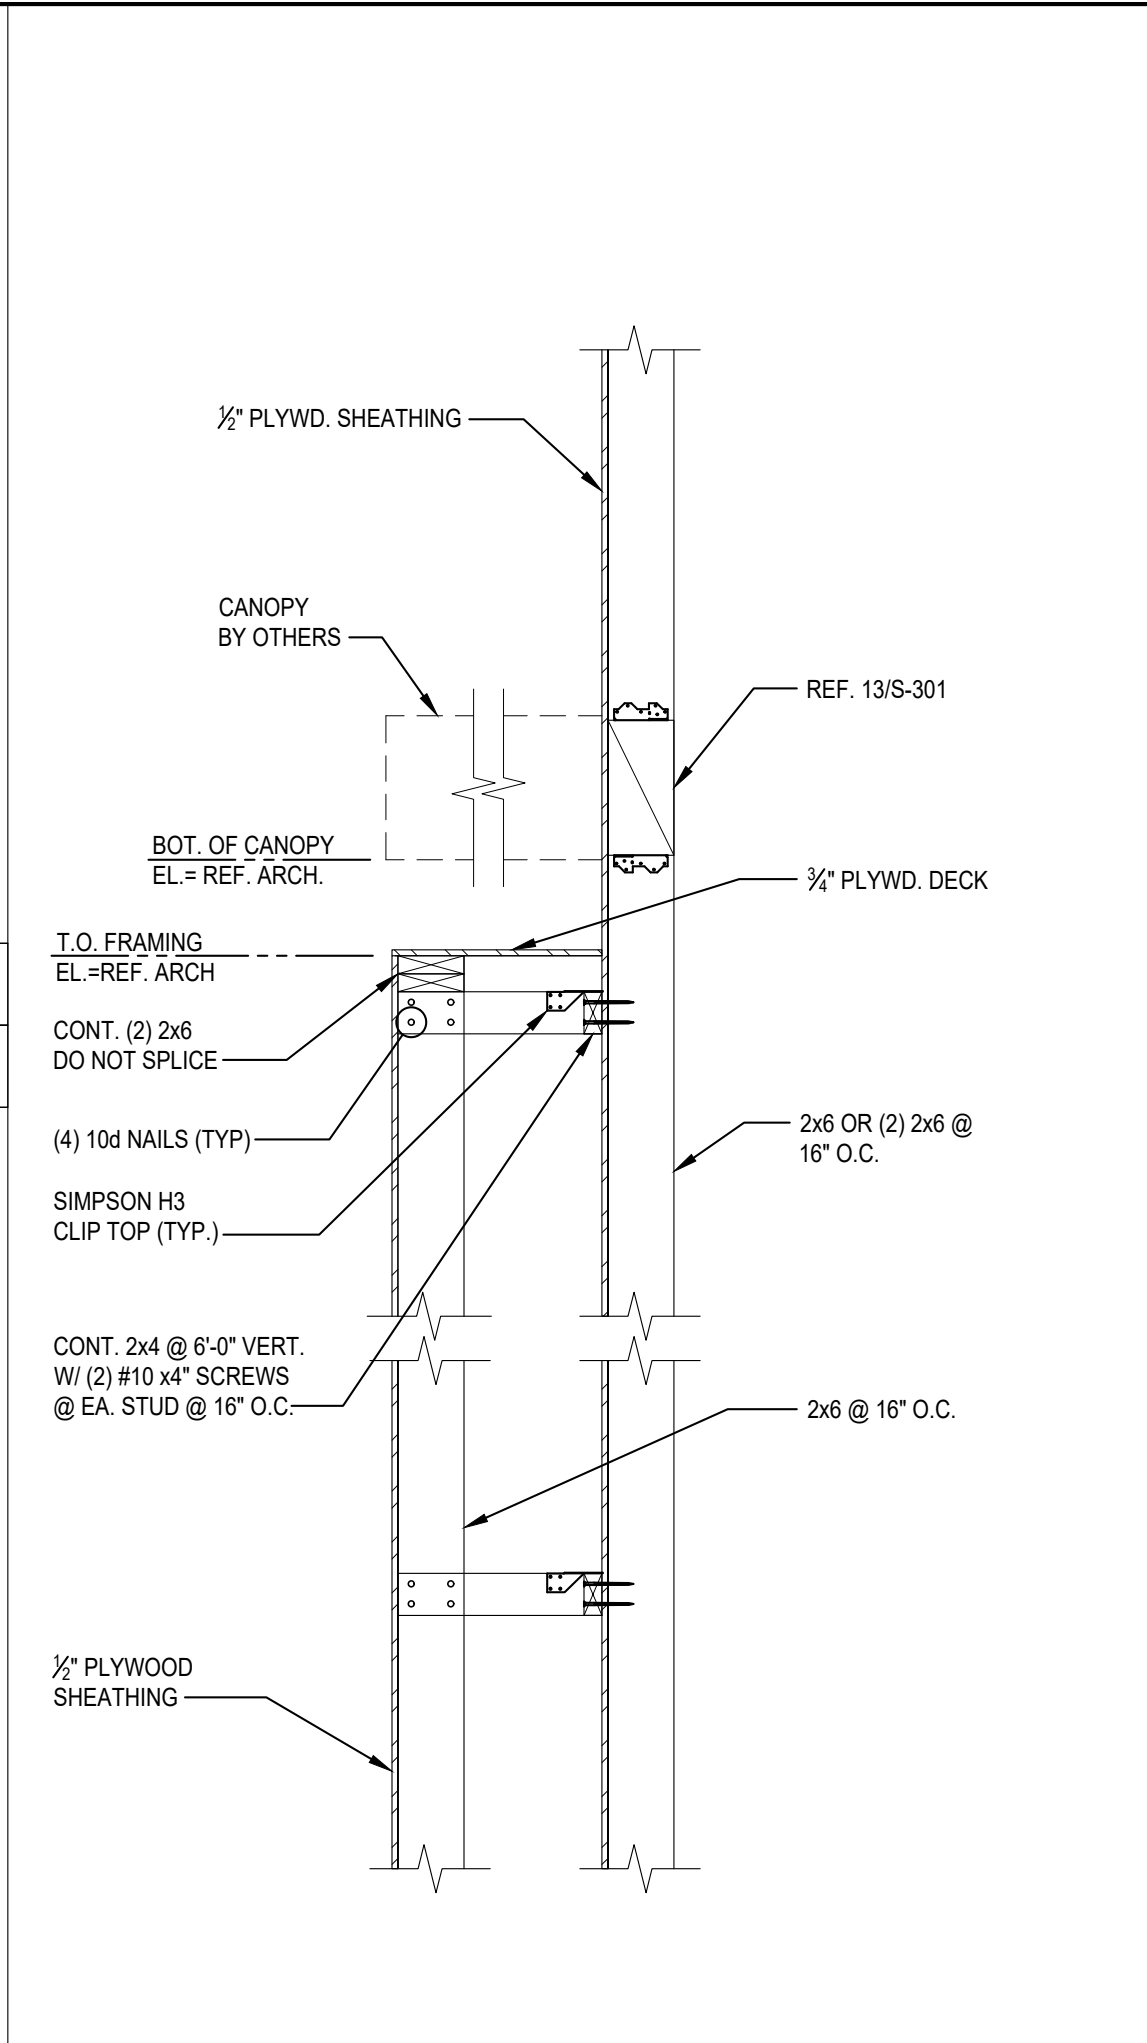


SECTION 15

SCALE: 3/4"=1'-0" S-301

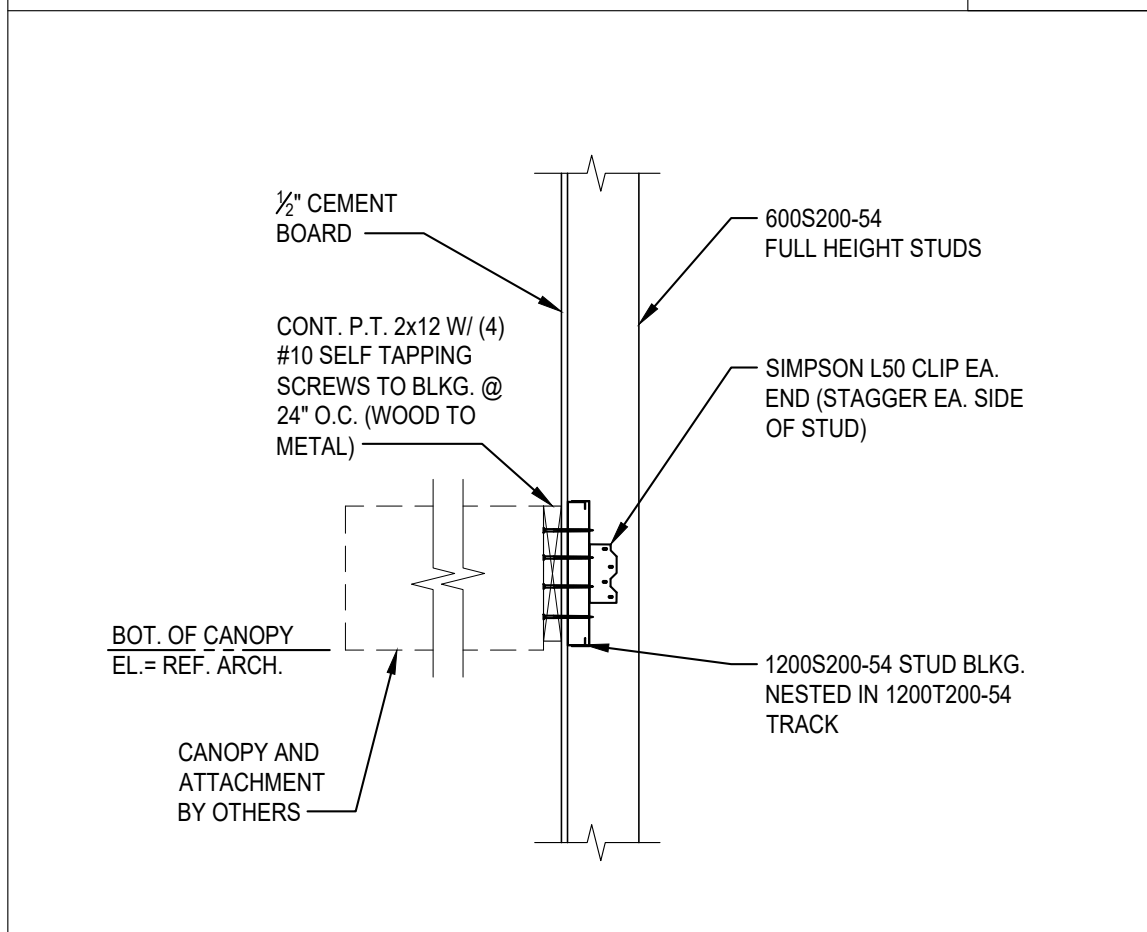


SMALL CANOPY BLKG. @ MTL STUD 14

SCALE: 3/4"=1'-0" S-301

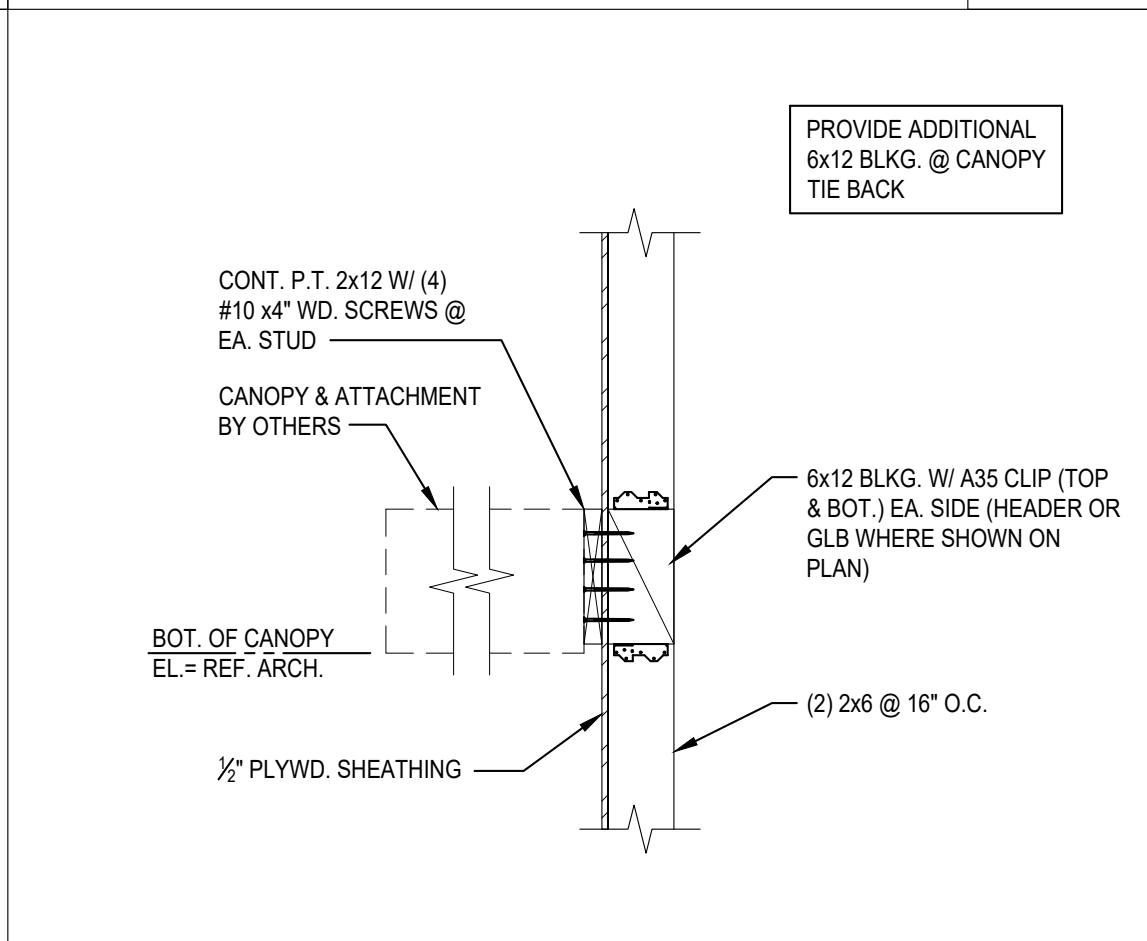


LARGE FRONT CANOPY BLKG. 13

SCALE: 3/4"=1'-0" S-301

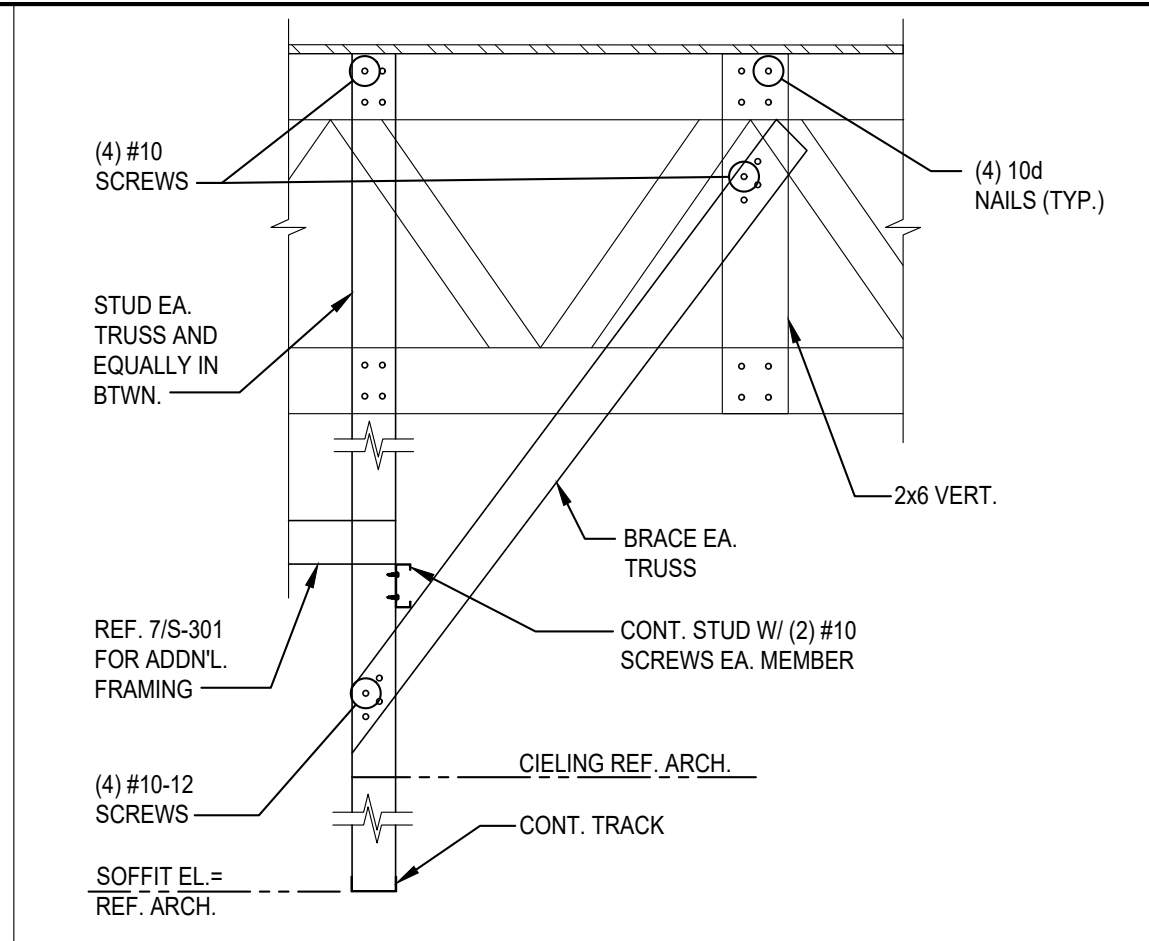


SOFFIT DETAIL @ SERV. COUNTER 12

SCALE: 3/4"=1'-0" S-301

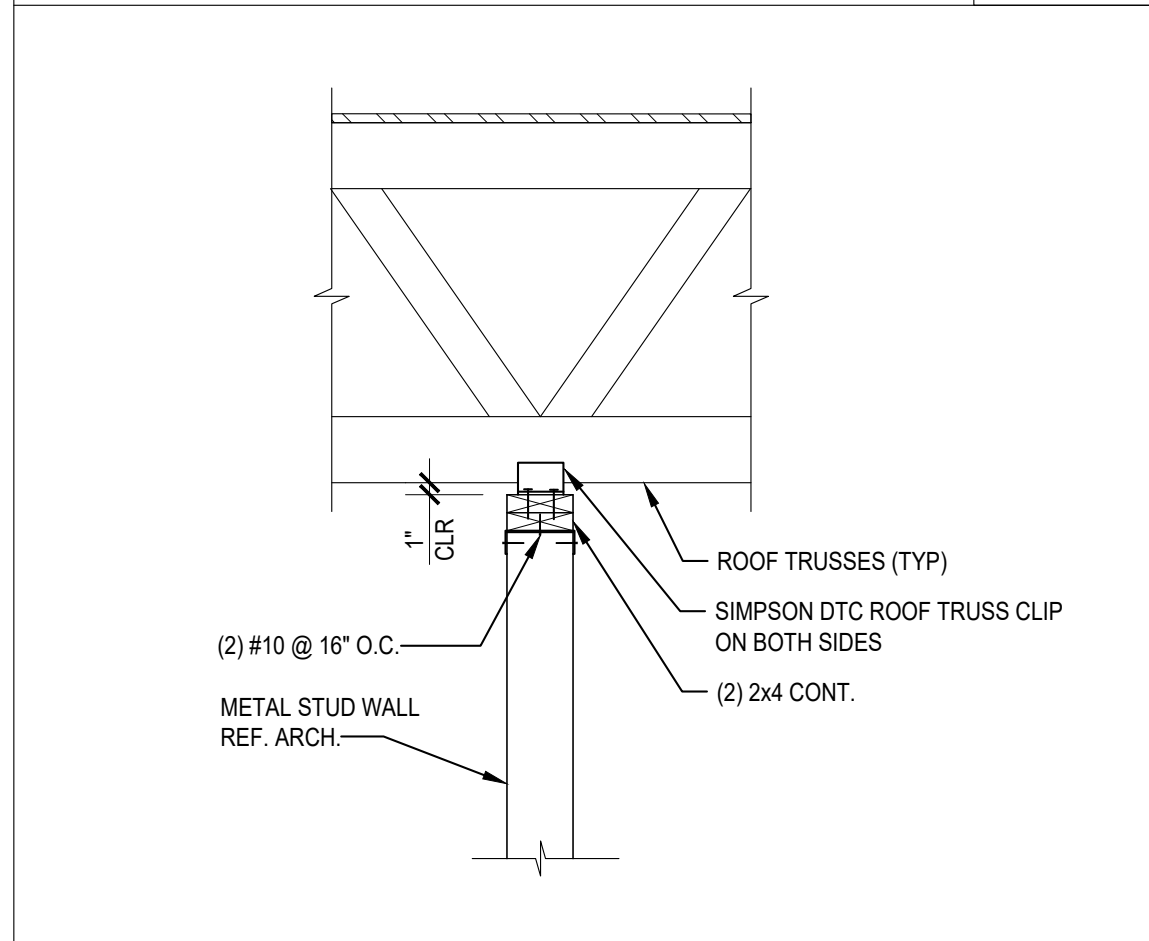


SUPPORT PERPENDICULAR TO TRUSS 11

SCALE: 3/4"=1'-0" S-301

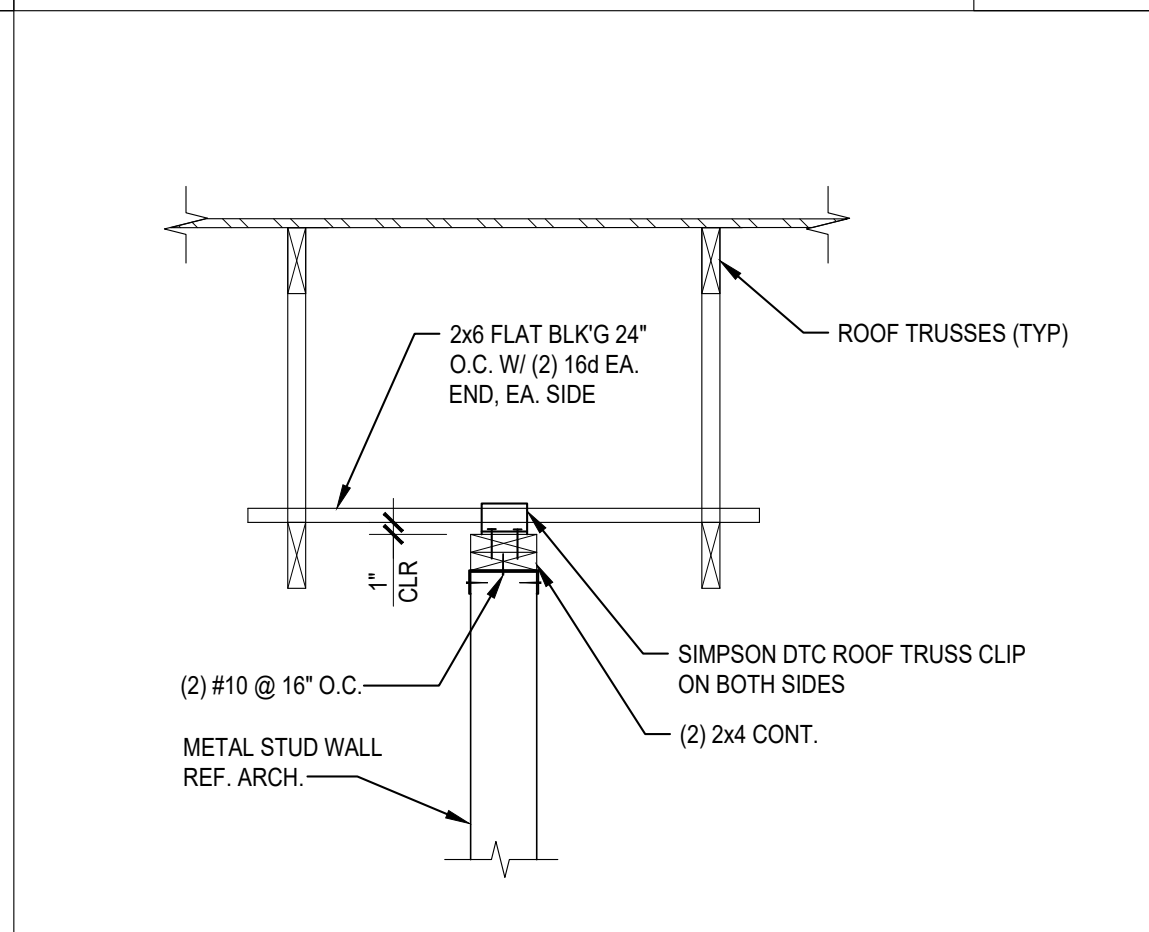


SUPPORT PARALLEL TO TRUSS 10

SCALE: 3/4"=1'-0" S-301

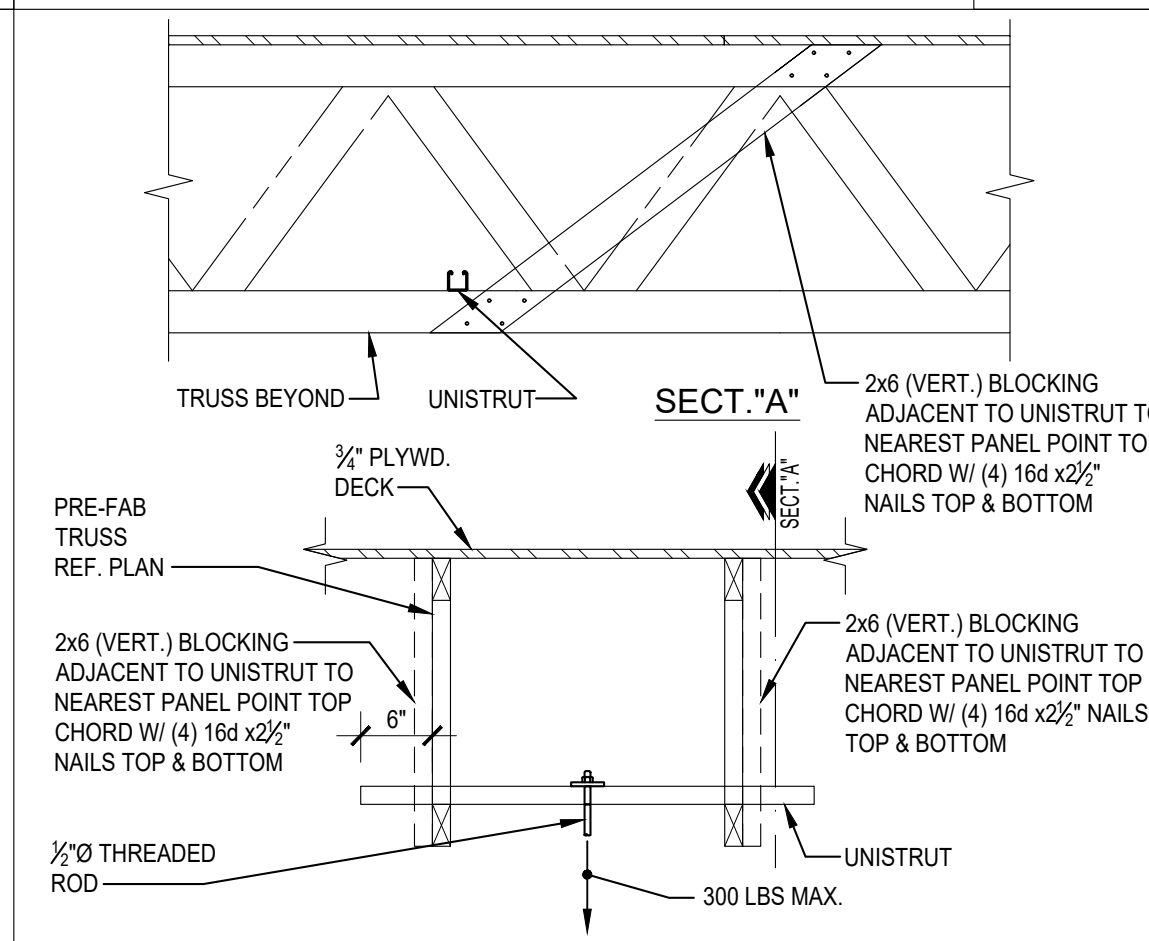


TYPICAL HANGER SUPPORT 9

SCALE: 3/4"=1'-0" S-301

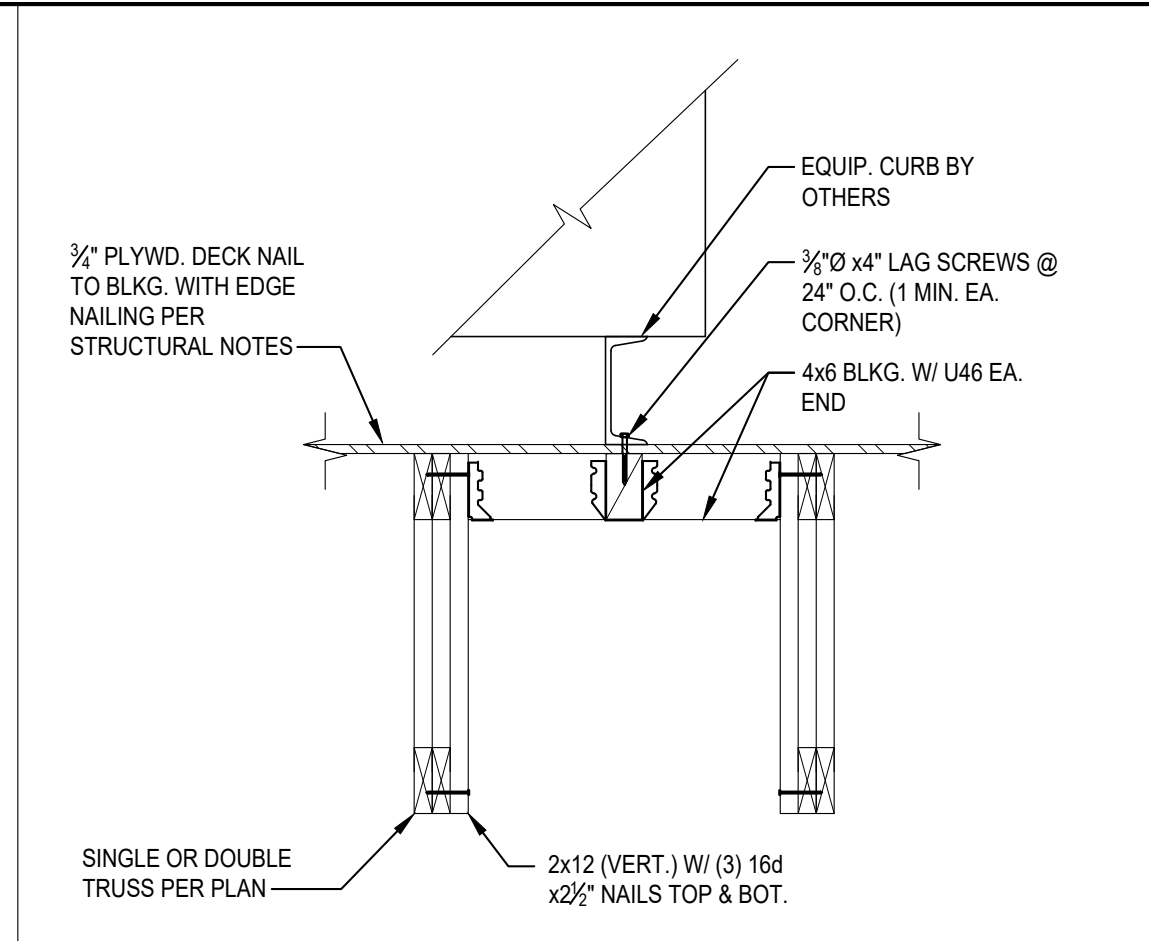


TYP. MECHANICAL SUPPORT UNIT 8

SCALE: 3/4"=1'-0" S-301

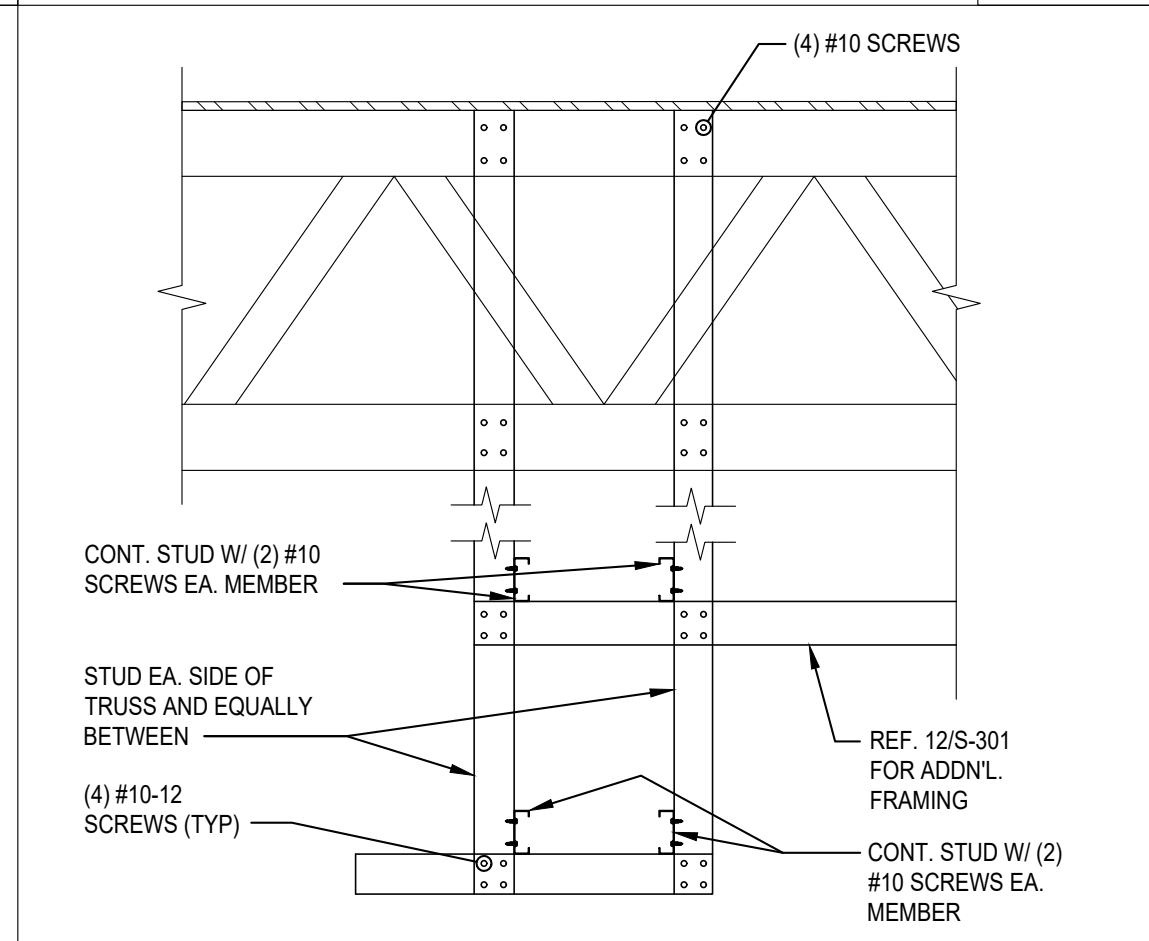


SOFFIT DETAIL @ SERV. COUNTER 7

SCALE: 3/4"=1'-0" S-301

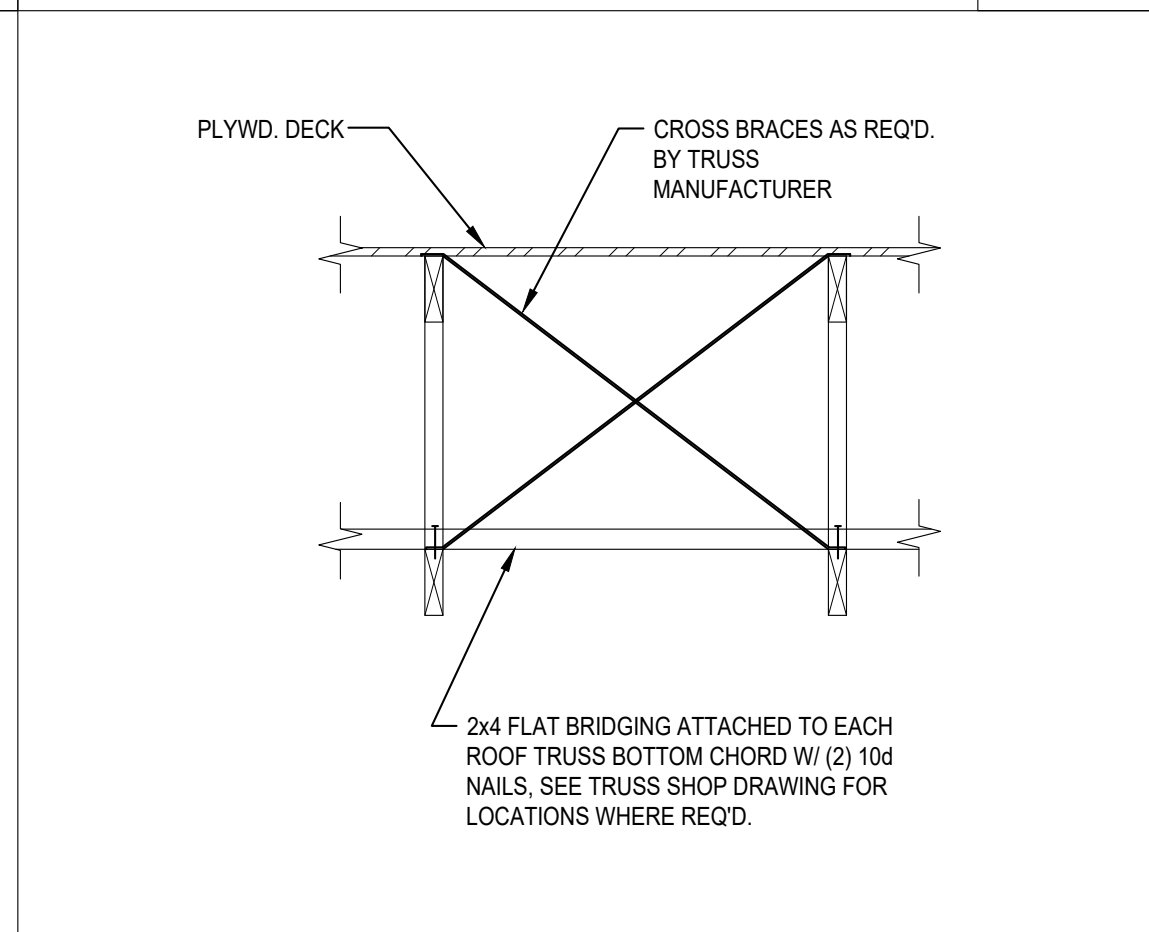


TYPICAL BRIDGING AND BRACING 6

SCALE: 3/4"=1'-0" S-301

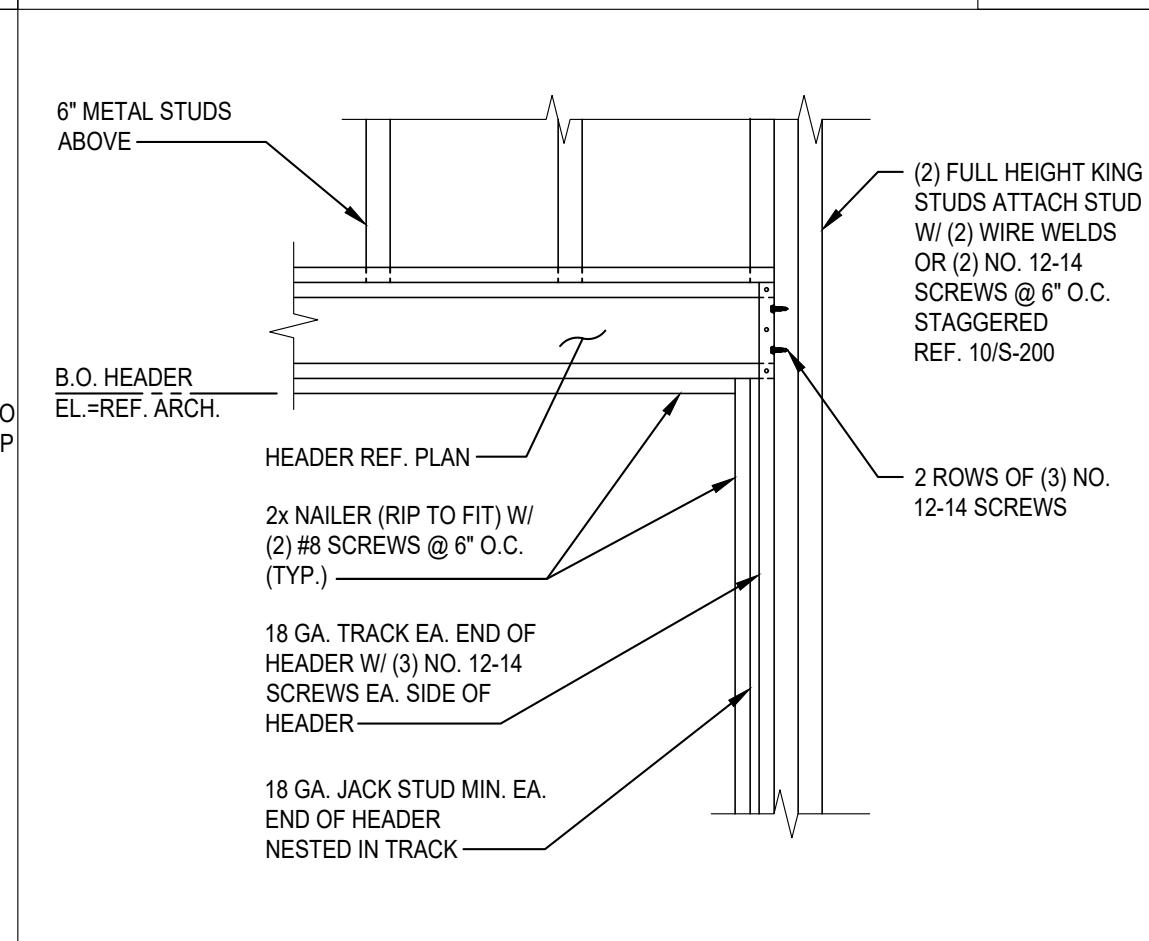


TYP. LIGHT GAGE HDR. FRAMING 5

SCALE: 3/4"=1'-0" S-301

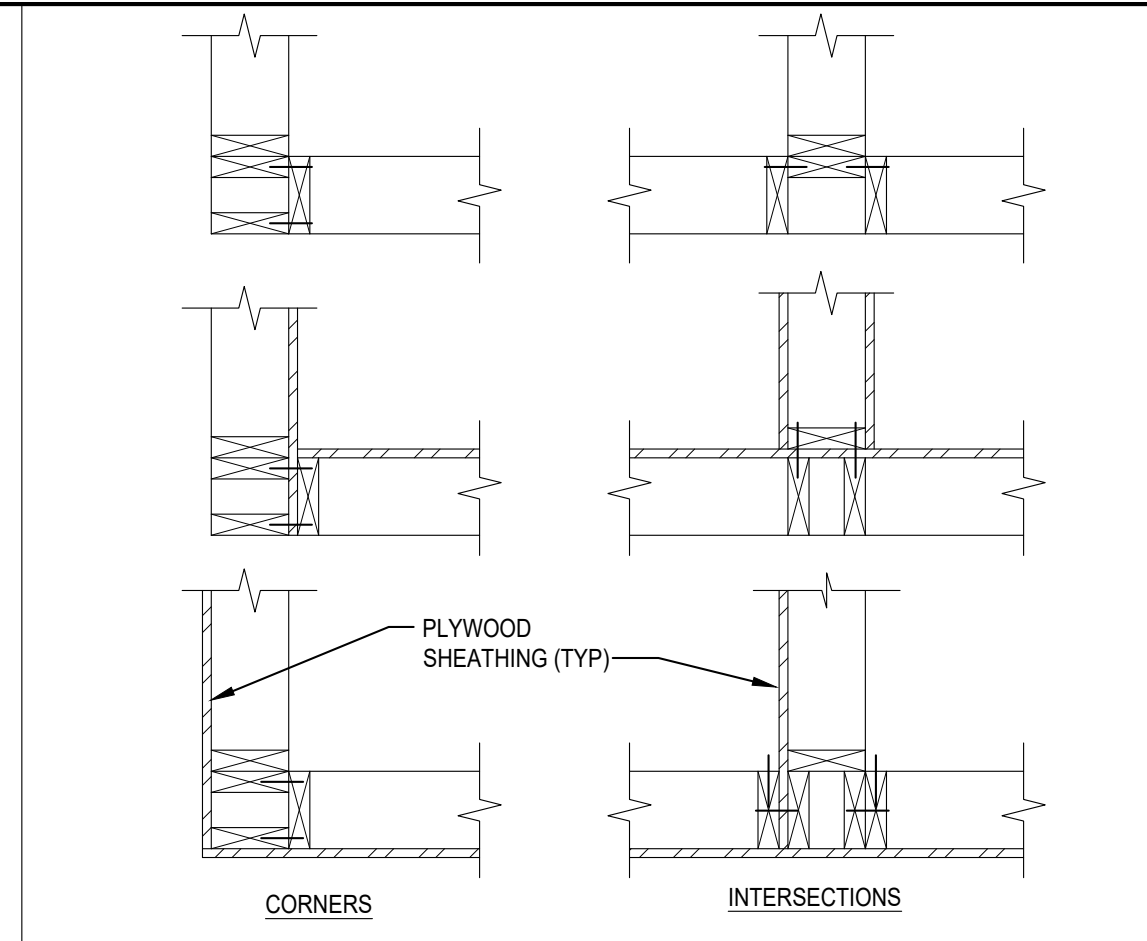


TYPICAL WALL FRAMING 4

SCALE: 3/4"=1'-0" S-301

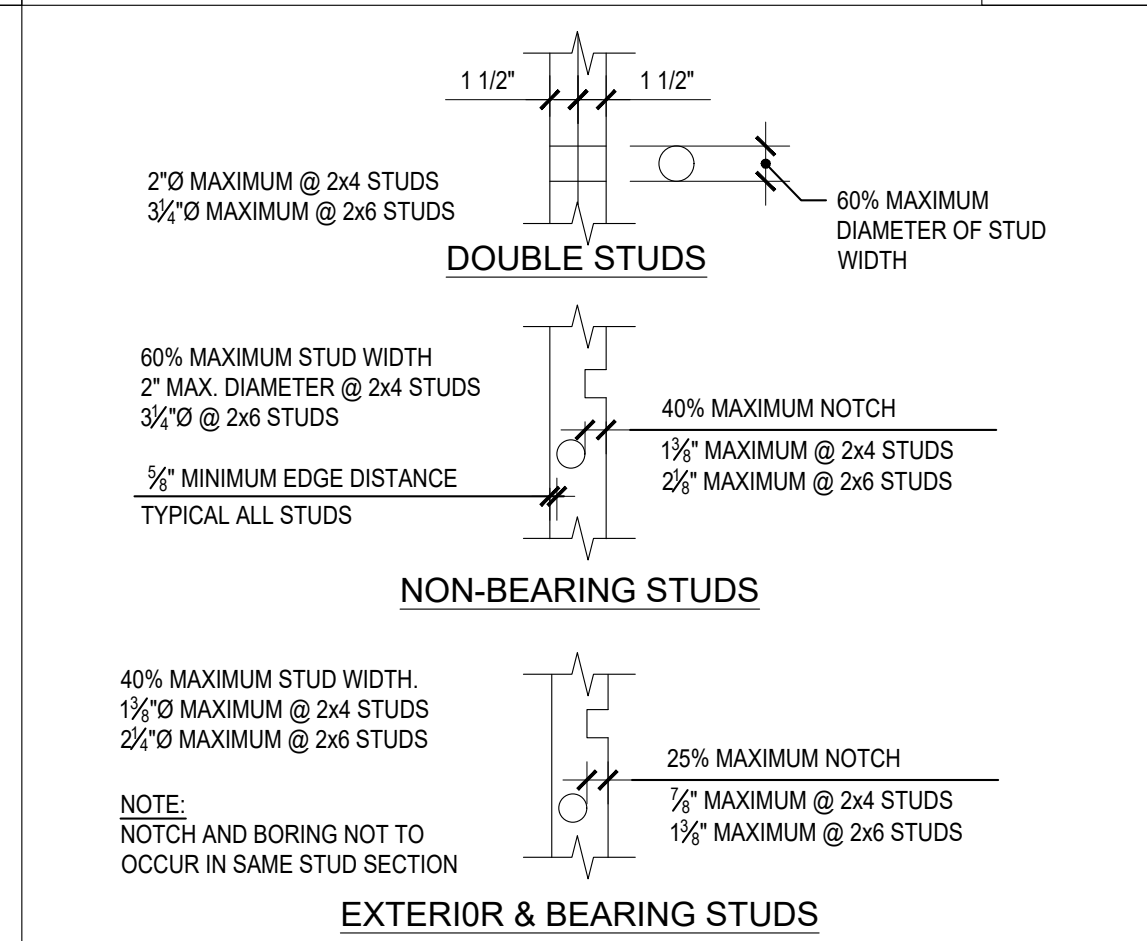

TYPICAL FRAMING NOTCHES 3

SCALE: N.T.S. S-301

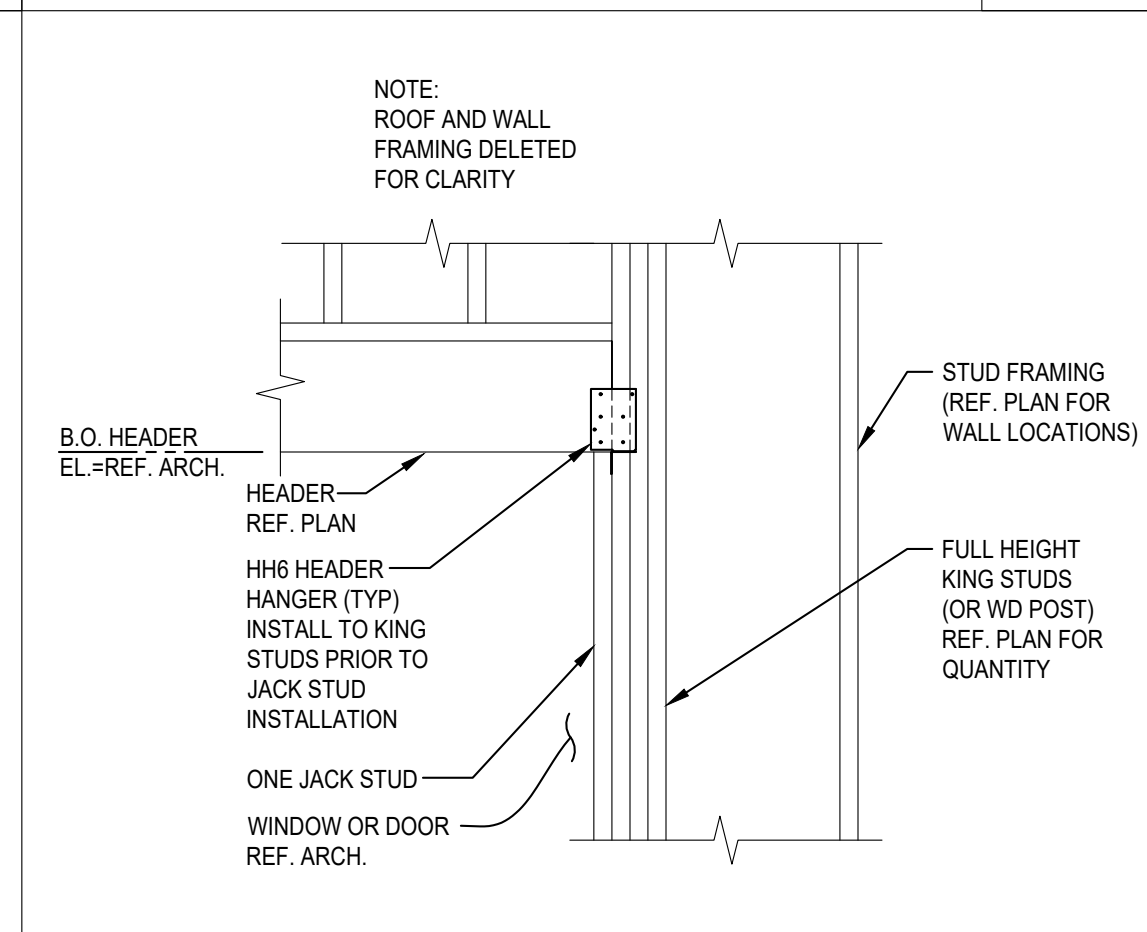

TYPICAL WOOD HEADER FRAMING 2

SCALE: 3/4"=1'-0" S-301



PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

1	CHECK SET	12-15-20
2	PERMIT SET	12-18-20
3	BID SET	02-01-21

DRAWN BY: DAS

PANDA PROJECT #: S8-21-D8043
ARCH PROJECT #: P7356.2



PANDA EXPRESS
TRUE WARM & WELCOME 2300
2599 S WOODLAND BLVD
DELAND, FL 32720

S-301

TYPICAL FRAMING DETAILS & SECTIONS

TRUE WARM & WELCOME 2300 R1